

# 5 Port Solenoid Valve

Metal Seal / Rubber Seal

CE  
[Option]

RoHS  
compliant

Power saving

Standard: **0.4 w**

(Reduced by **60%** compared to existing model)

High-pressure (1 MPa, Metal seal): **0.95 w**



Series **VQ1000/2000**

 SMC

CAT.ES11-100A

# 5 Port Solenoid Valve Series VQ

## Space-saving profile


All pilot valves are compactly mounted on one side. The space-saving design of mounting all fittings on one side permits mounting in three directions.

## The non-bias, one-clamp structure permits easy valve replacement.

## Built-in one-touch fittings for easy piping

## Slide locking type manual override provided

Manual override cannot be pushed by sliding the switch, to prevent malfunction.

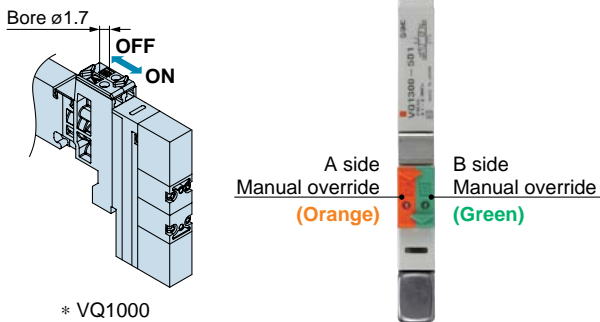


## Thin compact design with high flow capacity

Model	Manifold pitch (mm)	Flow-rate characteristics		Applicable cylinder bore size
		Metal seal		
		C [dm <sup>3</sup> /(s-bar)]	C [dm <sup>3</sup> /(s-bar)]	
VQ1000	10.5	0.72	1.0	Up to ø50
VQ2000	16	2.6	3.2	Up to ø80

\* Flow-rate characteristics: 4/2 → 5/3 (A/B → R1/R2)

## A wide variety of optional parts

\* The photo does not show an actual use example.

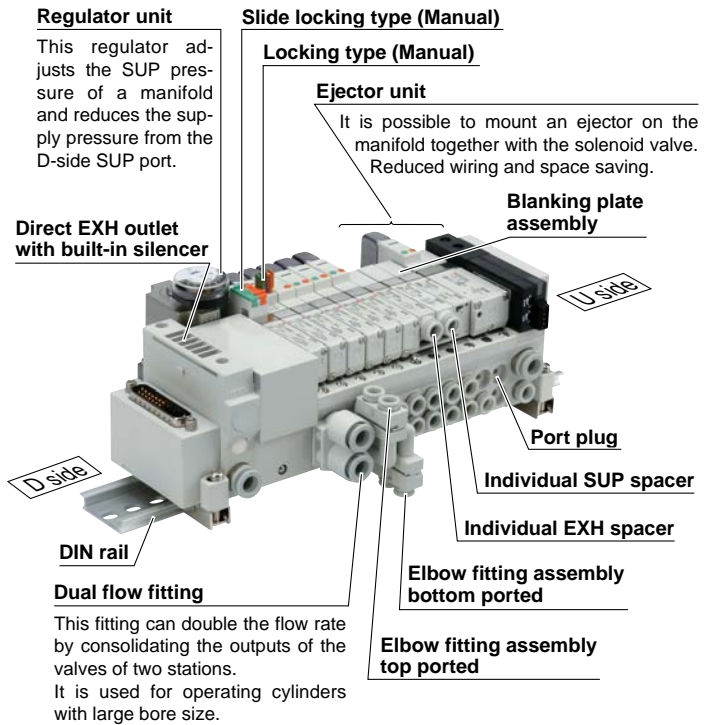

## Valve Specifications

Base Mounted	Plug-in	Series VQ1000	Sonic conductance C [dm <sup>3</sup> /(s-bar)]		Type of actuation					Voltage			Electrical entry			Manual override				
			4/2 → 5/3 (A/B → R1/R2)		Single	Double	Closed center	Exhaust center	Pressure center	12 VDC 24 VDC	100 VAC 110 VAC 50/60 Hz	200 VAC 220 VAC 50/60 Hz	Plug-in	Grommet	L-type plug connector	M-type plug connector	Non-locking push type (Tool required)	Locking type (Tool required)	Locking type (Manual)	Slide locking type (Manual)
			Double	3-position (Closed center)																
P. 7	Metal seal	VQ1□00	0.72	0.72	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	
		Rubber seal	VQ1□01	1.0	0.65															
	Series VQ2000	Metal seal	VQ2□00	2.6	2.0	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●
		Rubber seal	VQ2□01	3.2	2.2															
		P. 11			P. 15															














Series VQ1000



Series VQ2000

## A variety of common wiring methods are standardized.

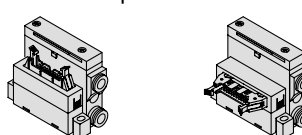
<p><b>F</b> kit (D-sub connector) Number of pins: 15/25</p>  <p>Top entry</p>  <p>Side entry</p>	<p><b>P</b> kit (Flat ribbon cable) Number of pins: 10/16/20/26</p>  <p>Top entry</p>  <p>Side entry</p>	<p><b>J</b> kit (PC Wiring System compliant Flat ribbon cable) Number of pins: 20</p>  <p>Top entry</p>  <p>Side entry</p>		
<p><b>G</b> kit (Flat ribbon cable with terminal block) Number of pins: 20</p> 	<p><b>T</b> kit (Terminal block box)</p> 	<p><b>L</b> kit (Lead wire)</p> 	<p><b>S</b> kit (Serial transmission)</p> 	<p><b>M</b> kit (Circular connector)  (VQ2000 only)</p> 

### Dual 3-port valves, 4 positions

Rubber seal only

- Two 3-port valves built into one body.
- The 3-port valves on the A and B sides can operate independently.
- When used as 3 port valves, only half the number of stations is required.
- Can also be used as a 4-position, 5-port type valve.

Exhaust center : **VQ1A01**  
                          : **VQ2A01**  
Pressure center : **VQ1B01**  
                          : **VQ2B01**

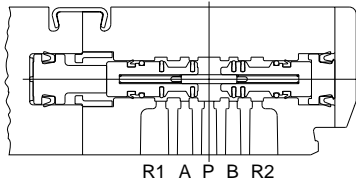

Model	A side	B side	JIS symbol
VQ1A01 VQ2A01	N.C. valve	N.C. valve	
VQ1B01 VQ2B01	N.O. valve	N.O. valve	
VQ1C01 VQ2C01	N.C. valve	N.O. valve	











### Semi-standard

### Options








External pilot	D-sub connector 15P	Flat ribbon cable 10P/16P/20P	Negative COM specifications	Inch-size one-touch fittings	Special wiring specifications	Blanking plate	Individual SUP/EXH spacer	SUP/EXH block plate	Name plate	Back pressure check valve	DIN rail mounting	Built-in silencer	Silencer for EXH port	Elbow fitting for cylinder port	Dual flow fitting	Plug for cylinder port	Regulator unit	Ejector unit	Double check block (Separated)
●	●	●	● Except S/G kit	●	● Except L kit	●	●	●	●	●	●	●	●	●	●	●	●	●	●
P. 55						P. 65													
●	●	●	● Except S/G kit	●	● Except L kit	●	●	●	●	●	●	●	●	●	●	●	●	●	●
P. 55						P. 71													

# Series VQ/Base Mounted: Variations

## Manifold Variations


		Plug-in	
		Series VQ1000	Series VQ2000
<p><b>F</b> kit</p> <p><b>D-sub connector</b> Conforming to with MIL D-sub connector</p> <p><b>P</b> kit</p> <p><b>Flat ribbon cable (26/20/16/10 pins)</b> Conforming to MIL flat ribbon cable connector</p> <p><b>J</b> kit</p> <p><b>Flat ribbon cable (20 pins)</b> Conforming to MIL flat ribbon cable connector PC Wiring System compatible</p> <p><b>G</b> kit</p> <p><b>Flat ribbon cable with terminal block</b> Conforming to MIL flat ribbon cable connector Applicable to OMRON's serial transmission unit PC Wiring System compatible</p> <p><b>T</b> kit</p> <p><b>Terminal block box (Terminal block)</b> Terminal block is compactly arranged on one side.</p> <p><b>L</b> kit</p> <p><b>Lead wire</b> Direct electrical entry type</p>	 <p>P. 17</p>	 <p>P. 17</p>	
	 <p>P. 21</p>	 <p>P. 21</p>	
	 <p>P. 29</p>	 <p>P. 29</p>	
	 <p>P. 33</p>	 <p>IP65 enclosure compatible</p> <p>P. 33</p>	
	 <p>P. 37</p>	 <p>IP65 enclosure compatible</p> <p>P. 37</p>	

## Manifold Variations

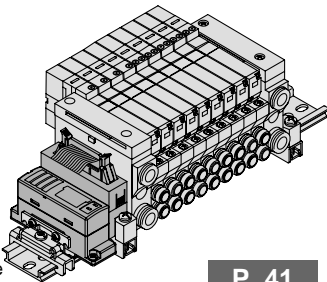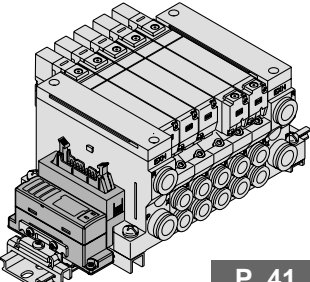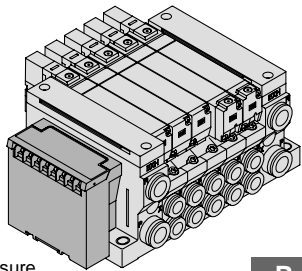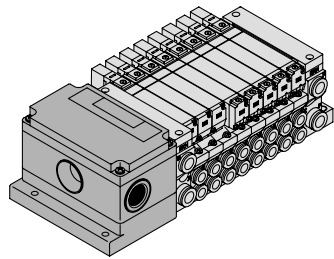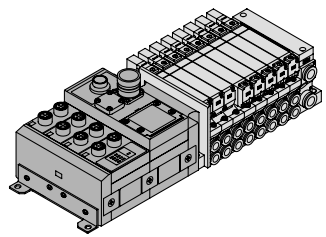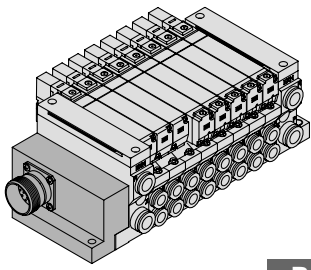		Plug-in	
		Series VQ1000	Series VQ2000
<p><b>Gateway-type serial transmission system</b></p> <p>Serial unit: EX510</p>	 <p>IP20 enclosure compliant</p> <p style="background-color: #cccccc; color: white; padding: 2px 5px; display: inline-block;"><b>P. 41</b></p>	 <p>IP20 enclosure compliant</p> <p style="background-color: #cccccc; color: white; padding: 2px 5px; display: inline-block;"><b>P. 41</b></p>	
<p><b>S</b> kit</p> <p><b>Integrated-type serial transmission system (for Output)</b></p> <p>Serial unit: EX120/123/124</p>	 <p style="background-color: #cccccc; color: white; padding: 2px 5px; display: inline-block;"><b>P. 45</b></p>	 <p>IP20 enclosure compliant</p> <p style="background-color: #cccccc; color: white; padding: 2px 5px; display: inline-block;"><b>P. 45</b></p>	
<p><b>Integrated-type serial transmission system (for I/O)</b></p> <p>Serial unit: EX240</p>	<p style="background-color: #cccccc; color: white; padding: 2px 5px; display: inline-block;">—</p>	 <p>Dust-tight, Water-jet-proof (-W) IP65 enclosure compliant</p> <p style="background-color: #cccccc; color: white; padding: 2px 5px; display: inline-block;"><b>P. 45</b></p>	
<p><b>M</b> kit</p> <p><b>Circular connector</b></p> <p>IP65 (Dust-tight, Water-jet-proof)</p>	<p style="background-color: #cccccc; color: white; padding: 2px 5px; display: inline-block;">—</p>	 <p>IP65 enclosure compliant</p> <p style="background-color: #cccccc; color: white; padding: 2px 5px; display: inline-block;"><b>P. 49</b></p>	
	<p style="background-color: #cccccc; color: white; padding: 2px 5px; display: inline-block;">—</p>	 <p>W type only</p> <p style="background-color: #cccccc; color: white; padding: 2px 5px; display: inline-block;"><b>P. 51</b></p>	

# Cylinder Speed Chart

This chart is provided as guidelines only.  
For performance under various conditions, use SMC's Model Selection Program before making a judgment.

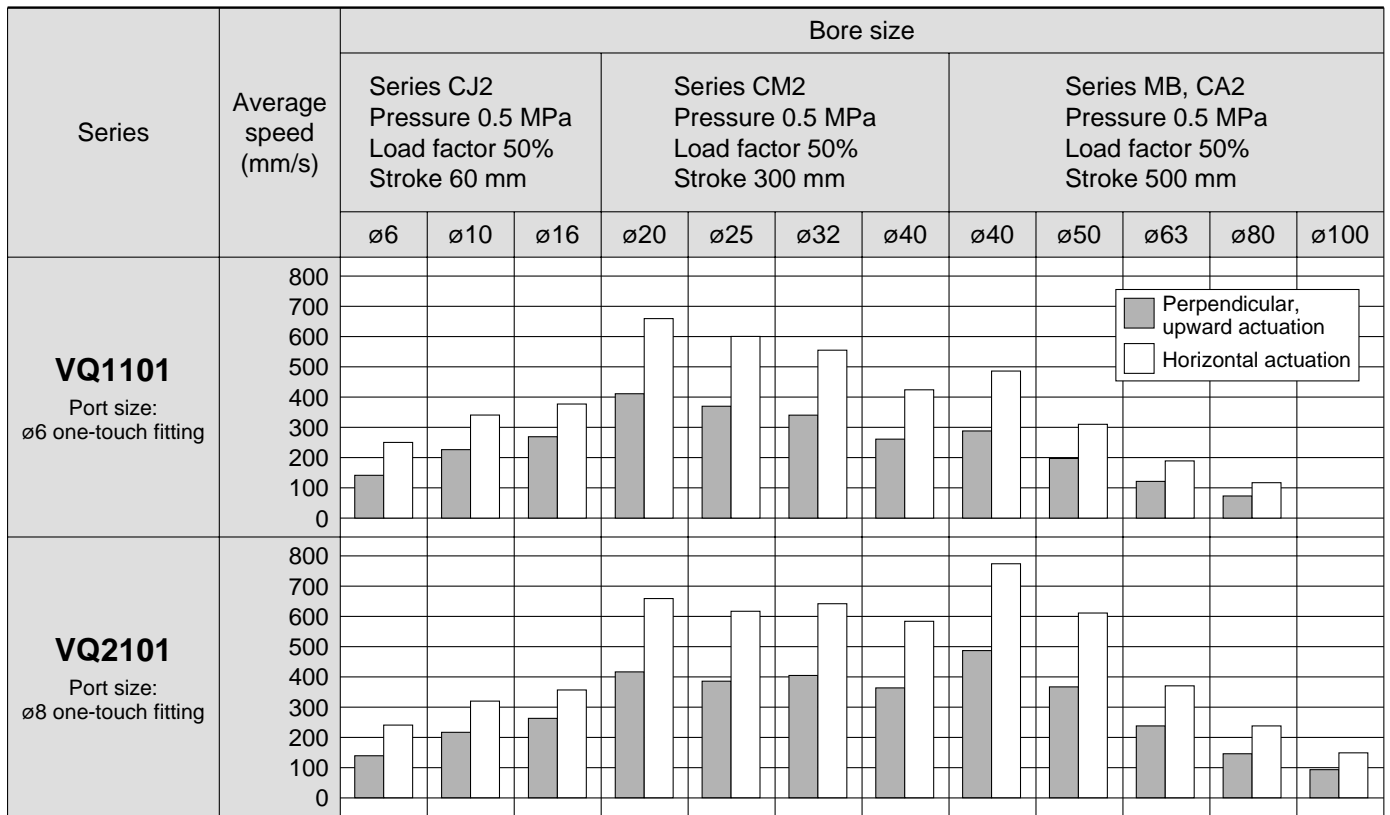


- \* It is when the cylinder is extending that is meter-out controlled by speed controller which is directly connected with cylinder, and its needle valve with being fully open.
- \* The average velocity of the cylinder is what the stroke is divided by the total stroke time.
- \* Load factor:  $((\text{Load mass} \times 9.8) / \text{Theoretical force}) \times 100\%$

## Conditions

Series	Conditions	Series CJ2	Series CM2	Series MB, CA2
<b>VQ1101</b>	Tube bore x Length	T0604 (O.D. ø6/I.D. ø4) x 1 m		
	Speed controller	AS3001F-06		
	Silencer	AN200-KM8		
<b>VQ2101</b>	Tube bore x Length	T0806 (O.D. ø8/I.D. ø6) x 1 m		
	Speed controller	AS3001F-08		
	Silencer	AN200-KM10		

# INDEX

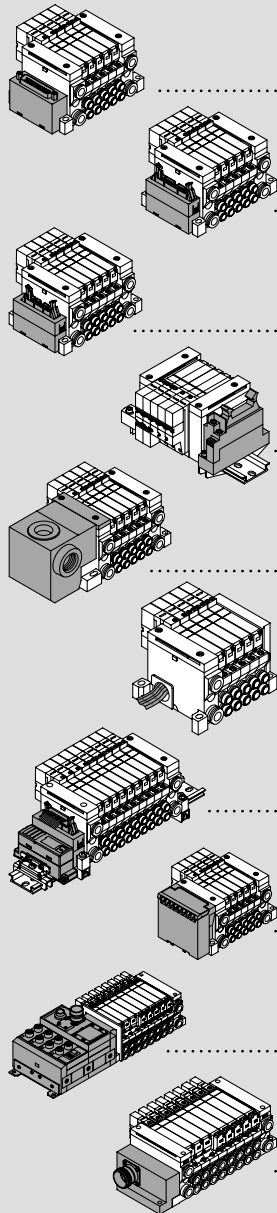

Features .....	P. 1
Variations .....	P. 3
Cylinder Speed Chart .....	P. 5
<b>VQ1000</b> How to Order, Manifold Options .....	P. 7
<b>VQ2000</b> How to Order, Manifold Options .....	P. 11
<b>VQ1000/2000</b> Model, Standard/Manifold Specifications .....	P. 15
<b>VQ1000/2000</b> <b>F</b> kit (D-sub connector) .....	P. 17
<b>VQ1000/2000</b> <b>P</b> kit (Flat ribbon cable) .....	P. 21
<b>VQ1000/2000</b> <b>J</b> kit (Flat ribbon cable) .....	P. 25
<b>VQ1000/2000</b> <b>G</b> kit (Flat ribbon cable with terminal block) .....	P. 29
<b>VQ1000/2000</b> <b>T</b> kit (Terminal block box) .....	P. 33
<b>VQ1000/2000</b> <b>L</b> kit (Lead wire) .....	P. 37
<b>VQ1000/2000</b> <b>S</b> kit (Serial transmission) EX510 .....	P. 41
<b>VQ1000/2000</b> <b>S</b> kit (Serial transmission) EX120/123/124 .....	P. 45
<b>VQ1000/2000</b> <b>S</b> kit (Serial transmission) EX240 .....	P. 49
<b>VQ2000</b> <b>M</b> kit (Circular connector) .....	P. 51
<b>VQ2000</b> Sub-plate Single Unit .....	P. 54
<b>VQ1000/2000</b> Semi-standard .....	P. 55
<b>VQ1000/2000</b> Construction .....	P. 59
<b>VQ1000/2000</b> Exploded View of Manifold .....	P. 61
<b>VQ1000/2000</b> Manifold Optional Parts .....	P. 65
Safety Instructions .....	Back page 1
<b>VQ1000/2000</b> Specific Product Precautions .....	Back page 3

F kit

P kit

J kit

G kit

T kit

L kit

S kit

M kit

Sub-plate  
Single Unit

Semi-  
standard

Construction

Exploded  
View of  
Manifold

Manifold  
Optional Parts

Safety  
Instructions

Specific  
Product  
Precautions

# Plug-in Unit Base Mounted

# Series VQ1000



## How to Order Manifold

VV5Q 1 1-08 C6 F U1 - -

**Series**

1	VQ1000
---	--------

**Manifold**

1	Plug-in unit
---	--------------

**Stations**

01	1 station
⋮	⋮

The number of max. stations differs from kit to kit. (Refer to the below table.)

**CE compliant**

Nil	—
Q	CE compliant

\* DC specification only

**Option**

Symbol	Option
Nil	None
2	200/220 VAC models (F/L kit only)
B Note 2)	With back pressure check valve
D	DIN rail mounting
D0	With DIN rail bracket (Without DIN rail)
D□ Note 7)	DIN rail length specified
G1 Note 3)	1 set of regulator unit
G2 Note 3)	2 sets of regulator unit
G3 Note 3)	3 sets of regulator unit
J□ Note 4)	With ejector unit
K Note 5)	Special wiring spec. (Except double wiring)
N	With name plate
R Note 6)	External pilot
S	Direct EXH outlet with built-in silencer

**Cylinder port**

Symbol	Port size	Symbol	Port size
C3	With ø3.2 one-touch fitting	L5	Top ported elbow M5 thread
C4	With ø4 one-touch fitting	B3	Bottom ported elbow with ø3.2 one-touch fitting
C6	With ø6 one-touch fitting	B4	Bottom ported elbow with ø4 one-touch fitting
M5	M5 thread	B6	Bottom ported elbow with ø6 one-touch fitting
CM Note 1)	Mixed sizes and with port plug	B5	Bottom ported elbow M5 thread
L3	Top ported elbow with ø3.2 one-touch fitting	LM Note 1)	Elbow port, mixed sizes
L4	Top ported elbow with ø4 one-touch fitting	MM Note 2)	Mixed size for different types of piping, option installed
L6	Top ported elbow with ø6 one-touch fitting		

- Note 1) Indicate "Mixed sizes and with port plug" by means of the manifold specification sheet.
- Note 2) When selecting the mixed size for different types of piping or dual flow fitting assembly, enter "MM" and give instructions in the manifold specification sheet.
- Note 3) Inch-size one-touch fittings are also available. Refer to page 57 for details.
- Note 4) M5 fittings for M5 thread are attached without being incorporated.

Simple specials are available with SMC Simple Specials System. Refer to Best Pneumatics No. ① for details on applicable models.

- Note 1) When two or more symbols are specified, indicate them alphabetically. Example: -BRS
- Note 2) Models with a suffix "-B" have check valves for prevention of back pressure at all manifold stations. When a back pressure check valve is desired, and is to be installed only in certain manifold stations, specify the mounting position by means of the manifold specification sheet.
- Note 3) Specify the mounting position by means of the manifold specification sheet.
- Note 4) Refer to page 69 for details on with vacuum ejector unit. A combination of "J" and "N" is not available.
- Note 5) Specify the wiring specifications by means of the manifold specification sheet. (Except L kit)
- Note 6) Indicate "R" for the valve with external pilot.
- Note 7) □: Station. Example: D08: The number of stations that may be displayed is longer than the manifold number of stations.

**Kit type/Electrical entry/Cable length**

F kit (D-sub connector)				P kit (Flat ribbon cable)				J kit (Flat ribbon cable 20P)				G kit (Flat ribbon cable with terminal block)																																																																															
<p>Connector entry direction</p> <table border="1"> <tr> <th>Top entry</th> <th>Side entry</th> <th colspan="2">P. 17</th> </tr> <tr> <td>U0</td> <td>S0</td> <td>Without cable</td> <td></td> </tr> <tr> <td>U1</td> <td>S1</td> <td>With cable (1.5 m)</td> <td>Note 2)</td> </tr> <tr> <td>U2</td> <td>S2</td> <td>With cable (3 m)</td> <td>2 to 24 stations</td> </tr> <tr> <td>U3</td> <td>S3</td> <td>With cable (5 m)</td> <td></td> </tr> </table>				Top entry	Side entry	P. 17		U0	S0	Without cable		U1	S1	With cable (1.5 m)	Note 2)	U2	S2	With cable (3 m)	2 to 24 stations	U3	S3	With cable (5 m)		<p>Connector entry direction</p> <table border="1"> <tr> <th>Top entry</th> <th>Side entry</th> <th colspan="2">P. 21</th> </tr> <tr> <td>U0</td> <td>S0</td> <td>Without cable</td> <td></td> </tr> <tr> <td>U1</td> <td>S1</td> <td>With cable (1.5 m)</td> <td>Note 2)</td> </tr> <tr> <td>U2</td> <td>S2</td> <td>With cable (3 m)</td> <td>2 to 24 stations</td> </tr> <tr> <td>U3</td> <td>S3</td> <td>With cable (5 m)</td> <td></td> </tr> </table>				Top entry	Side entry	P. 21		U0	S0	Without cable		U1	S1	With cable (1.5 m)	Note 2)	U2	S2	With cable (3 m)	2 to 24 stations	U3	S3	With cable (5 m)		<p>Connector entry direction</p> <table border="1"> <tr> <th>Top entry</th> <th>Side entry</th> <th colspan="2">P. 25</th> </tr> <tr> <td>U0</td> <td>S0</td> <td>Without cable</td> <td></td> </tr> <tr> <td>U1</td> <td>S1</td> <td>With cable (1.5 m)</td> <td>Note 2)</td> </tr> <tr> <td>U2</td> <td>S2</td> <td>With cable (3 m)</td> <td>2 to 16 stations</td> </tr> <tr> <td>U3</td> <td>S3</td> <td>With cable (5 m)</td> <td></td> </tr> </table>				Top entry	Side entry	P. 25		U0	S0	Without cable		U1	S1	With cable (1.5 m)	Note 2)	U2	S2	With cable (3 m)	2 to 16 stations	U3	S3	With cable (5 m)		<p>The voltage used for the valve is 24 VDC.</p> <table border="1"> <tr> <th>0</th> <th colspan="2">Without cable</th> <th></th> </tr> <tr> <td>G</td> <td>1</td> <td>With cable (1.5 m)</td> <td>Note 2)</td> </tr> <tr> <td></td> <td>2</td> <td>With cable (3 m)</td> <td>2 to 16 stations</td> </tr> <tr> <td></td> <td>3</td> <td>With cable (5 m)</td> <td></td> </tr> </table> <p>Order separately SI unit made by OMRON Corp.</p>				0	Without cable			G	1	With cable (1.5 m)	Note 2)		2	With cable (3 m)	2 to 16 stations		3	With cable (5 m)	
Top entry	Side entry	P. 17																																																																																									
U0	S0	Without cable																																																																																									
U1	S1	With cable (1.5 m)	Note 2)																																																																																								
U2	S2	With cable (3 m)	2 to 24 stations																																																																																								
U3	S3	With cable (5 m)																																																																																									
Top entry	Side entry	P. 21																																																																																									
U0	S0	Without cable																																																																																									
U1	S1	With cable (1.5 m)	Note 2)																																																																																								
U2	S2	With cable (3 m)	2 to 24 stations																																																																																								
U3	S3	With cable (5 m)																																																																																									
Top entry	Side entry	P. 25																																																																																									
U0	S0	Without cable																																																																																									
U1	S1	With cable (1.5 m)	Note 2)																																																																																								
U2	S2	With cable (3 m)	2 to 16 stations																																																																																								
U3	S3	With cable (5 m)																																																																																									
0	Without cable																																																																																										
G	1	With cable (1.5 m)	Note 2)																																																																																								
	2	With cable (3 m)	2 to 16 stations																																																																																								
	3	With cable (5 m)																																																																																									

- Note 1) Besides the above, F/P kit with different number of pins are available. Refer to page 55 for details.
- Note 2) Refer to page 56 for details.



## How to Order Valves

## How to Order Manifold Assembly

**VQ 1 1 0 0 - 5 - 1 -**

**Series**  
1 VQ1000

**Type of actuation**

1	2-position single (A)(B) (R1)(P)(R2)
2	Metal 2-position double (A)(B) (R1)(P)(R2)
	Rubber 2-position double (A)(B) (R1)(P)(R2)
3	3-position closed center (A)(B) (R1)(P)(R2)
4	3-position exhaust center (A)(B) (R1)(P)(R2)
5	3-position pressure center (A)(B) (R1)(P)(R2)
A Note 1	4-position dual 3-port valve (A) N.C. 1 N.C.
B Note 2	4-position dual 3-port valve (B) N.O. 1 N.O.
C Note 3	4-position dual 3-port valve (C) N.C. 1 N.O.

**Seal**

0	Metal seal
1	Rubber seal

**Function**

Symbol	Specifications	DC	AC
Nil	Standard	(0.4 W) ○	○ Note 1)
B	High-speed response type	(0.95 W) ○	—
K Note 2)	High-pressure type (1.0 MPa)	(0.95 W) ○	—
N Note 3)	Negative common	○	—
R Note 3)	External pilot	○	○

Note 1) Refer to page 16 for power consumption of AC type.  
Note 2) Metal seal only  
Note 3) For external pilot and negative common specifications, refer to "Semi-standard" on pages 56 to 57.  
Note 4) When two or more symbols are specified, indicate them alphabetically. Combination of [B] and [K] is not possible.  
Note) Rubber seal only

**CE compliant**

Nil	—
Q	CE compliant

\* DC specification only

**Manual override**

Nil: Non-locking push type (Tool required)	B: Locking type (Tool required)
C: Locking type (Manual)	D: Slide locking type (Manual)

**Light/surge voltage suppressor**

Nil	Yes
E Note)	None

Note) Not applicable to the S kit.

**Coil voltage**

1	100 VAC (50/60 Hz)
2 Note)	200 VAC (50/60 Hz)
3	110 VAC (50/60 Hz)
4 Note)	220 VAC (50/60 Hz)
5	24 VDC
6	12 VDC

Note) 200 and 220 VAC: F/L kit only

**Example**

Single solenoid (24 VDC)  
VQ1100-51 (4 sets)

Double solenoid (24 VDC)  
VQ1200-51 (4 sets)

Blanking plate  
VVQ1000-10A-1 (1 set)

3 m

D-sub connector cable assembly  
AXT100-DS25-030

F kit (D-sub connector)

Cylinder port fitting port size  
C6: With ø6 one-touch fitting

Manifold base (9 stations)  
VV5Q11-09C6FU2

**VV5Q11-09C6FU2** ... 1 set (F kit 9-station manifold base part no.)  
\*VQ1100-51 ... 4 sets (Single solenoid part no.)  
\*VQ1200-51 ... 4 sets (Double solenoid part no.)  
\*VVQ1000-10A-1 ... 1 set (Blanking plate part no.)

The asterisk denotes the symbol for assembly. Prefix it to the part nos. of the solenoid valve, etc.

Specify the part numbers for valves and options together beneath the manifold base part number. Besides, when the arrangement will be complicated, specify them by means of the manifold specification sheet.

**T kit**  
(Terminal block box)

**P. 33**

T kit	O	Terminal block box	2 to 24 stations (Note 2)
-------	---	--------------------	---------------------------

**L kit**  
(Lead wire)

**P. 37**

L kit	0	With cable (0.6 m)	1 to 8 stations
	1	With cable (1.5 m)	
	2	With cable (3 m)	

**S kit**  
(Serial transmission)

The valve is equipped with an indicator light and surge voltage suppressor, and the voltage is 24 VDC. The dust proof SI unit is also available. Refer to page 45 for details.

**P. 45**


S kit	0	Without SI unit	Max. 16 stations
	F1	NKE Corp.: Uni-wire System	
	H	NKE Corp.: Uni-wire H System	Max. 8 stations
	J1	SUNX Corp.: S-LINK (16 outputs)	
	J2	SUNX Corp.: S-LINK (8 outputs)	Max. 16 stations
	Q	DeviceNet™	
	R1	OMRON Corp.: CompoBus/S (16 outputs)	Max. 8 stations
	R2	OMRON Corp.: CompoBus/S (8 outputs)	
V	CC-LINK	Max. 16 stations	

# Series VQ1000


## VQ1000: Manifold Options

P. 65 to 69


Blanking plate assembly  
VVQ1000-10A-1

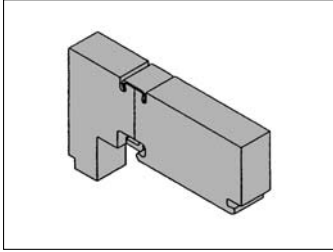


Individual SUP spacer  
VVQ1000-P-1-C<sub>6</sub>-N<sub>7</sub>

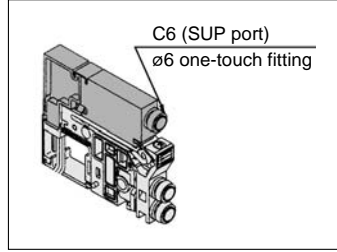


Individual EXH spacer  
VVQ1000-R-1-C<sub>6</sub>-N<sub>7</sub>

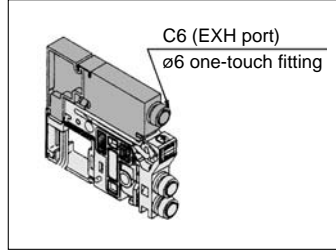

SUP block plate  
VVQ1000-16A

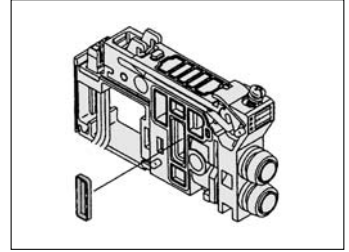


Blanking plate with connector  
VVQ1000-1C□-□

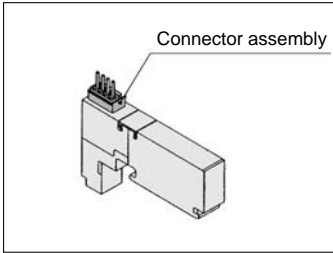


EXH block base assembly  
VVQ1000-19A-  


F	C3, C4
P	C6, M5
L	N1, N3, N7

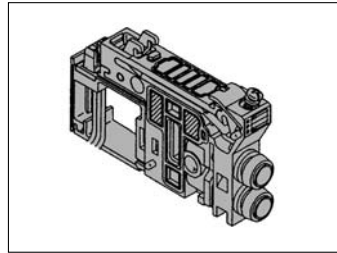


Back pressure check valve assembly [-B]  
VVQ1000-18A

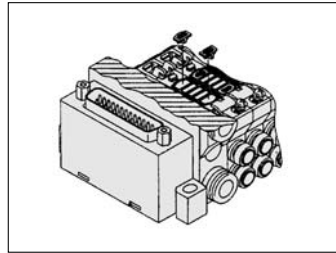


Name plate [-N]  
VVQ1000-N<sub>NC</sub>-Station  
(1 to Max. stations)

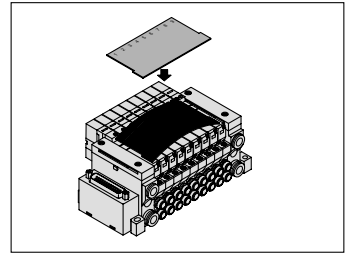


Blanking plug  
KQ2P-□

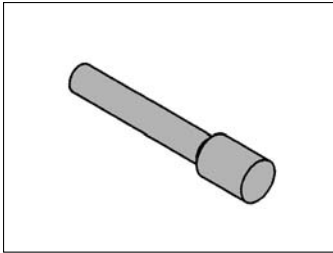


Port plug  
VVQ0000-58A

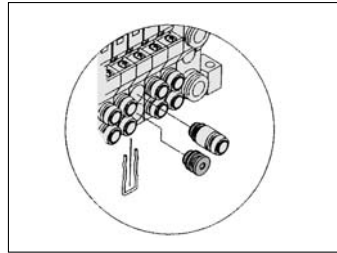


Elbow fitting assembly  
VVQ1000-F-L□

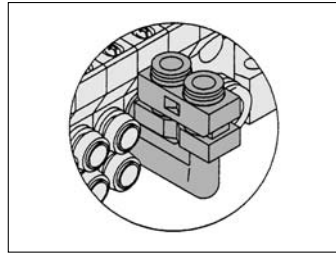


DIN rail mounting bracket  
[-D/-D0/-D□]  
VVQ1000-57A

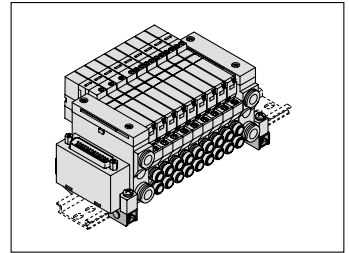


Direct EXH outlet with built-in silencer [-S]

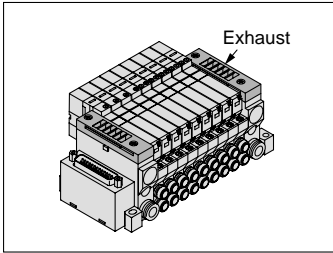

Dual flow fitting assembly  
VVQ1000-52A-C<sub>8</sub>-N<sub>9</sub>

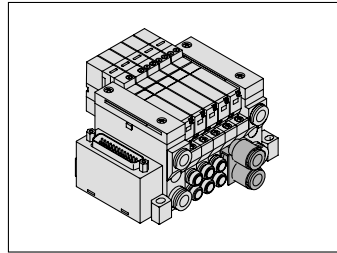


Silencer (For EXH port)  
AN200-KM8/AN203-KM8

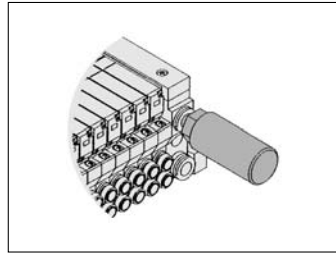


- Refer to back page 4 for cylinder port fittings part number.
- Refer to page 62 for replacement parts.


Regulator unit  
VVQ1000-AR-1

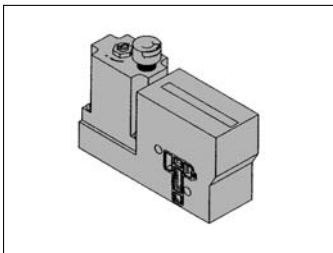

Double check block  
VVQ1000-FPG-□□-□

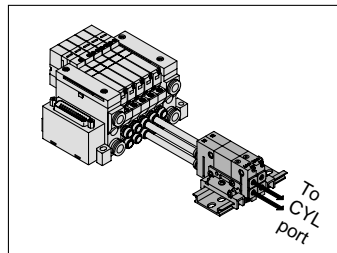

With ejector unit  
[-J□]

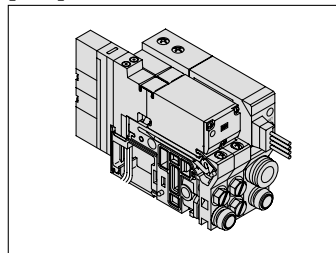



# Plug-in Unit Base Mounted

# Series VQ2000



## How to Order Manifold

**VV5Q 2 1 - 08 C6 FU1 - -**

**Series**  
2 VQ2000

**Manifold**  
1 Plug-in unit

**Stations**  
01 1 station

**Cylinder port**

Symbol	Port size
C4	With ø4 one-touch fitting
C6	With ø6 one-touch fitting
C8	With ø8 one-touch fitting
CM (Note 1)	Mixed sizes and with port plug
L4	Top ported elbow with ø4 one-touch fitting
L6	Top ported elbow with ø6 one-touch fitting

**Kit type**

Symbol	Port size
L8	Top ported elbow with ø8 one-touch fitting
B4	Bottom ported elbow with ø4 one-touch fitting
B6	Bottom ported elbow with ø6 one-touch fitting
B8	Bottom ported elbow with ø8 one-touch fitting
LM (Note 1)	Elbow port, mixed sizes
MM (Note 2)	Mixed size for different types of piping, option installed

**CE compliant**

Nil	—
Q	CE compliant

\* DC specification only

Note 1) Indicate "Mixed size and with port plug" by means of the manifold specification sheet.  
 Note 2) When selecting the mixed size for different types of piping, dual flow fitting assembly, or double check block (direct mounting), enter "MM" and give instructions in the manifold specification sheet.  
 Note 3) Inch-size one-touch fittings are also available. Refer to page 57 for details.

Simple specials are available with SMC Simple Specials System. Refer to Best Pneumatics No. ① for details on applicable models.

### Option

Symbol	Option
Nil	None
2	200/220 VAC models (F/L kit only)
B (Note 2)	With back pressure check valve
D	DIN rail mounting
D0	With DIN rail bracket (Without DIN rail)
D□ (Note 5)	DIN rail length specified
K (Note 3)	Special wiring spec. (Except double wiring)
N	With name plate
R (Note 4)	External pilot
S	Direct EXH outlet with built-in silencer
W	Enclosure: Dust-tight, Water-jet-proof (IP65) (T/L/S/M kit only)



- Note 1) When two or more symbols are specified, indicate them alphabetically. Example: -DNR  
 Note 2) Models with a suffix "-B" have check valves for prevention of back pressure at all manifold stations. When a back pressure check valve is desired, and is to be installed only in certain manifold stations, specify the mounting position by means of the manifold specification sheet.  
 Note 3) Specify the wiring specifications by means of the manifold specification sheet. (Except L kit)  
 Note 4) Indicate "R" for the valve with external pilot.  
 Note 5) □: Station. Example: D08: The number of stations that may be displayed is longer than the manifold number of stations.

### Kit type/Electrical entry/Cable length

<p><b>F kit (D-sub connector)</b></p> <p>Connector entry direction Top entry Side entry</p> <p>P. 17</p> <table border="1"> <thead> <tr> <th>Kit</th> <th>Without cable</th> <th>With cable (1.5 m)</th> <th>With cable (3 m)</th> <th>With cable (5 m)</th> </tr> </thead> <tbody> <tr> <td>F U0</td> <td>S0</td> <td>S1</td> <td>S2</td> <td>S3</td> </tr> </tbody> </table>	Kit	Without cable	With cable (1.5 m)	With cable (3 m)	With cable (5 m)	F U0	S0	S1	S2	S3	<p><b>P kit (Flat ribbon cable)</b></p> <p>Connector entry direction Top entry Side entry</p> <p>P. 21</p> <table border="1"> <thead> <tr> <th>Kit</th> <th>Without cable</th> <th>With cable (1.5 m)</th> <th>With cable (3 m)</th> <th>With cable (5 m)</th> </tr> </thead> <tbody> <tr> <td>P U0</td> <td>S0</td> <td>S1</td> <td>S2</td> <td>S3</td> </tr> </tbody> </table>	Kit	Without cable	With cable (1.5 m)	With cable (3 m)	With cable (5 m)	P U0	S0	S1	S2	S3	<p><b>J kit (Flat ribbon cable 20P)</b></p> <p>Connector entry direction Top entry Side entry</p> <p>P. 25</p> <table border="1"> <thead> <tr> <th>Kit</th> <th>Without cable</th> <th>With cable (1.5 m)</th> <th>With cable (3 m)</th> <th>With cable (5 m)</th> </tr> </thead> <tbody> <tr> <td>J U0</td> <td>S0</td> <td>S1</td> <td>S2</td> <td>S3</td> </tr> </tbody> </table>	Kit	Without cable	With cable (1.5 m)	With cable (3 m)	With cable (5 m)	J U0	S0	S1	S2	S3	<p><b>G kit (Flat ribbon cable with terminal block)</b></p> <p>The voltage used for the valve is 24 VDC.</p> <p>P. 29</p> <table border="1"> <thead> <tr> <th>Kit</th> <th>Without cable</th> <th>With cable (1.5 m)</th> <th>With cable (3 m)</th> <th>With cable (5 m)</th> </tr> </thead> <tbody> <tr> <td>G U0</td> <td>S0</td> <td>S1</td> <td>S2</td> <td>S3</td> </tr> </tbody> </table>	Kit	Without cable	With cable (1.5 m)	With cable (3 m)	With cable (5 m)	G U0	S0	S1	S2	S3																				
Kit	Without cable	With cable (1.5 m)	With cable (3 m)	With cable (5 m)																																																											
F U0	S0	S1	S2	S3																																																											
Kit	Without cable	With cable (1.5 m)	With cable (3 m)	With cable (5 m)																																																											
P U0	S0	S1	S2	S3																																																											
Kit	Without cable	With cable (1.5 m)	With cable (3 m)	With cable (5 m)																																																											
J U0	S0	S1	S2	S3																																																											
Kit	Without cable	With cable (1.5 m)	With cable (3 m)	With cable (5 m)																																																											
G U0	S0	S1	S2	S3																																																											
<p><b>T kit (Terminal block box)</b></p> <p>Dust-tight/Water-jet-proof (IP65) compatible</p> <p>P. 33</p> <table border="1"> <thead> <tr> <th>Kit</th> <th>Without cable</th> <th>With cable (0.6 m)</th> <th>With cable (1.5 m)</th> <th>With cable (3 m)</th> </tr> </thead> <tbody> <tr> <td>T U0</td> <td>S0</td> <td>S1</td> <td>S2</td> <td>S3</td> </tr> </tbody> </table>	Kit	Without cable	With cable (0.6 m)	With cable (1.5 m)	With cable (3 m)	T U0	S0	S1	S2	S3	<p><b>L kit (Lead wire)</b></p> <p>Dust-tight/Water-jet-proof (IP65) compatible</p> <p>P. 37</p> <table border="1"> <thead> <tr> <th>Kit</th> <th>Without cable</th> <th>With cable (0.6 m)</th> <th>With cable (1.5 m)</th> <th>With cable (3 m)</th> </tr> </thead> <tbody> <tr> <td>L U0</td> <td>S0</td> <td>S1</td> <td>S2</td> <td>S3</td> </tr> </tbody> </table>	Kit	Without cable	With cable (0.6 m)	With cable (1.5 m)	With cable (3 m)	L U0	S0	S1	S2	S3	<p><b>S kit (Serial transmission)</b></p> <p>Note 4)</p> <p>The valve is equipped with an indicator light and surge voltage suppressor, and the voltage is 24 VDC. The dusttight SI unit is available. Refer to page 45 for details. Dust-tight, Water-jet-proof (IP65) is available.</p> <p>P. 45</p> <table border="1"> <thead> <tr> <th>Kit</th> <th>Without SI unit</th> <th>Max. stations</th> </tr> </thead> <tbody> <tr> <td>S U0</td> <td>S0</td> <td>Max. 16 stations</td> </tr> <tr> <td>S F1</td> <td>S1</td> <td>Max. 16 stations</td> </tr> <tr> <td>S H</td> <td>S2</td> <td>Max. 16 stations</td> </tr> <tr> <td>S J1</td> <td>S3</td> <td>Max. 8 stations</td> </tr> <tr> <td>S J2</td> <td>S4</td> <td>Max. 8 stations</td> </tr> <tr> <td>S Q</td> <td>S5</td> <td>Max. 16 stations</td> </tr> <tr> <td>S R1</td> <td>S6</td> <td>Max. 8 stations</td> </tr> <tr> <td>S R2</td> <td>S7</td> <td>Max. 8 stations</td> </tr> <tr> <td>S V</td> <td>S8</td> <td>Max. 16 stations</td> </tr> </tbody> </table>	Kit	Without SI unit	Max. stations	S U0	S0	Max. 16 stations	S F1	S1	Max. 16 stations	S H	S2	Max. 16 stations	S J1	S3	Max. 8 stations	S J2	S4	Max. 8 stations	S Q	S5	Max. 16 stations	S R1	S6	Max. 8 stations	S R2	S7	Max. 8 stations	S V	S8	Max. 16 stations	<p><b>M kit (Circular-connector)</b></p> <p>P. 51</p> <table border="1"> <thead> <tr> <th>Kit</th> <th>Without cable</th> <th>With cable (1.5 m)</th> <th>With cable (3 m)</th> <th>With cable (5 m)</th> </tr> </thead> <tbody> <tr> <td>M U0</td> <td>S0</td> <td>S1</td> <td>S2</td> <td>S3</td> </tr> </tbody> </table>	Kit	Without cable	With cable (1.5 m)	With cable (3 m)	With cable (5 m)	M U0	S0	S1	S2	S3
Kit	Without cable	With cable (0.6 m)	With cable (1.5 m)	With cable (3 m)																																																											
T U0	S0	S1	S2	S3																																																											
Kit	Without cable	With cable (0.6 m)	With cable (1.5 m)	With cable (3 m)																																																											
L U0	S0	S1	S2	S3																																																											
Kit	Without SI unit	Max. stations																																																													
S U0	S0	Max. 16 stations																																																													
S F1	S1	Max. 16 stations																																																													
S H	S2	Max. 16 stations																																																													
S J1	S3	Max. 8 stations																																																													
S J2	S4	Max. 8 stations																																																													
S Q	S5	Max. 16 stations																																																													
S R1	S6	Max. 8 stations																																																													
S R2	S7	Max. 8 stations																																																													
S V	S8	Max. 16 stations																																																													
Kit	Without cable	With cable (1.5 m)	With cable (3 m)	With cable (5 m)																																																											
M U0	S0	S1	S2	S3																																																											

Note 1) Besides the above, F/P kit with different number of pins are available. Refer to page 55 for details.  
 Note 2) Refer to page 56 for details.

Note 3) Refer to the pages on respective kits for IP65 type. (T/L/S kit)  
 Note 4) Serial transmission system with IP65 enclosure applicable to input/output is also available. Refer to page 49 for details.

## How to Order Valves

## How to Order Manifold Assembly

**VQ 2 1 0 0 - 5 - 1 -**

**Series**

2	VQ2000
---	--------

**Seal**

0	Metal seal
1	Rubber seal

**Type of actuation**

1	2-position single (A)(B) 	A Note)	4-position dual 3-port valve (A) 
2	Metal 2-position double (A)(B) 	B Note)	4-position dual 3-port valve (B) 
	Rubber 2-position double (A)(B) 		
3	3-position closed center (A)(B) 	C Note)	4-position dual 3-port valve (C) 
	3-position exhaust center (A)(B) 		
	3-position pressure center (A)(B) 		

Note) Rubber seal only

Note) For sub-plate single unit type, refer to page 54.

**Function**

Symbol	Specifications	DC	AC
Nil	Standard	(0.4 W) ○	○ Note 1)
B	High-speed response type	(0.95 W) ○	—
K Note 2)	High-pressure type (1.0 MPa)	(0.95 W) ○	—
N Note 3)	Negative common	○	—
R Note 3)	External pilot	○	○

Note 1) For power consumption of AC type, refer to page 16.

Note 2) Metal seal only

Note 3) For external pilot and negative common specifications, refer to "Semi-standard" on pages 56 to 57.

Note 4) When two or more symbols are specified, indicate them alphabetically. Combination of [B] and [K] is not possible.

### ⚠ Caution

Use the standard (DC) specification when continuously energizing for long periods of time.

**CE compliant**

Nil	—
Q	CE compliant

\* DC specification only

**Light/surge voltage suppressor**

Nil	Yes
E Note)	None

Note) Not applicable to the S kit.


**Coil voltage**

1	100 VAC (50/60 Hz)
2 Note)	200 VAC (50/60 Hz)
3	110 VAC (50/60 Hz)
4 Note)	220 VAC (50/60 Hz)
5	24 VDC
6	12 VDC


Note) 200 and 220 VAC: F/L kit only

**Manual override**


Nil: Non-locking push type (Tool required)




B: Push-locking slotted type (Tool required)




C: Locking type (Manual)



D: Slide locking type (Manual)



**Example**

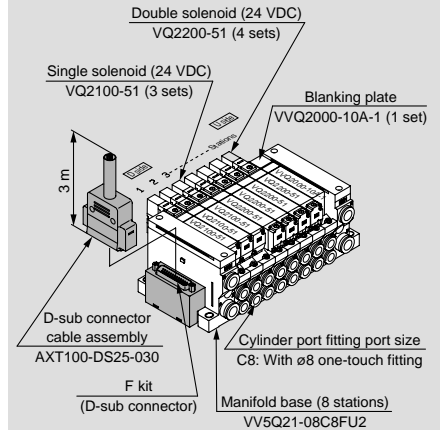

**VV5Q21-08C8FU2** 1 set (F kit 8-station manifold base part no.)  
**\*VQ2100-51** ..... 3 sets (Single solenoid part no.)  
**\*VQ2200-51** ..... 4 sets (Double solenoid part no.)  
**\*VVQ2000-10A-1** ..... 1 set (Blanking plate part no.)

The asterisk denotes the symbol for assembly. Prefix it to the part nos. of the solenoid valve, etc.


Specify the part numbers for valves and options together beneath the manifold base part number. Besides, when the arrangement will be complicated, specify them by means of the manifold specification sheet.

# Series VQ2000


## VQ2000: Manifold Options

P. 71 to 75


Blanking plate assembly  
VVQ2000-10A-1

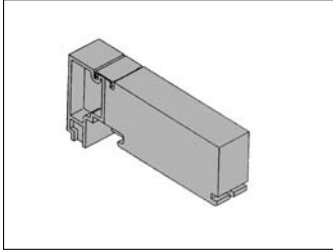


Individual SUP spacer  
VVQ2000-P-1-C<sub>8</sub>-N<sub>9</sub>

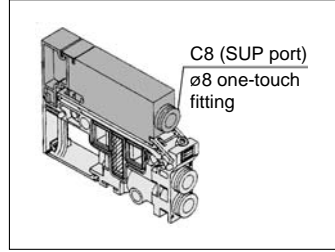


Individual EXH spacer  
VVQ2000-R-1-C<sub>8</sub>-N<sub>9</sub>

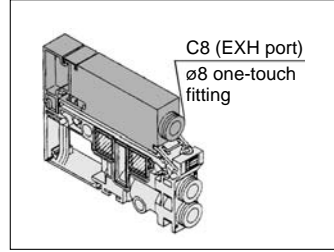


SUP block plate  
VVQ2000-16A

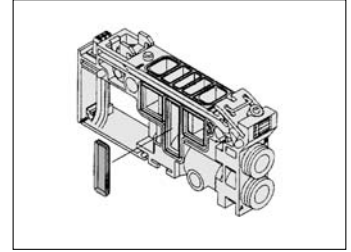


EXH block plate  
VVQ2000-19A

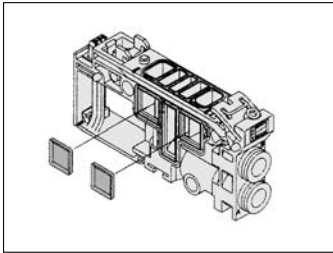


SUP stop valve spacer  
VVQ2000-24A-1

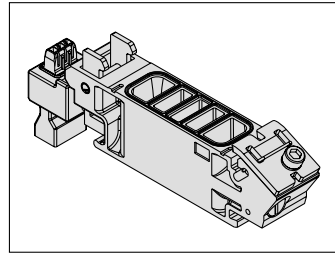


Back pressure check valve assembly [-B]  
VVQ2000-18A

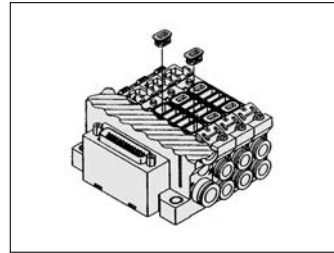


Name plate [-N]  
VVQ2000-N-Station  
(1 to Max. stations)

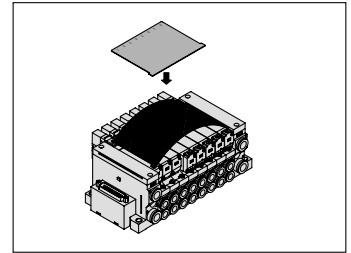


Blanking plug  
KQ2P-□

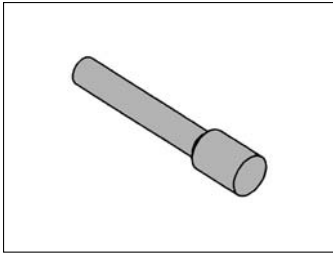


Port plug  
VVQ1000-58A

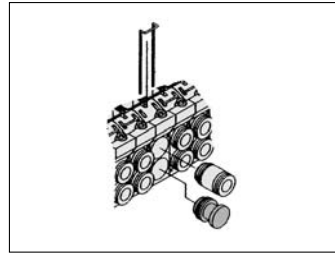


DIN rail mounting bracket  
[-D/-D0/-D□]  
VVQ2000-57A

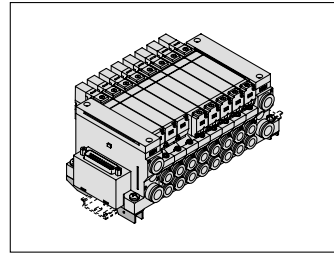


Direct EXH outlet with  
built-in silencer  
[-S]

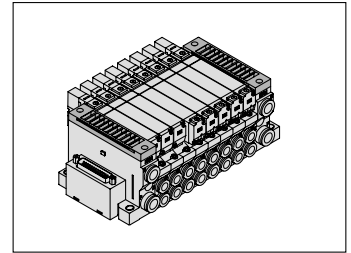


Silencer (For EXH port)  
AN200-KM10

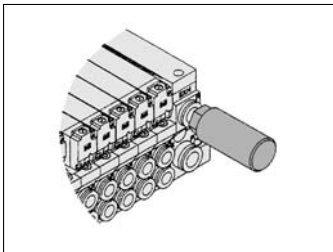

Elbow fitting assembly  
VVQ2000-F-L□

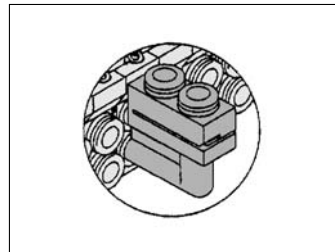


Dual flow fitting assembly  
VVQ2000-52A-C<sub>10</sub>-N<sub>11</sub>

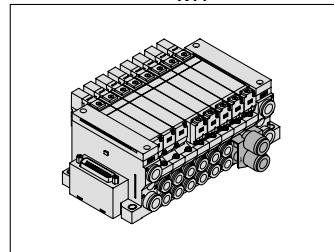


- Refer to back page 4 for cylinder port fittings part number.
- Refer to page 64 for replacement parts.

Double check block  
(Separated)  
VQ2000-FPG-□□-□

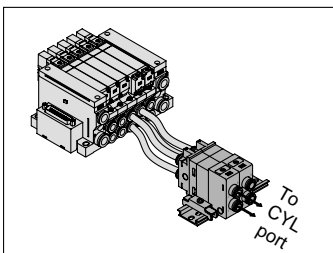


Double check block  
(Direct mounting)  
VVQ2000-23A-□

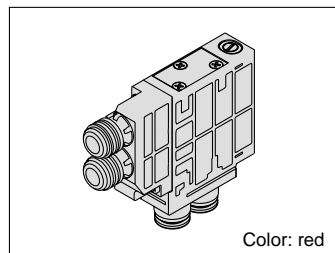



# Plug-in Unit Base Mounted

# Series VQ1000/2000

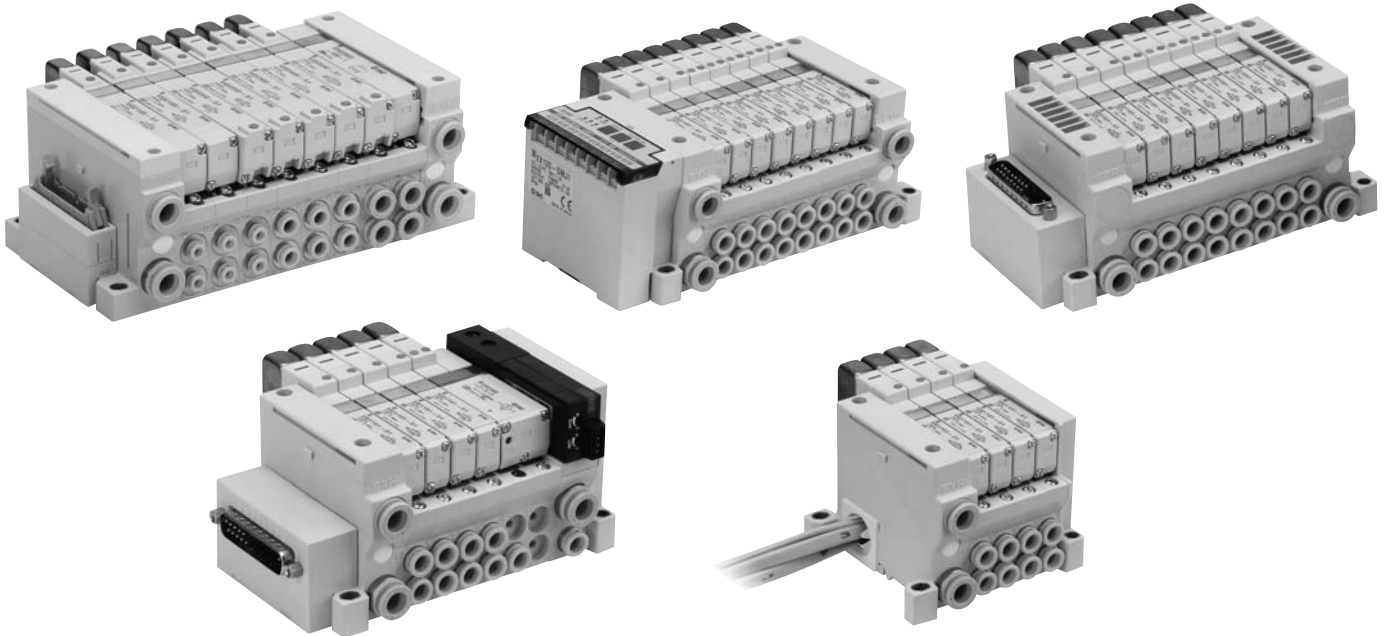

## Model

Series	Type of actuation	Model		Flow-rate characteristics <small>Note 1)</small>						Response time (ms) <small>Note 2)</small>			Mass (g)	
				1 → 2/4 (P → A/B)			2/4 → 3/5 (A/B → R1/R2)			Standard: 0.4 W	High-speed response: 0.95 W	AC		
				C [dm <sup>3</sup> /(s·bar)]	b	Cv	C [dm <sup>3</sup> /(s·bar)]	b	Cv					
VQ1000	2-position	Single	Metal seal	VQ1100	0.70	0.15	0.16	0.72	0.25	0.18	15 or less	12 or less	29 or less	67
			Rubber seal	VQ1101	0.85	0.20	0.21	1.0	0.30	0.25	20 or less	15 or less	34 or less	
	2-position	Double	Metal seal	VQ1200	0.70	0.15	0.16	0.72	0.25	0.18	13 or less	10 or less	13 or less	77
			Rubber seal	VQ1201	0.85	0.20	0.21	1.0	0.30	0.25	20 or less	15 or less	20 or less	
	3-position	Closed center	Metal seal	VQ1300	0.68	0.15	0.16	0.72	0.25	0.18	26 or less	20 or less	40 or less	
			Rubber seal	VQ1301	0.70	0.20	0.16	0.65	0.42	0.18	33 or less	25 or less	47 or less	
		Exhaust center	Metal seal	VQ1400	0.68	0.15	0.16	0.72	0.25	0.18	26 or less	20 or less	40 or less	
			Rubber seal	VQ1401	0.70	0.20	0.16	1.0	0.30	0.25	33 or less	25 or less	47 or less	
	3-position	Pressure center	Metal seal	VQ1500	0.70	0.15	0.16	0.72	0.25	0.18	26 or less	20 or less	40 or less	
			Rubber seal	VQ1501	0.85	0.20	0.21	0.65	0.42	0.18	33 or less	25 or less	47 or less	
4-position	Dual 3-port valve	Rubber seal	VQ1 <sup>A</sup> <sub>B</sub> 01 C	0.70	0.20	0.16	0.70	0.20	0.16	33 or less	25 or less	47 or less		
VQ2000	2-position	Single	Metal seal	VQ2100	2.0	0.15	0.46	2.6	0.15	0.60	29 or less	22 or less	49 or less	
			Rubber seal	VQ2101	2.2	0.28	0.55	3.2	0.30	0.80	31 or less	24 or less	51 or less	
	2-position	Double	Metal seal	VQ2200	2.0	0.15	0.46	2.6	0.15	0.60	20 or less	15 or less	20 or less	105
			Rubber seal	VQ2201	2.2	0.28	0.55	3.2	0.30	0.80	26 or less	20 or less	26 or less	
	3-position	Closed center	Metal seal	VQ2300	2.0	0.15	0.46	2.0	0.18	0.46	38 or less	29 or less	58 or less	
			Rubber seal	VQ2301	2.0	0.28	0.49	2.2	0.31	0.60	44 or less	34 or less	64 or less	
		Exhaust center	Metal seal	VQ2400	2.0	0.15	0.46	2.6	0.15	0.60	38 or less	29 or less	58 or less	
			Rubber seal	VQ2401	2.0	0.28	0.49	3.2	0.30	0.80	44 or less	34 or less	64 or less	
	3-position	Pressure center	Metal seal	VQ2500	2.4	0.17	0.57	2.0	0.18	0.46	38 or less	29 or less	58 or less	
			Rubber seal	VQ2501	3.2	0.28	0.80	2.2	0.31	0.60	44 or less	34 or less	64 or less	
4-position	Dual 3-port valve	Rubber seal	VQ2 <sup>A</sup> <sub>B</sub> 01 C	1.8	0.28	0.46	1.8	0.28	0.46	44 or less	34 or less	64 or less		



Note 1) The values are given for port size C6: (VQ1000), C8: (VQ2000) without back pressure check valve.


Note 2) As per JIS B 8375-1981 (Supply pressure 0.5 MPa; with indicator light/surge voltage suppressor; clean air

The response time is subject to the pressure and quality of the air.) The values at the time of ON are given for double types.



## Standard Specifications

### JIS symbol

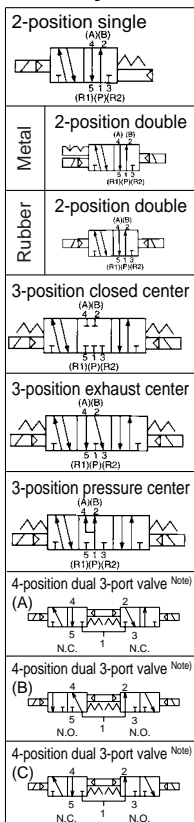

Note) Rubber seal only


Valve specifications	Valve type	Metal seal	Rubber seal	
	Fluid	Air, Inert gas	Air, Inert gas	
	Maximum operating pressure	0.7 MPa (High-pressure type: 1.0 MPa)		
	Minimum operating pressure	Single	0.1 MPa	0.15 MPa
		Double	0.1 MPa	0.1 MPa
		3-position	0.1 MPa	0.2 MPa
		4-position	—	0.15 MPa
	Ambient and fluid temperature	-10 to 50°C <sup>Note 1)</sup>		
	Lubrication	Not required		
	Manual override	Push type, Locking type (Tool required, Manual) semi-standard		
Impact/Vibration resistance <sup>Note 2)</sup>	150/30 m/s <sup>2</sup>			
Enclosure	Dust-protected; Dust-tight, Water-jet-proof (IP65) <sup>Note 4)</sup>			
Electrical specifications	Coil rated voltage	12, 24 VDC, 100, 110, 200, 220 VAC (50/60 Hz)		
	Allowable voltage fluctuation	±10% of rated voltage		
	Coil insulation type	Equivalent to Class B		
	Power consumption (Current)	24 VDC	0.4 W DC (17 mA), 0.95 W DC (40 mA) <sup>Note 3)</sup>	
		12 VDC	0.4 W DC (34 mA), 0.95 W DC (80 mA) <sup>Note 3)</sup>	
		100 VAC	Inrush 0.96 VA (10 mA), Holding 0.96 VA (10 mA)	
		110 VAC	Inrush 1.0 VA (9 mA), Holding 1.0 VA (9 mA)	
		200 VAC	Inrush 1.26 VA (6 mA), Holding 1.26 VA (6 mA)	
		220 VAC	Inrush 1.38 VA (6 mA), Holding 1.38 VA (6 mA)	

Note 1) Use dry air to prevent condensation when operating at low temperatures.  
 Note 2) Impact resistance ..... No malfunction occurred when it is tested in the axial direction and at the right angles to the main valve and armature in both energized and de-energized states every once for each condition. (Values at the initial period)  
 Vibration resistance ... No malfunction occurred in a one-sweep test between 45 and 2000 Hz. Test was performed at both energized and de-energized states in the axial direction and at the right angles to the main valve and armature. (Values at the initial period)  
 Note 3) Value for high-speed response, high-voltage type (0.95 W)  
 Note 4) Dust-tight, Water-jet-proof (IP65) is available on T/L/S/M kit of the VQ2000.


## Manifold Specifications

Series	Base model	Connection type	Piping specifications		Applicable stations <sup>Note 2)</sup>	Applicable solenoid valve	5-station mass (g)	
			Piping direction	Port size <sup>Note 1)</sup>				
VQ1000	VV5Q11-□□□	F kit—D-sub connector P kit—Flat ribbon cable J kit—Flat ribbon cable (20P) G kit—Flat ribbon cable with terminal block T kit—Terminal block box L kit—Lead wire S kit—Serial transmission	Side	1(P), 3(R)	4(A), 2(B)	( F/P/T kit 2 to 24 stations ) ( J/G/S kit 2 to 16 stations ) ( L kit 1 to 8 stations )	VQ1□00 VQ1□01	643 (Single) 754 (Double, 3-position)
				C8 (ø8)	C3 (ø3.2) C4 (ø4) C6 (ø6) M5 (M5 thread)			
VQ2000	VV5Q21-□□□	F kit—D-sub connector P kit—Flat ribbon cable J kit—Flat ribbon cable (20P) G kit—Flat ribbon cable with terminal block T kit—Terminal block box L kit—Lead wire S kit—Serial transmission M kit—Circular connector	Side	1(P), 3(R)	4(A), 2(B)	( F/P kit 2 to 24 stations ) ( J/G/S kit 2 to 16 stations ) ( L kit 1 to 8 stations ) ( T kit 2 to 20 stations )	VQ2□00 VQ2□01	1076 (Single) 1119 (Double, 3-position)
				C10 (ø10)	C4 (ø4) C6 (ø6) C8 (ø8)			

Note 1) Inch-size one-touch fittings are also available. Refer to page 57 for details.  
 Note 2) Refer to page 56 for details.

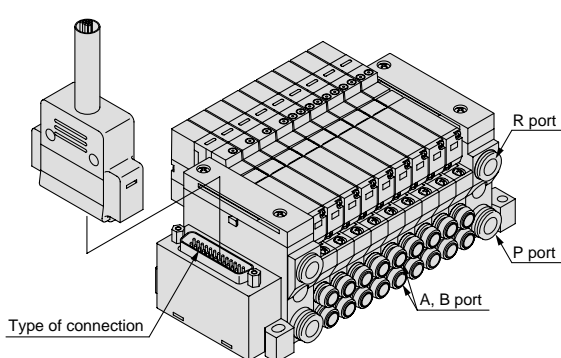


VV5Q11

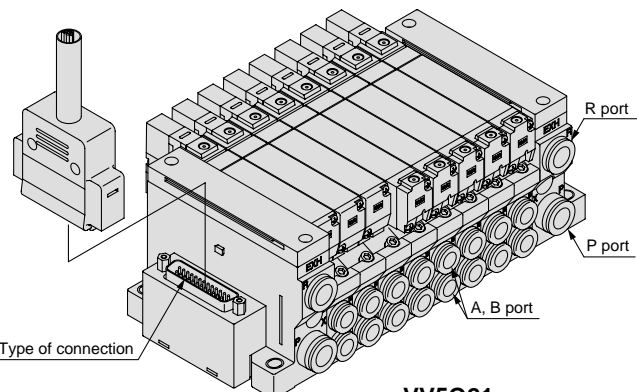

VV5Q21

# F Series VQ1000/2000 Kit (D-sub connector)

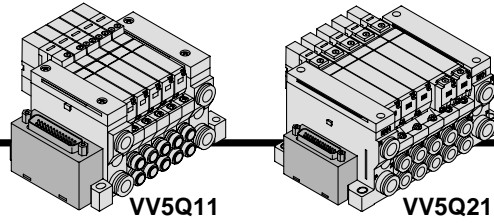

- D-sub connector reduces installation labor for electrical connections.
- Using the D-sub connector (25P), (15P as semi-standard) conforming to MIL standard permits the use of connectors put on the market and gives a wide interchangeability.
- Top or side receptacle position can be selected in accordance with the available mounting space.
- Maximum stations are 24.


## Manifold Specifications

Series	Piping specifications		Applicable stations	
	Piping direction	Port size		
		1(P), 3(R)	4(A), 2(B)	
VQ1000	Side	C8	C3, C4, C6, M5	Max. 24 stations
VQ2000	Side	C10	C4, C6, C8	Max. 24 stations

## D-sub Connector (25 Pins)

## Cable Assembly

AXT100-DS25-<sup>015</sup><sub>030</sub><sup>050</sup>  
 (The D-sub connector cable assembly can be ordered individually or included in a specific manifold model no. Refer to "How to Order Manifold.")

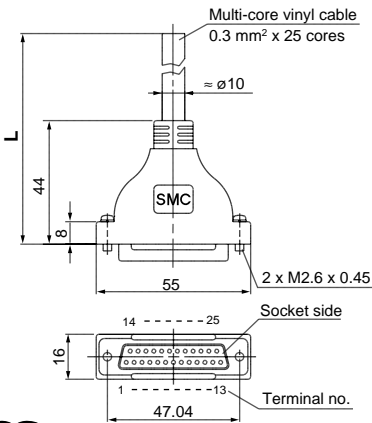

### D-sub connector cable assembly

Cable length (L)	Assembly part no.	Note
1.5 m	AXT100-DS25-015	Cable 25 cores x 24AWG
3 m	AXT100-DS25-030	
5 m	AXT100-DS25-050	

\* For other commercial connectors, use a 25 pins type with female connector conforming to MIL-C-24308.

\* Cannot be used for transfer wiring.

### Connector manufacturers' example

- Fujitsu Limited
- Japan Aviation Electronics Industry, Ltd.
- J.S.T. Mfg. Co., Ltd.
- Hirose Electric Co., Ltd.

### Electrical characteristics

Item	Property
Conductor resistance Ω/km, 20°C	65 or less
Voltage limit V, 1 min, AC	1000
Insulation resistance MΩ/km, 20°C	5 or more

Note) The min. bending radius of the D-sub connector cable assembly is 20 mm.


### Wire color by terminal no. of D-sub connector cable assembly

Terminal no.	Lead wire color	Dot marking
1	Black	None
2	Brown	None
3	Red	None
4	Orange	None
5	Yellow	None
6	Pink	None
7	Blue	None
8	Purple	White
9	Gray	Black
10	White	Black
11	White	Red
12	Yellow	Red
13	Orange	Red
14	Yellow	Black
15	Pink	Black
16	Blue	White
17	Purple	None
18	Gray	None
19	Orange	Black
20	Red	White
21	Brown	White
22	Pink	Red
23	Gray	Red
24	Black	White
25	White	None



Note 1) Types with 15 pins are also available. Refer to page 55 for details.  
 Note 2) Lengths other than the above are also available. Please contact SMC for details.

## How to Order Manifold

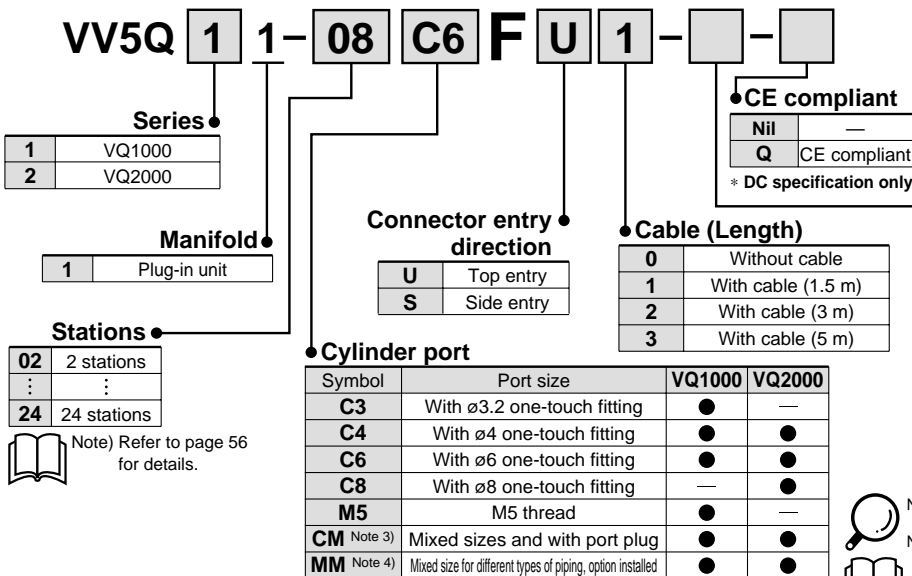

### Option


Symbol	Option	VQ1000	VQ2000
Nil	None	●	●
2	200/220 VAC models (F/L kit only)	●	●
B <sup>Note 2)</sup>	With back pressure check valve	●	●
D	DIN rail mounting	●	●
D0	With DIN rail bracket (Without DIN rail)	●	●
D□ <sup>Note 3)</sup>	DIN rail length specified (□: Stations 02 to 24)	●	●
G1 <sup>Note 4)</sup>	1 set of regulator unit	—	—
G2 <sup>Note 4)</sup>	2 sets of regulator unit	●	—
G3 <sup>Note 4)</sup>	3 sets of regulator unit	—	—
J□ <sup>Note 5)</sup>	With ejector unit	●	—
K <sup>Note 6)</sup>	Special wiring specifications (Except double wiring)	●	●
N	With name plate	●	●
R <sup>Note 7)</sup>	External pilot	●	●
S	Direct EXH outlet with built-in silencer	●	●

Note) Refer to page 56 for details.

- Note 1) Insert "L" (Top ported) or "B" (Bottom ported) for elbow type.  
 Example) B6 (Bottom ported elbow with ø6 one-touch fitting)
- Note 2) Indicate "LM" for models with elbow fittings and mixed cylinder port sizes.
- Note 3) Indicate "Mixed sizes and with port plug" by means of the manifold specification sheet.
- Note 4) When selecting the mixed size for different types of piping, dual flow fitting assembly, or double check block (direct mounting), enter "MM" and give instructions in the manifold specification sheet.
- Note 5) Inch-size one-touch fittings are available. Refer to "Semi-standard" on page 57 for details.



- Note 1) When two or more symbols are specified, indicate them alphabetically. Example) -BRS
- Note 2) Models with a suffix "-B" have check valves for prevention of back pressure at all manifold stations. When a back pressure check valve is desired, and is to be installed only in certain manifold stations, specify the mounting position by means of the manifold specification sheet.
- Note 3) The number of stations that may be displayed is longer than the manifold number of stations.
- Note 4) Specify the mounting position by means of the manifold specification sheet.
- Note 5) Refer to page 69 for the details on with ejector unit. A combination of "J" and "N" is not available.
- Note 6) Specify the wiring specifications by means of the manifold specification sheet.
- Note 7) Indicate "R" for the valve with external pilot.

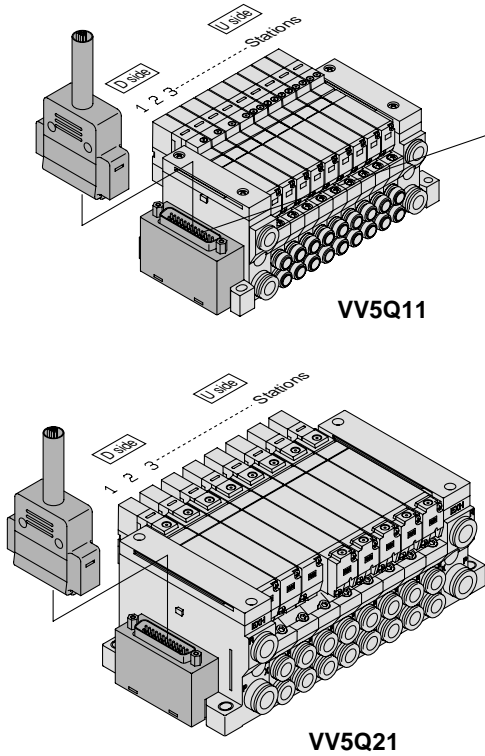

● **Electrical Wiring Specifications**

**D-sub connector**

**D-sub connector assembly**  
015  
AXT100-DS25-030 Wire color  
050

Terminal no.	Polarity	Lead wire color	Dot marking
Station 1 SOL.A 1	(-)	(+)	Black None
Station 1 SOL.B 14	(-)	(+)	Yellow Black
Station 2 SOL.A 2	(-)	(+)	Brown None
Station 2 SOL.B 15	(-)	(+)	Pink Black
Station 3 SOL.A 3	(-)	(+)	Red None
Station 3 SOL.B 16	(-)	(+)	Blue White
Station 4 SOL.A 4	(-)	(+)	Orange None
Station 4 SOL.B 17	(-)	(+)	Purple None
Station 5 SOL.A 5	(-)	(+)	Yellow None
Station 5 SOL.B 18	(-)	(+)	Gray None
Station 6 SOL.A 6	(-)	(+)	Pink None
Station 6 SOL.B 19	(-)	(+)	Orange Black
Station 7 SOL.A 7	(-)	(+)	Blue None
Station 7 SOL.B 20	(-)	(+)	Red White
Station 8 SOL.A 8	(-)	(+)	Purple White
Station 8 SOL.B 21	(-)	(+)	Brown White
Station 9 SOL.A 9	(-)	(+)	Gray Black
Station 9 SOL.B 22	(-)	(+)	Pink Red
Station 10 SOL.A 10	(-)	(+)	White Black
Station 10 SOL.B 23	(-)	(+)	Gray Red
Station 11 SOL.A 11	(-)	(+)	White Red
Station 11 SOL.B 24	(-)	(+)	Black White
Station 12 SOL.A 12	(-)	(+)	Yellow Red
Station 12 SOL.B 25	(-)	(+)	White None
COM. 13	(+)	(-) <sup>Note)</sup>	Orange Red

Positive COM spec.      Negative COM spec.

As the standard electrical wiring specifications, double wiring (connected to SOL. A and SOL. B) is adopted for the internal wiring of each station for 12 stations or less, regardless of valve and option types. Mixed single and double wiring is available as semi-standard. Refer to page 56 for details.

Note) When using the negative common specifications, use valves for negative common. (Refer to page 56.) Refer to "Semi-standard" on page 56 for details.

The total number of stations is tabulated starting from station one on the D-side.

**How to Order Valves**

**VQ 1 1 0 0 - 5 - 1 -**

**Series**  
1 VQ1000  
2 VQ2000

**Type of actuation**

1	2-position single
2	2-position double
3	3-position closed center
4	3-position exhaust center
5	3-position pressure center
A	4-position dual port (N.C. +N.C.)
B	4-position dual port (N.O. +N.O.)
C	4-position dual port (N.C. +N.O.)

**Seal**

0	Metal seal
1	Rubber seal

**Function**

Symbol	Specifications	DC (0.4 W)	AC (Note 1)
Nil	Standard	○	○
B	High-speed response type	○	—
K <sup>Note 2)</sup>	High-pressure type (1.0 MPa)	○	—
N <sup>Note 3)</sup>	Negative common	○	—
R <sup>Note 3)</sup>	External pilot	○	○

Note 1) Refer to page 16 for power consumption of AC type.  
Note 2) Metal seal only  
Note 3) For external pilot and negative common specifications, refer to "Semi-standard" on pages 56 to 57.  
Note 4) When two or more symbols are specified, indicate them alphabetically. Combination of [B] and [K] is not possible.

**Manual override**

Nil	Non-locking push type (Tool required)
B	Locking type (Tool required)
C	Locking type (Manual)
D	Slide locking type (Manual)

**Light/surge voltage suppressor**

Nil	Yes
E	None

**Coil voltage**

1	100 VAC (50/60 Hz)
2	200 VAC (50/60 Hz)
3	110 VAC (50/60 Hz)
4	220 VAC (50/60 Hz)
5	24 VDC
6	12 VDC

**CE compliant**

Nil	—
Q	CE compliant

\* DC specification only


**How to Order Manifold Assembly**

Specify the part numbers for valves and options together beneath the manifold base part number.

**<Example>**  
D-sub connector kit with cable (3 m)  
VV5Q11-09C6FU2 ...1 set—Manifold base part no.  
\*VQ1100-51 .....2 sets—Valve part no. (Stations 1 to 2)  
\*VQ1200-51 .....4 sets—Valve part no. (Stations 3 to 6)  
\*VQ1300-51 .....2 sets—Valve part no. (Stations 7 to 8)  
\*VVQ1000-10A-1 .....1 set—Blanking plate part no. (Station 9)

Prefix the asterisk to the part nos. of the solenoid valve, etc.

Write sequentially from the 1st station on the D-side. When part nos. written collectively are complicated, specify them by means of the manifold specification sheet.

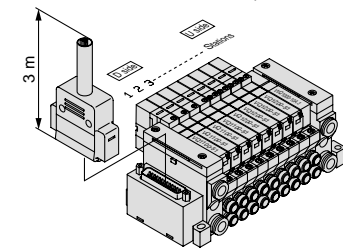

**⚠ Caution**  
Use the standard (DC) specification when continuously energizing for long periods of time.





- F kit
- P kit
- J kit
- G kit
- T kit
- L kit
- S kit
- M kit
- Sub-plate Single Unit
- Semi-standard
- Construction
- Exploded View of Manifold
- Manifold Optional Parts
- Safety Instructions
- Specific Product Precautions

# F Series VQ1000/2000 kit (D-sub connector)

## VV5Q11

<>: AC

The dashed lines indicate the DIN rail mounting [-D] and the side entry connection [-FS].

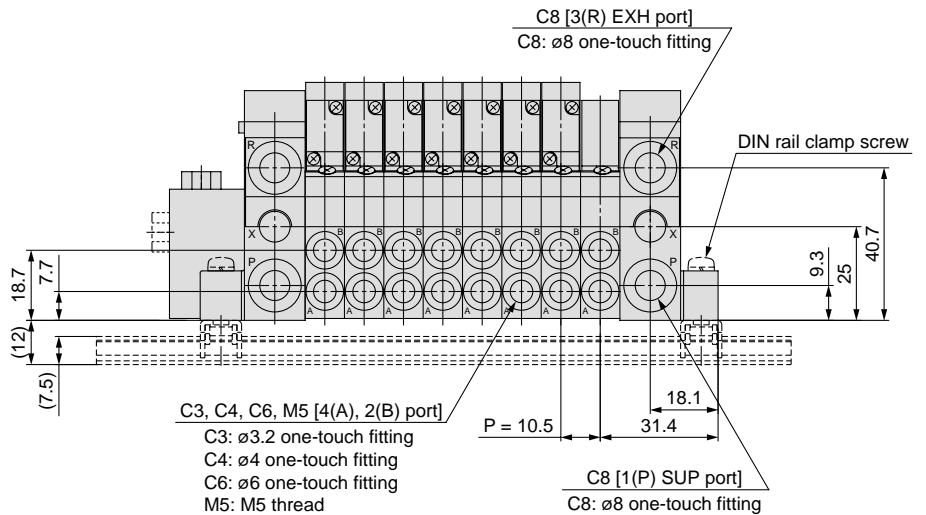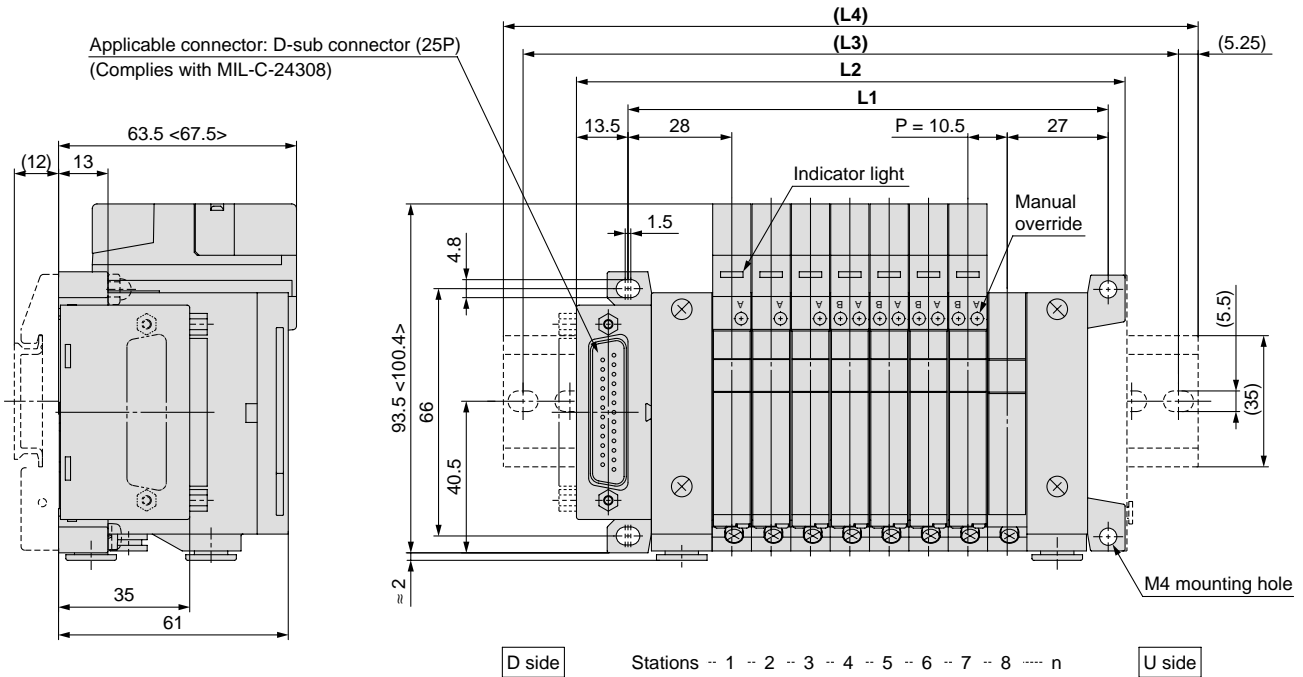

### Dimensions

Formula L1 = 10.5n + 44.5, L2 = 10.5n + 62.5 n: Station (Maximum 24 stations)



L \ n	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24
<b>L1</b>	65.5	76	86.5	97	107.5	118	128.5	139	149.5	160	170.5	181	191.5	202	212.5	223	233.5	244	254.5	265	275.5	286	296.5
<b>L2</b>	83.5	94	104.5	115	125.5	136	146.5	157	167.5	178	188.5	199	209.5	220	230.5	241	251.5	262	272.5	283	293.5	304	314.5
<b>(L3)</b>	112.5	125	125	137.5	150	162.5	175	187.5	187.5	200	212.5	225	237.5	250	250	262.5	275	287.5	300	312.5	325	325	337.5
<b>(L4)</b>	123	135.5	135.5	148	160.5	173	185.5	198	198	210.5	223	235.5	248	260.5	260.5	273	285.5	298	310.5	323	335.5	335.5	348

With ejector unit: Formula L1 = 10.5n + 28.7 + (Number of ejector units x 26.7)  
 L2 = 10.5n + 46.3 + (Number of ejector units x 26.7)  
 L4 is L2 plus about 30.

# VV5Q21

< >: AC

The dashed lines indicate the DIN rail mounting [-D] and the side entry connection [-FS].

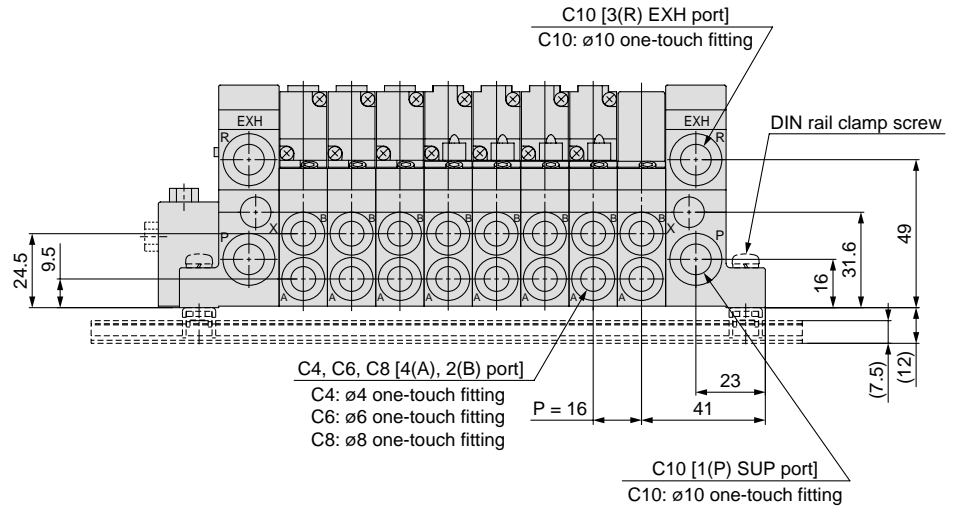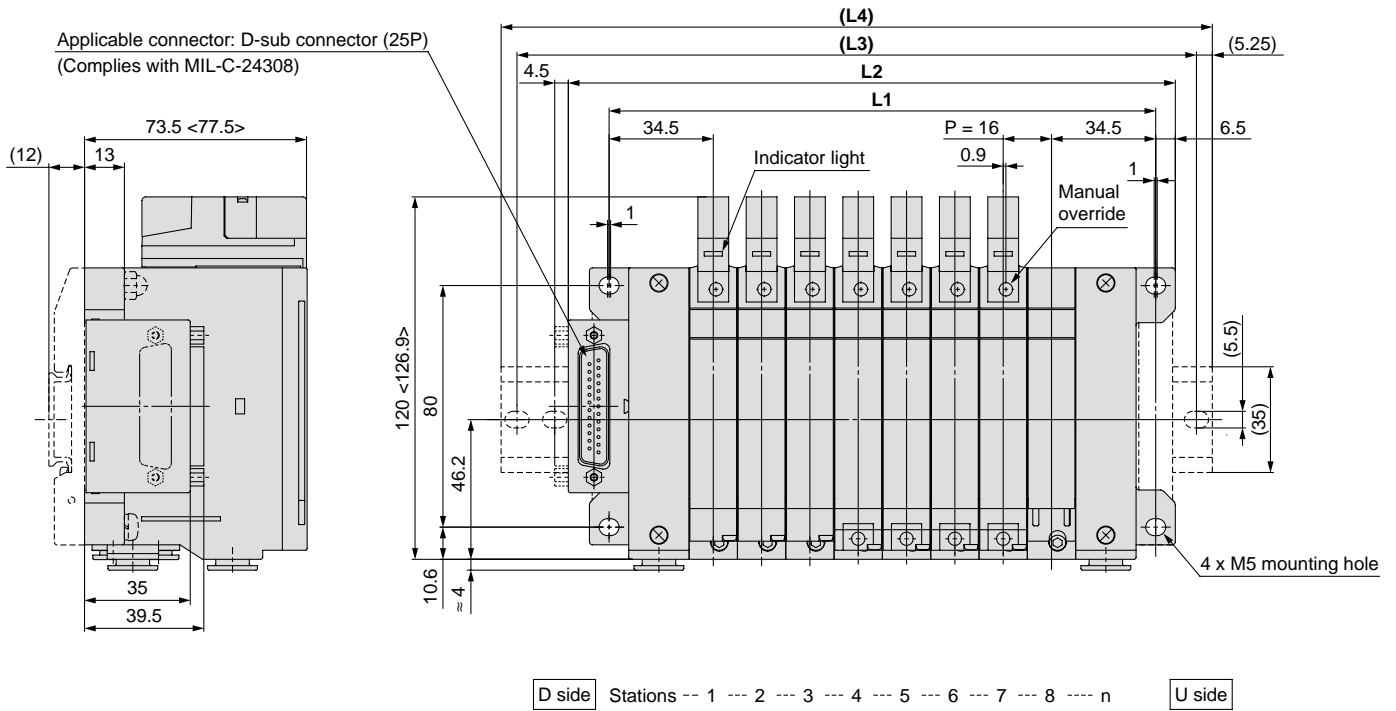


## Dimensions

Formula L1 = 16n + 53, L2 = 16n + 73 n: Station (Maximum 24 stations)

L \ n	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24
<b>L1</b>	85	101	117	133	149	165	181	197	213	229	245	261	277	293	309	325	341	357	373	389	405	421	437
<b>L2</b>	105	121	137	153	169	185	201	217	233	249	265	281	297	313	329	345	361	377	393	409	425	441	457
<b>(L3)</b>	137.5	150	162.5	187.5	200	212.5	225	250	262.5	275	300	312.5	325	337.5	350	375	387.5	400	412.5	437.5	450	462.5	487.5
<b>(L4)</b>	148	160.5	173	198	210.5	223	235.5	260.5	273	285.5	310.5	323	335.5	348	360.5	385.5	398	410.5	423	448	460.5	473	498

# P Series VQ1000/2000 kit (Flat ribbon cable)

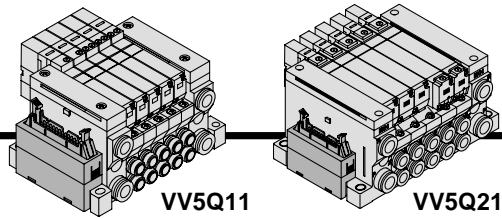

- MIL flat ribbon cable connector reduces installation labor for electrical connection.
- Using the connector for flat ribbon cable (26P) conforming to MIL standard permits the use of connectors put on the market and gives a wide interchangeability.
- Top or side receptacle position can be selected in accordance with the available mounting space.
- Maximum stations are 24.

## Manifold Specifications

Series	Piping specifications		Applicable stations
	Piping direction	Port size	
VQ1000	Side	1(P), 3(R) 4(A), 2(B)	Max. 24 stations
VQ2000	Side	C8 C4, C6, C8	Max. 24 stations

## Flat Ribbon Cable (26 Pins)

**AXT100-FC26-1 to 3**  
(Flat ribbon cable connector assembly can be ordered individually or included in a specific manifold model no. Refer to "How to Order Manifold.")

**Flat Ribbon Cable Connector Assembly**

Cable length (L)	Assembly part no.	Note
1.5 m	AXT100-FC26-1	Cable 26 cores x 28AWG
3 m	AXT100-FC26-2	
5 m	AXT100-FC26-3	


\* For other commercial connectors, use a 26 pins type with strain relief conforming to MIL-C-83503.  
\* Cannot be used for transfer wiring.

**Connector manufacturers' example**

- Hirose Electric Co., Ltd.
- Sumitomo 3M Limited
- Fujitsu Limited
- Japan Aviation Electronics Industry, Ltd.
- J.S.T. Mfg. Co., Ltd.
- Oki Electric Cable Co., Ltd.

Note 1) Other than the above model, 10P, 16P, 20P are also available. Refer to page 55 for details.  
Note 2) Lengths other than the above are also available. Please contact SMC for details.

## Cable Assembly

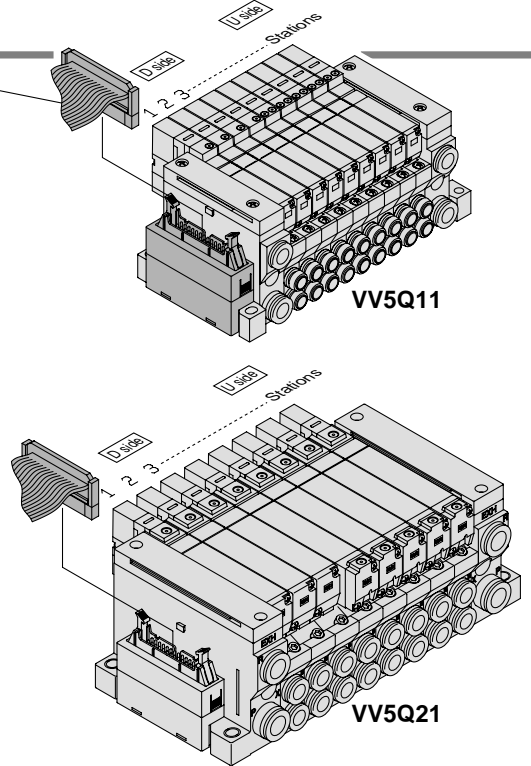

The total number of stations is tabulated starting from one on the D-side.

## How to Order Manifold

**VV5Q 1 1 - 08 C6 P U 1 - -**

**Series**

1	VQ1000
2	VQ2000

**Manifold**

1	Plug-in unit
---	--------------

**Stations**

02	2 stations
...	...
24	24 stations

**Connector entry direction**

U	Top entry
S	Side entry

**Cylinder port**

Symbol	Port size	VQ1000	VQ2000
C3	With ø3.2 one-touch fitting	●	—
C4	With ø4 one-touch fitting	●	●
C6	With ø6 one-touch fitting	●	●
C8	With ø8 one-touch fitting	—	●
M5	M5 thread	●	—
CM	Mixed sizes and with port plug	●	●
MM	Mixed size for different types of piping, option installed	●	●

**Cable (Length)**

0	Without cable
1	With cable (1.5 m)
2	With cable (3 m)
3	With cable (5 m)

**CE compliant**

Nil	—
Q	CE compliant

\* DC specification only

## Option

Symbol	Option	VQ1000	VQ2000
Nil	None	●	●
B	With back pressure check valve	●	●
D	DIN rail mounting	●	●
D0	With DIN rail bracket (Without DIN rail)	●	●
D□	DIN rail length specified (□: Stations 02 to 24)	●	●
G1	1 set of regulator unit	—	—
G2	2 sets of regulator unit	●	—
G3	3 sets of regulator unit	—	—
J	With ejector unit	●	—
K	Special wiring specifications (Except double wiring)	●	●
N	With name plate	●	●
R	External pilot	●	●
S	Direct EXH outlet with built-in silencer	●	●

Note) Refer to page 56 for details.

- Note 1) Insert "L" (Top ported) or "B" (Bottom ported) for elbow type. Example) B6 (Bottom ported elbow with ø6 one-touch fitting)  
 Note 2) Indicate "LM" for models with elbow fittings and mixed cylinder port sizes.  
 Note 3) Indicate "Mixed sizes and with port plug" by means of the manifold specification sheet.  
 Note 4) When selecting the mixed size for different types of piping, dual flow fitting assembly, or double check block (direct mounting), enter "MM" and give instructions in the manifold specification sheet.  
 Note 5) Inch-size one-touch fittings are available. Refer to "Semi-standard" on page 57 for details.

- Note 1) When two or more symbols are specified, indicate them alphabetically. Example) -BRS  
 Note 2) Models with a suffix "-B" have check valves for prevention of back pressure at all manifold stations. When a back pressure check valve is desired, and is to be installed only in certain manifold stations, specify the mounting position by means of the manifold specification sheet.  
 Note 3) The number of stations that may be displayed is longer than the manifold number of stations.  
 Note 4) Specify the mounting position by means of the manifold specification sheet.  
 Note 5) Refer to page 69 for details on with ejector unit. A combination of "J" and "N" is not available.  
 Note 6) Specify the wiring specifications by means of the manifold specification sheet.  
 Note 7) Indicate "R" for the valve with external pilot.

## • Electrical Wiring Specifications

**Flat ribbon cable connector**

Connector terminal no. (left side): 26, 24, 22, 20, 18, 16, 14, 12, 10, 8, 6, 4, 2

Triangle mark indicator position (on terminal 1)

Electrical wiring specifications

Terminal no.	Polarity
SOL.A 1	(-) (+)
SOL.B 2	(-) (+)
SOL.A 3	(-) (+)
SOL.B 4	(-) (+)
SOL.A 5	(-) (+)
SOL.B 6	(-) (+)
SOL.A 7	(-) (+)
SOL.B 8	(-) (+)
SOL.A 9	(-) (+)
SOL.B 10	(-) (+)
SOL.A 11	(-) (+)
SOL.B 12	(-) (+)
SOL.A 13	(-) (+)
SOL.B 14	(-) (+)
SOL.A 15	(-) (+)
SOL.B 16	(-) (+)
SOL.A 17	(-) (+)
SOL.B 18	(-) (+)
SOL.A 19	(-) (+)
SOL.B 20	(-) (+)
SOL.A 21	(-) (+)
SOL.B 22	(-) (+)
SOL.A 23	(-) (+)
SOL.B 24	(-) (+)
COM. 25	(+) (-)
COM. 26	(+) (-)

Positive COM spec.      Negative COM spec. (Note)

As the standard electrical wiring specifications, double wiring (connected to SOL. A and SOL. B) is adopted for the internal wiring of each station for 12 stations or less, regardless of valve and option types.

Mixed single and double wiring is available as semi-standard. Refer to page 56 for details.

**Note)** When using the negative common specifications, use valves for negative common. (Refer to page 56.) Refer to "Semi-standard" on page 56 for details.

## How to Order Valves

**VQ 1 1 0 0** - **5** - **1** - **CE compliant**

**Series**

1	VQ1000
2	VQ2000

**Type of actuation**

1	2-position single
2	2-position double
3	3-position closed center
4	3-position exhaust center
5	3-position pressure center
A	4-position dual port (N.C. +N.C.)
B	4-position dual port (N.O. +N.O.)
C	4-position dual port (N.C. +N.O.)

**Seal**

0	Metal seal
1	Rubber seal

**Function**

Symbol	Specifications	DC (0.4 W)	AC (Note 1)
Nil	Standard	○	○
B	High-speed response type	○	—
K (Note 2)	High-pressure type (1.0 MPa)	○	—
N (Note 3)	Negative common	○	—
R (Note 3)	External pilot	○	○

**Manual override**

Nil	Non-locking push type (Tool required)
B	Locking type (Tool required)
C	Locking type (Manual)
D	Slide locking type (Manual)

**Light/surge voltage suppressor**

Nil	Yes
E	None

**Coil voltage**

1	100 VAC (50/60 Hz)
3	110 VAC (50/60 Hz)
5	24 VDC
6	12 VDC

**CE compliant**

Nil	—
Q	CE compliant

\* DC specification only

**Caution**  
Use the standard (DC) specification when continuously energizing for long periods of time.

**Note 1)** Refer to page 16 for power consumption of AC type.  
**Note 2)** Metal seal only  
**Note 3)** Refer to "Semi-standard" on pages 56 to 57 for external pilot and negative common specifications.  
**Note 4)** When two or more symbols are specified, indicate them alphabetically. Combination of [B] and [K] is not possible.


## How to Order Manifold Assembly

Specify the part numbers for valves and options together beneath the manifold base part number.

### <Example>

Flat ribbon cable kit with cable (3 m)  
**VV5Q11-09C6PU2...1 set**—Manifold base part no.  
 \*VQ1100-51 .....2 sets—Valve part no. (Stations 1 to 2)  
 \*VQ1200-51 .....4 sets—Valve part no. (Stations 3 to 6)  
 \*VQ1300-51 .....2 sets—Valve part no. (Stations 7 to 8)  
 \*VVQ1000-10A-1 .....1 set—Blanking plate part no. (Station 9)

Write sequentially from the 1st station on the D-side. When part nos. written collectively are complicated, specify them by means of the manifold specification sheet.

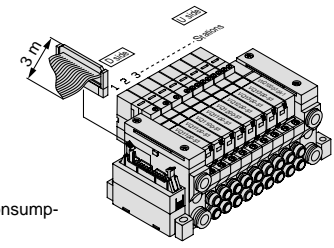

F kit  
 P kit  
 J kit  
 G kit  
 T kit  
 L kit  
 S kit  
 M kit  
 Sub-plate Single Unit  
 Semi-standard  
 Construction  
 Exploded View of Manifold  
 Manifold Optional Parts  
 Safety Instructions  
 Specific Product Precautions


# P Series VQ1000/2000 kit (Flat ribbon cable)

## VV5Q11

<>: AC

The dashed lines indicate the DIN rail mounting [-D] and the side entry connection [-PS].


Applicable connector: Flat ribbon cable connector (26P)  
(Complies with MIL-C-83503)

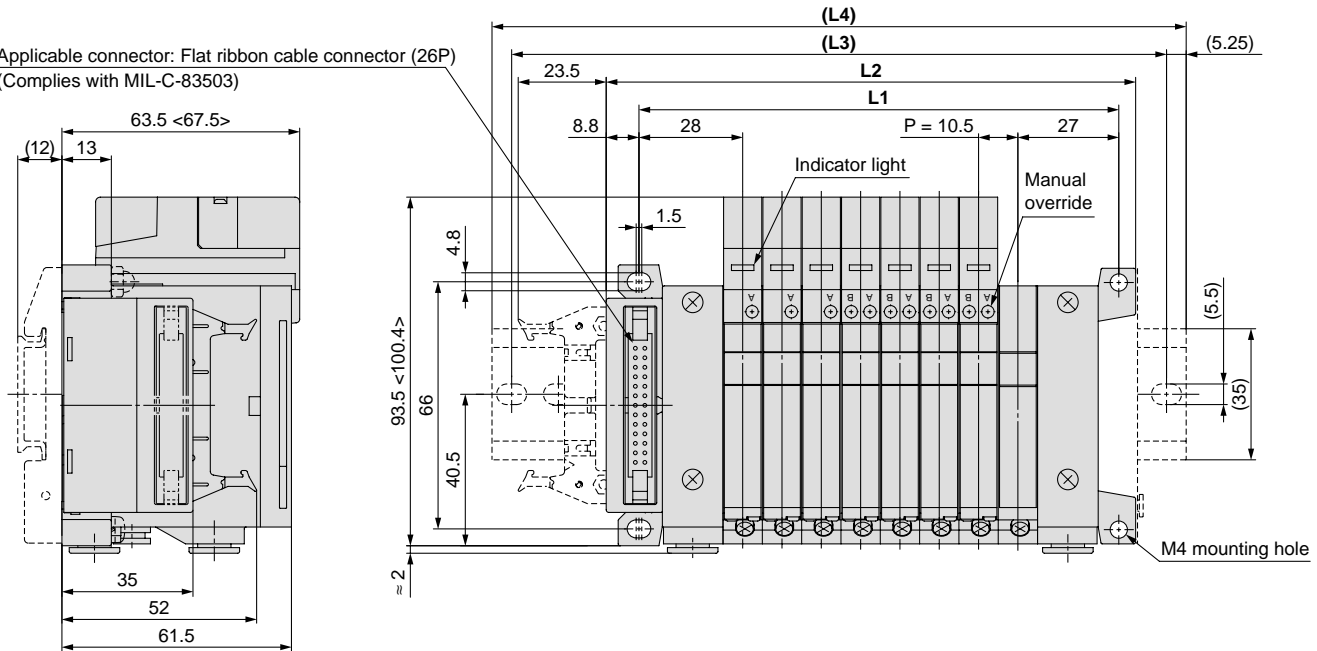

D side

Stations - 1 - 2 - 3 - 4 - 5 - 6 - 7 - 8 - ... - n

U side

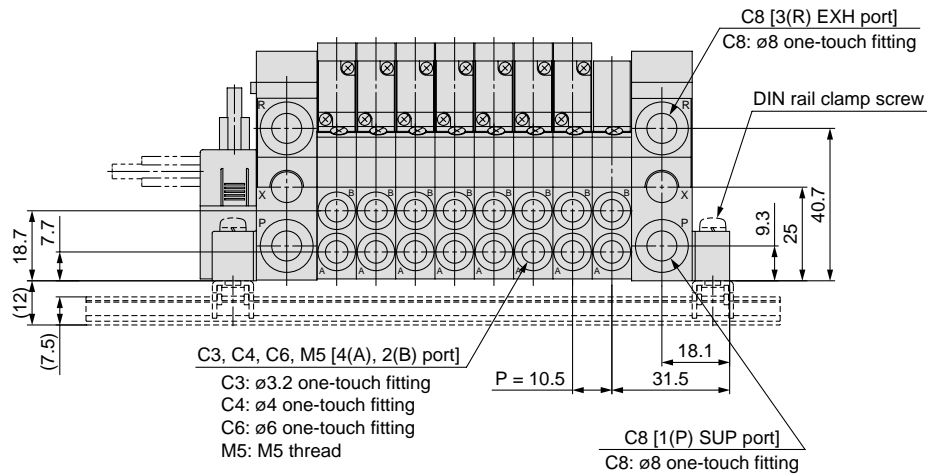

### Dimensions

Formula  $L1 = 10.5n + 44.5$ ,  $L2 = 10.5n + 57.5$  n: Station (Maximum 24 stations)

L \ n	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24
<b>L1</b>	65.5	76	86.5	97	107.5	118	128.5	139	149.5	160	170.5	181	191.5	202	212.5	223	233.5	244	254.5	265	275.5	286	296.5
<b>L2</b>	78.5	89	99.5	110	120.5	131	141.5	152	162.5	173	183.5	194	204.5	215	225.5	236	246.5	257	267.5	278	288.5	299	309.5
<b>(L3)</b>	112.5	125	125	137.5	150	162.5	175	187.5	187.5	200	212.5	225	225	237.5	250	262.5	275	287.5	287.5	300	312.5	325	337.5
<b>(L4)</b>	123	135.5	135.5	148	160.5	173	185.5	198	198	210.5	223	235.5	235.5	248	260.5	273	285.5	298	298	310.5	323	335.5	348

With ejector unit: Formula  $L1 = 10.5n + 28.7 + (\text{Number of ejector units} \times 26.7)$

$L2 = 10.5n + 41.3 + (\text{Number of ejector units} \times 26.7)$

$L4$  is  $L2$  plus about 30.





# VV5Q21

< >: AC

The dashed lines indicate the DIN rail mounting [-D] and the side entry connection [-PS].

Applicable connector: Flat ribbon cable connector (26P)  
(Complies with MIL-C-83503)

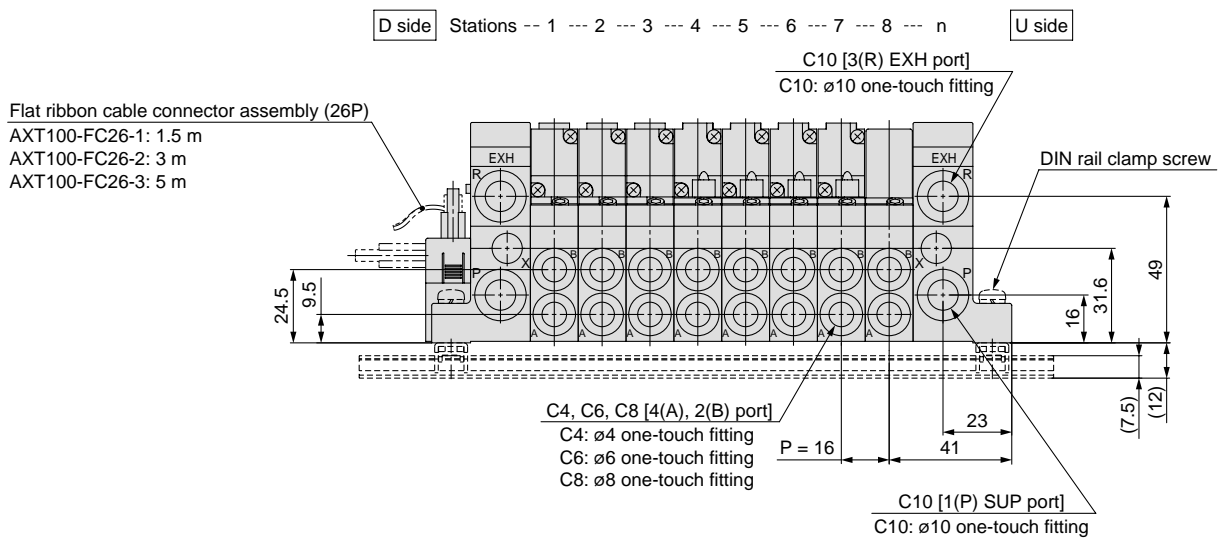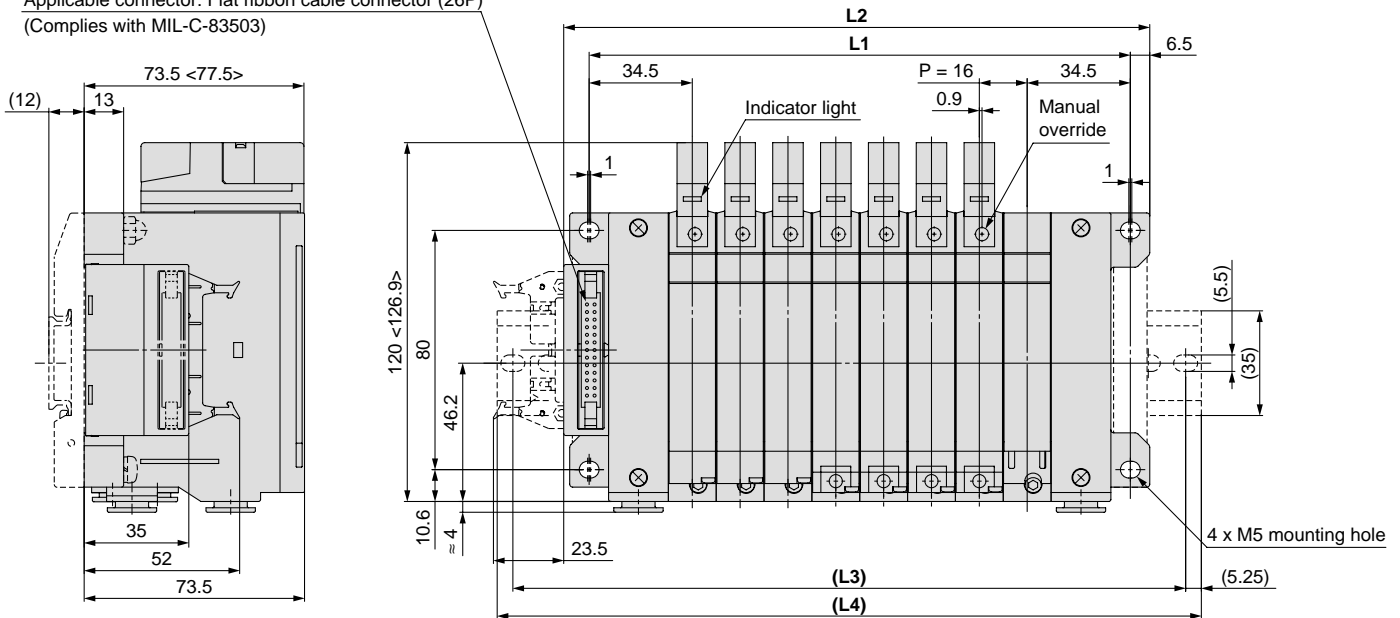

## Dimensions


Formula  $L1 = 16n + 53$ ,  $L2 = 16n + 68$  n: Station (Maximum 24 stations)

L \ n	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24
<b>L1</b>	85	101	117	133	149	165	181	197	213	229	245	261	277	293	309	325	341	357	373	389	405	421	437
<b>L2</b>	100	116	132	148	164	180	196	212	228	244	260	276	292	308	324	340	356	372	388	404	420	436	452
<b>(L3)</b>	125	150	162.5	175	187.5	212.5	225	237.5	262.5	275	287.5	300	312.5	337.5	350	362.5	387.5	400	412.5	425	450	462.5	475
<b>(L4)</b>	135.5	160.5	173	185.5	198	223	235.5	248	273	285.5	298	310.5	323	348	360.5	373	398	410.5	423	435.5	460.5	473	485.5

F kit  
P kit  
J kit  
G kit  
T kit  
L kit  
S kit  
M kit  
Sub-plate Single Unit  
Semi-standard  
Construction  
Exploded View of Manifold  
Manifold Optional Parts  
Safety Instructions  
Specific Product Precautions

# J

## Series VQ1000/2000 kit (Flat ribbon cable)

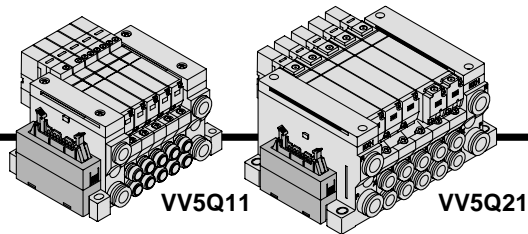

- MIL flat ribbon cable connector reduces installation labor for electrical connection.
- Using the connector for flat ribbon cable connectors (20P) conforming to MIL standard permits the use of connector put on the market and gives a wide interchangeability.
- Top or side receptacle position can be selected in accordance with the available mounting space.
- Maximum stations are 16.

### Manifold Specifications

Series	Piping specifications		Applicable stations
	Piping direction	Port size	
VQ1000	Side	1(P), 3(R) 4(A), 2(B)	Max. 16 stations
VQ2000	Side	C8 C4, C6, C8	Max. 16 stations

### Flat Ribbon Cable (20 Pins)

**AXT100-FC20-1 to 3**  
(Flat ribbon cable connector assembly can be ordered individually or included in a specific manifold model no. Refer to "How to Order Manifold.")

**Flat Ribbon Cable Connector Assembly**


Cable length (L)	Assembly part no.	Note
1.5 m	AXT100-FC20-1	Cable 20 cores x 28AWG
3 m	AXT100-FC20-2	
5 m	AXT100-FC20-3	

\* For other commercial connectors, use a 20 pins with strain relief conforming to MIL-C-83503.  
\* Cannot be used for transfer wiring.

**Connector manufacturers' example**

- Hirose Electric Co., Ltd.
- Japan Aviation Electronics Industry, Ltd.
- Sumitomo 3M Limited
- J.S.T. Mfg. Co., Ltd.
- Fujitsu Limited
- Oki Electric Cable Co., Ltd.

Note) Lengths other than the above are also available. Please contact SMC for details.

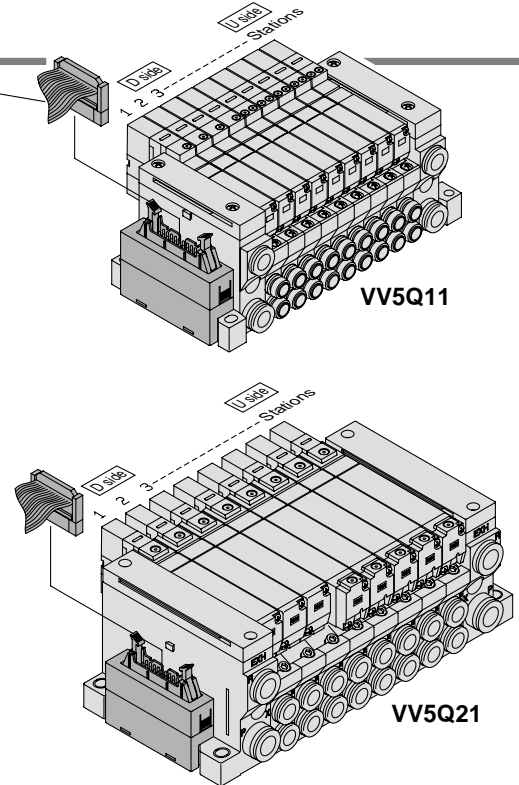

The total number of stations is tabulated starting from one on the D-side.

### How to Order Manifold

**VV5Q 1 1 - 08 C6 J U 1 - - -**

**Series**

1	VQ1000
2	VQ2000

**Manifold**

1	Plug-in unit
---	--------------

**Stations**

02	2 stations
...	...
16	16 stations

**Connector entry direction**

U	Top entry
S	Side entry

**Cylinder port**

Symbol	Port size	VQ1000	VQ2000
C3	With ø3.2 one-touch fitting	●	—
C4	With ø4 one-touch fitting	●	●
C6	With ø6 one-touch fitting	●	●
C8	With ø8 one-touch fitting	—	●
M5	M5 thread	●	—
CM Note 3)	Mixed sizes and with port plug	●	●
MM Note 4)	Mixed size for different types of piping, option installed	●	●

**Cable (Length)**

0	Without cable
1	With cable (1.5 m)
2	With cable (3 m)
3	With cable (5 m)

**CE compliant**

Nil	—
Q	CE compliant

### Option

Symbol	Option	VQ1000	VQ2000
Nil	None	●	●
B Note 2)	With back pressure check valve	●	●
D	DIN rail mounting	●	●
D0	With DIN rail bracket (Without DIN rail)	●	●
D□ Note 3)	DIN rail length specified (□: Stations 02 to 24)	●	●
G1 Note 4)	1 set of regulator unit	—	—
G2 Note 4)	2 sets of regulator unit	●	—
G3 Note 4)	3 sets of regulator unit	—	—
J□ Note 5)	With ejector unit	●	—
K Note 6)	Special wiring specifications (Except double wiring)	●	●
N	With name plate	●	●
R Note 7)	External pilot	●	●
S	Direct EXH outlet with built-in silencer	●	●

Note) Refer to page 56 for details.

- Note 1) Insert "L" (Top ported) or "B" (Bottom ported) for elbow type. Example) B6 (Bottom ported elbow with ø6 one-touch fitting)
- Note 2) Indicate "LM" for models with elbow fittings and mixed cylinder port sizes.
- Note 3) Indicate "Mixed sizes and with port plug" by means of the manifold specification sheet.
- Note 4) When selecting the mixed size for different types of piping, dual flow fitting assembly, or double check block (direct mounting), enter "MM" and give instructions in the manifold specification sheet.
- Note 5) Inch-size one-touch fittings are available. Refer to "Semi-standard" on page 57 for details.

- Note 1) When two or more symbols are specified, indicate them alphabetically. Example) -BRS
- Note 2) Models with a suffix "-B" have check valves for prevention of back pressure at all manifold stations. When a back pressure check valve is desired, and is to be installed only in certain manifold stations, specify the mounting position by means of the manifold specification sheet.
- Note 3) The number of stations that may be displayed is longer than the manifold number of stations.
- Note 4) Specify the mounting position by means of the manifold specification sheet.
- Note 5) Refer to page 69 for details on with ejector unit. A combination of "J" and "N" is not available.
- Note 6) Specify the wiring specifications by means of the manifold specification sheet.
- Note 7) Indicate "R" for the valve with external pilot.

F kit  
P kit  
J kit  
G kit  
T kit  
L kit  
S kit  
M kit  
Sub-plate Single Unit  
Semi-standard  
Construction  
Exploded View of Manifold  
Manifold Optional Parts  
Safety Instructions  
Specific Product Precautions

● **Electrical Wiring Specifications**

**Flat ribbon cable connector**

Station	Terminal no.	Polarity
Station 1	SOLA 20	(-) (+)
	SOLB 18	(-) (+)
Station 2	SOLA 16	(-) (+)
	SOLB 14	(-) (+)
Station 3	SOLA 12	(-) (+)
	SOLB 10	(-) (+)
Station 4	SOLA 8	(-) (+)
	SOLB 6	(-) (+)
Station 5	SOLA 19	(-) (+)
	SOLB 17	(-) (+)
Station 6	SOLA 15	(-) (+)
	SOLB 13	(-) (+)
Station 7	SOLA 11	(-) (+)
	SOLB 9	(-) (+)
Station 8	SOLA 7	(-) (+)
	SOLB 5	(-) (+)
	COM. 2	(+) (-)
	COM. 1	(+) (-)

Positive COM spec.      Positive COM spec. <sup>Note)</sup>

As the standard electrical wiring specifications, double wiring (connected to SOL. A and SOL. B) is adopted for the internal wiring of each station for 8 stations or less, regardless of valve and option types. Mixed single and double wiring is available as semi-standard. Refer to "Semi-standard" on page 56 for details.

Note) When using the negative common specifications, use valves for negative common. (Refer to page 56.) Refer to "Semi-standard" on page 56 for details.

**How to Order Valves**

**VQ 1 1 0 0** - **5** - **1** - **CE compliant**

**Series**

1	VQ1000
2	VQ2000

**Type of actuation**

1	2-position single
2	2-position double
3	3-position closed center
4	3-position exhaust center
5	3-position pressure center
A	4-position dual port (N.C. +N.C.)
B	4-position dual port (N.O. +N.O.)
C	4-position dual port (N.C. +N.O.)

**Seal**

0	Metal seal
1	Rubber seal

**Function**

Symbol	Specifications	DC
Nil	Standard	(0.4 W) ○
B	High-speed response type	(0.95 W) ○
K <sup>Note 1)</sup>	High-pressure type (1.0 MPa)	(0.95 W) ○
N <sup>Note 2)</sup>	Negative common	○
R <sup>Note 2)</sup>	External pilot	○

**Manual override**

Nil	Non-locking push type (Tool required)
B	Locking type (Tool required)
C	Locking type (Manual)
D	Slide locking type (Manual)

**Light/surge voltage suppressor**

Nil	Yes
E	None

**Coil voltage**

5	24 VDC
---	--------

Note 1) Metal seal only  
Note 2) Refer to "Semi-standard" on pages 56 to 57 for external pilot and negative common specifications.  
Note 3) When two or more symbols are specified, indicate them alphabetically. Combination of [B] and [K] is not possible.


**How to Order Manifold Assembly**

Specify the part numbers for valves and options together beneath the manifold base part number.

**<Example>**  
Flat ribbon cable kit with cable (3 m)  
VV5Q11-08C6JU2 ...1 set-Manifold base part no.  
\*VQ1100-51 .....2 sets-Valve part no. (Stations 1 to 2)  
\*VQ1200-51 .....4 sets-Valve part no. (Stations 3 to 6)  
\*VQ1300-51 .....1 set-Valve part no. (Station 7)  
\*VVQ1000-10A-1 .....1 set-Blanking plate part no. (Station 8)

Write sequentially from the 1st station on the D-side. When part nos. written collectively are complicated, specify them by means of the manifold specification sheet.

Prefix the asterisk to the part nos. of the solenoid valve, etc.


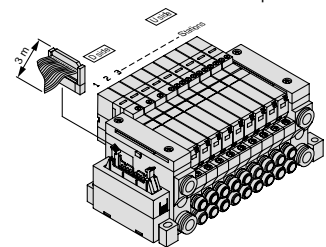


# J Series VQ1000/2000 kit (Flat ribbon cable)

## VV5Q11

The dashed lines indicate the DIN rail mounting [-D] and the side entry connection [-JS].

Applicable connector: Flat ribbon cable connector (20P)  
(Complies with MIL-C-83503)

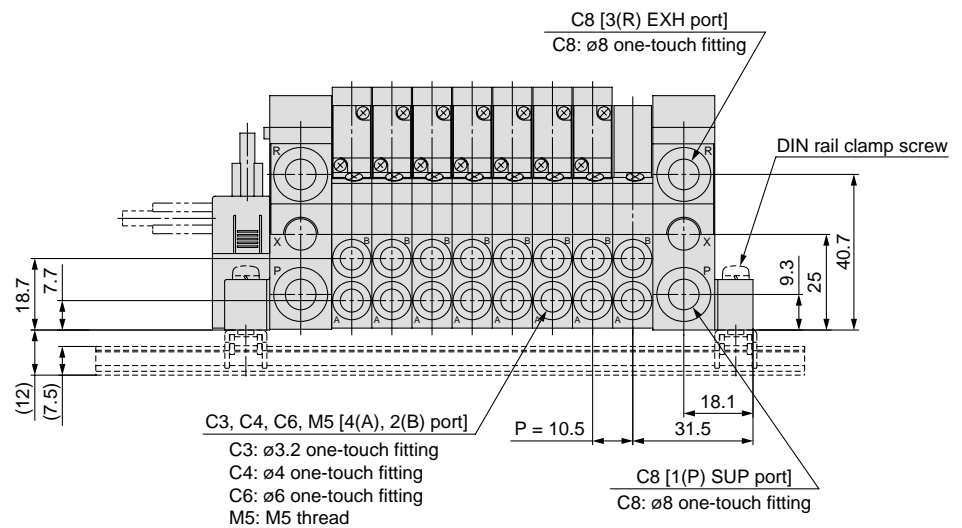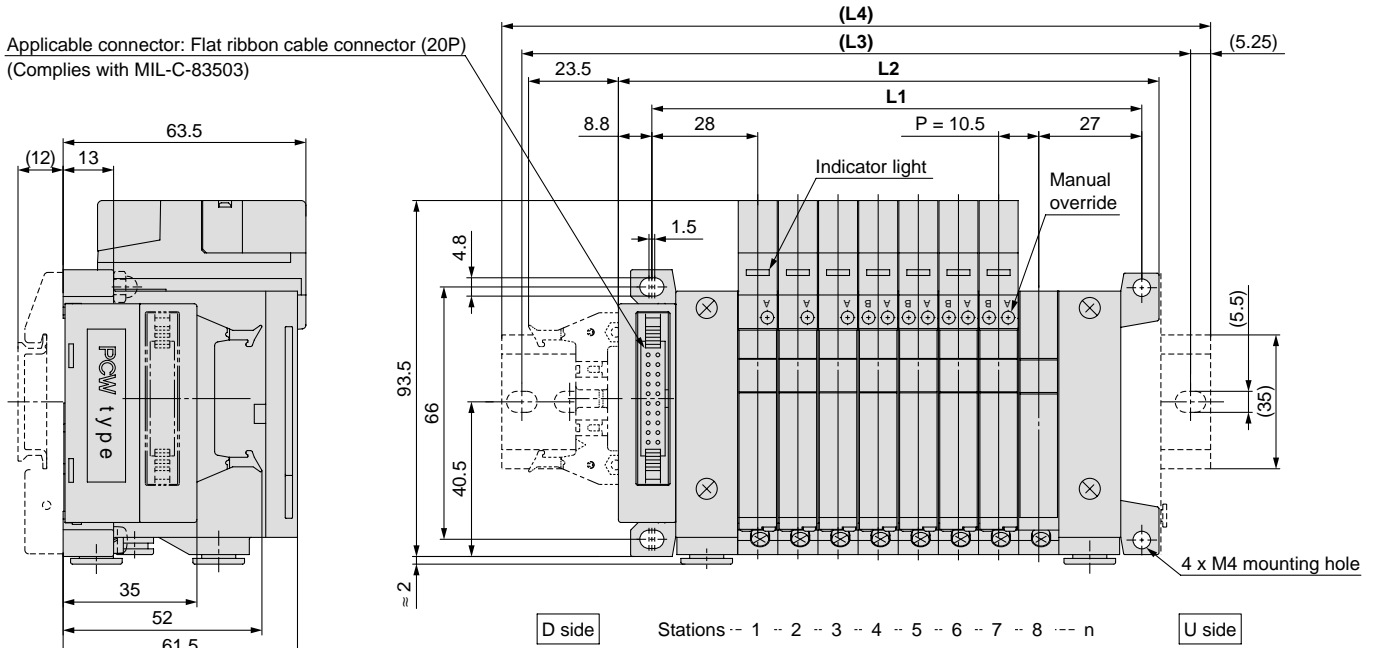

### Dimensions

Formula L1 = 10.5n + 44.5, L2 = 10.5n + 57.5 n: Station (Maximum 16 stations)


L \ n	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16
L1	65.5	76	86.5	97	107.5	118	128.5	139	149.5	160	170.5	181	191.5	202	212.5
L2	78.5	89	99.5	110	120.5	131	141.5	152	162.5	173	183.5	194	204.5	215	225.5
(L3)	112.5	125	125	137.5	150	162.5	175	187.5	187.5	200	212.5	225	225	237.5	250
(L4)	123	135.5	135.5	148	160.5	173	185.5	198	198	210.5	223	235.5	235.5	248	260.5

With ejector unit: Formula L1 = 10.5n + 28.7 + (Number of ejector units x 26.7)  
L2 = 10.5n + 41.3 + (Number of ejector units x 26.7)  
L4 is L2 plus about 30.


# VV5Q21

The dashed lines indicate the DIN rail mounting [-D] and the side entry connection [-JS].

Applicable connector: Flat ribbon cable connector (20P)  
(Complies with MIL-C-83503)

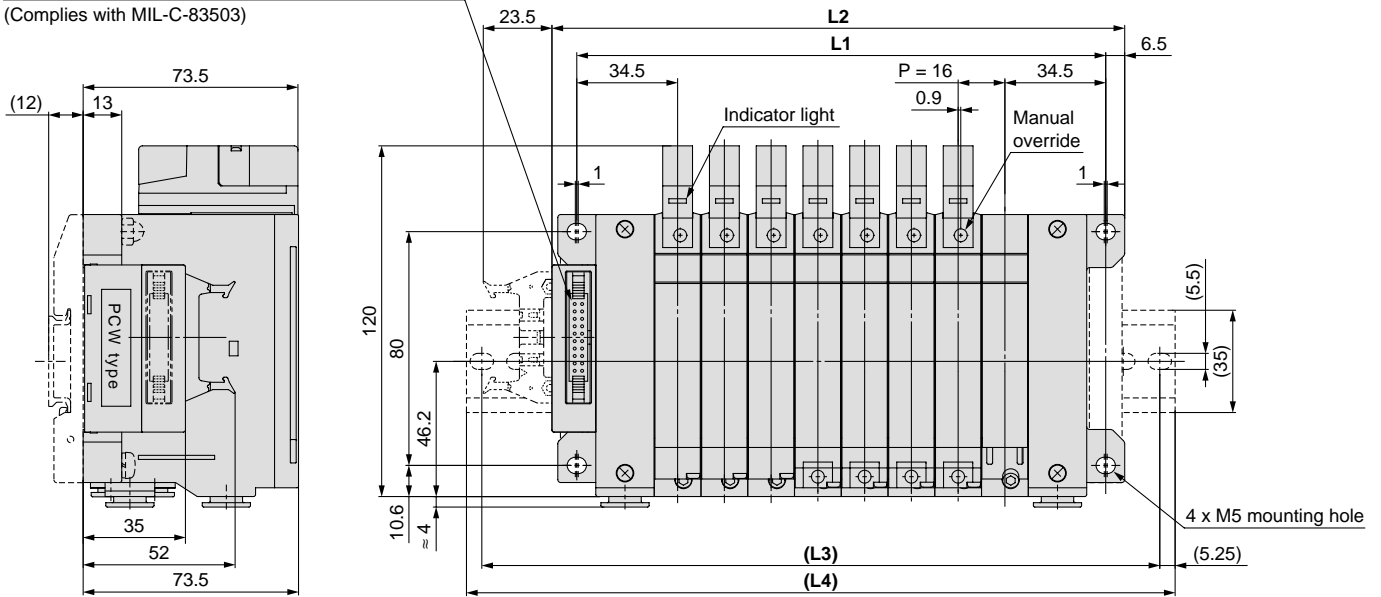

D side Stations --- 1 --- 2 --- 3 --- 4 --- 5 --- 6 --- 7 --- 8 --- n U side

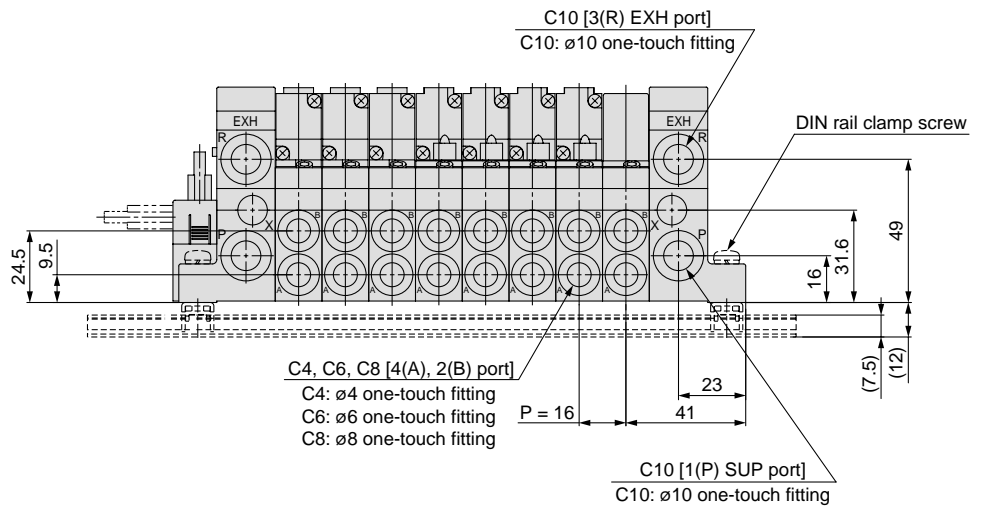

## Dimensions


Formula  $L1 = 16n + 53$ ,  $L2 = 16n + 68$  n: Station (Maximum 16 stations)

L \ n	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16
<b>L1</b>	85	101	117	133	149	165	181	197	213	229	245	261	277	293	309
<b>L2</b>	100	116	132	148	164	180	196	212	228	244	260	276	292	308	324
<b>(L3)</b>	125	150	162.5	175	187.5	212.5	225	237.5	262.5	275	287.5	300	312.5	337.5	350
<b>(L4)</b>	135.5	160.5	173	185.5	198	223	235.5	248	273	285.5	298	310.5	323	348	360.5

F kit  
P kit  
J kit  
G kit  
T kit  
L kit  
S kit  
M kit  
Sub-plate Single Unit  
Semi-standard  
Construction  
Exploded View of Manifold  
Manifold Optional Parts  
Safety Instructions  
Specific Product Precautions



# Series VQ1000/2000 kit (Flat ribbon cable with terminal block)

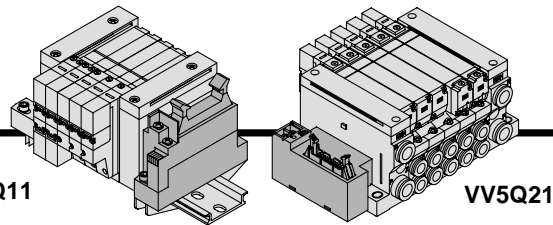

- Terminal block for power supply equipped with a 20 pins flat ribbon cable connection for rationalized connection of valves.
- Solenoid valves and power supply can be connected by the same cable to a specific output unit that requires power supply from the output section to the internal circuit.
- Maximum stations are 16.

## Manifold Specifications


Series	Piping specifications		Applicable stations
	Piping direction	Port size	
VQ1000	Side	1(P), 3(R) / 4(A), 2(B)	Max. 16 stations
VQ2000	Side	C8 / C4, C6, C8	Max. 16 stations

## Flat Ribbon Cable (20 Pins)

### Cable Assembly

AXT100-FC20-<sup>1</sup>/<sub>2</sub>/<sub>3</sub>

(Flat ribbon cable connector assembly can be ordered individually or included in a specific manifold model no. Refer to "How to Order Manifold.")

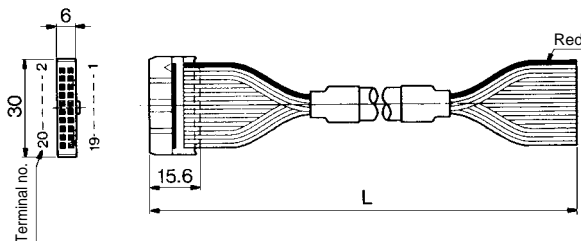

### Flat Ribbon Cable Connector Assembly



Cable length (L)	Assembly part no.	Note
1.5 m	AXT100-FC20-1	Cable 20 cores x 28AWG
3 m	AXT100-FC20-2	
5 m	AXT100-FC20-3	

- \* For other commercial connectors, use a 20 pins type with strain relief conforming to MIL-C-83503.
- \* Cannot be used for transfer wiring.


### Connector manufacturers' example

- Hirose Electric Co., Ltd.
- Sumitomo 3M Limited
- Japan Aviation Electronics Industry, Ltd.
- J.S.T. Mfg. Co., Ltd.
- Oki Electric Cable Co., Ltd.
- Fujitsu Limited

Note) Lengths other than the above are also available. Please contact SMC for details.

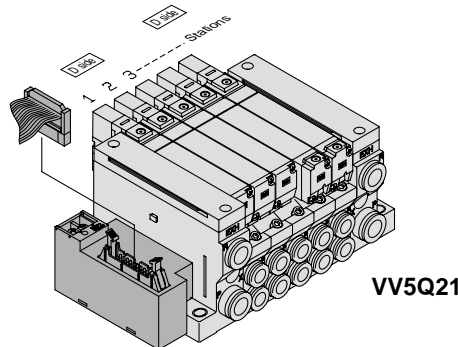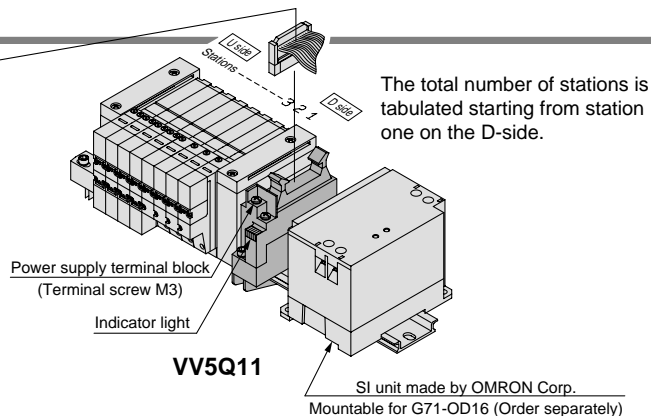

## How to Order Manifold

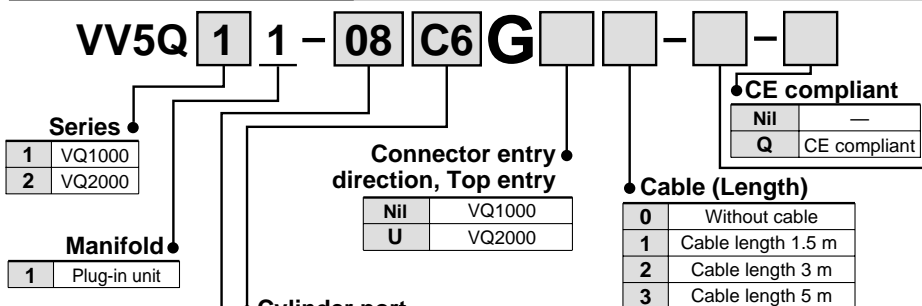

Stations	Symbol	Port size	VQ1000	VQ2000
02	C3	With ø3.2 one-touch fitting	●	—
⋮	C4	With ø4 one-touch fitting	●	●
⋮	C6	With ø6 one-touch fitting	●	●
16 (Note)	C8	With ø8 one-touch fitting	—	●
	M5	M5 thread	●	—
	CM (Note 3)	Mixed sizes and with port plug	●	●
	MM (Note 4)	Mixed size for different types of piping, option installed	●	●

Note) Refer to page 56 for details.



Note 1) Insert "L" (Top ported) or "B" (Bottom ported) for elbow type. Example) B6 (Bottom ported elbow with ø6 one-touch fitting)

Note 2) Indicate "LM" for models with elbow fittings and mixed cylinder port sizes.

Note 3) Indicate "Mixed sizes and with port plug" by means of the manifold specification sheet.

Note 4) When selecting the mixed size for different types of piping, dual flow fitting assembly, or double check block (direct mounting), enter "MM" and give instructions in the manifold specification sheet.

Note 5) Inch-size one-touch fittings are available. Refer to "Semi-standard" on page 57 for details.

### Option

Symbol	Option	VQ1000	VQ2000
Nil	None	●	●
B (Note 2)	With back pressure check valve	●	●
D	DIN rail mounting	●	●
D0	With DIN rail bracket (Without DIN rail)	●	●
D□ (Note 3)	DIN rail length specified (□: Stations 02 to 24)	●	●
G1 (Note 4)	1 set of regulator unit	—	—
G2 (Note 4)	2 sets of regulator unit	●	—
G3 (Note 4)	3 sets of regulator unit	—	—
J□ (Note 5)	With ejector unit	●	—
K (Note 6)	Special wiring specifications (Except double wiring)	●	●
N	With name plate	●	●
R (Note 7)	External pilot	●	●
S	Direct EXH outlet with built-in silencer	●	●



Note 1) When two or more symbols are specified, indicate them alphabetically. Example) -BRS

Note 2) Models with a suffix "B" have check valves for prevention of back pressure at all manifold stations. When a back pressure check valve is desired, and is to be installed only in certain manifold stations, specify the mounting position by means of the manifold specification sheet.

Note 3) The number of stations that may be displayed is longer than the manifold number of stations.

Note 4) Specify the mounting position by means of the manifold specification sheet.

Note 5) Refer to page 69 for details on with ejector unit. A combination of "J" and "N" is not available.

Note 6) Specify the wiring specifications by means of the manifold specification sheet.

Note 7) Indicate "R" for the valve with external pilot.

F kit

P kit

J kit

G kit

T kit

L kit

S kit

M kit

Sub-plate  
Single Unit

Semi-  
standard

Construction

Exploded  
View of  
Manifold

Manifold  
Optional Parts


Safety  
Instructions

Specific  
Product  
Precautions

● Connector Assembly


Electric circuit diagram (Below wiring is the case of all double solenoid connections.)

Flat ribbon cable connector



Connector terminal no.

Triangle mark indicator position

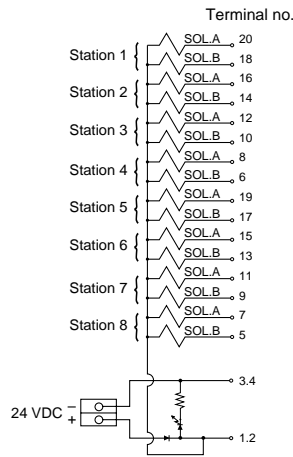

As the standard electrical wiring specifications, double wiring (connected to SOL. A and SOL. B) is adopted for the internal wiring of each station for 8 stations or less, regardless of valve and option types. Mixed single and double wiring is available as semi-standard. Refer to page 56 for details.

How to Order Valves

**VQ 1 1 0 0 - 5 1 -**

**Series**

1	VQ1000
2	VQ2000

**Seal**

0	Metal seal
1	Rubber seal

**CE compliant**

Nil	—
Q	CE compliant

**Manual override**

Nil	Non-locking push type (Tool required)
B	Locking type (Tool required)
C	Locking type (Manual)
D	Slide locking type (Manual)

**Coil voltage**

5	24 VDC
---	--------

**Light/surge voltage suppressor**

Nil	Yes
E	None

**Function**

Symbol	Specifications	DC
Nil	Standard	(0.4 W)
B	High-speed response type	(0.95 W)
K Note 1)	High-pressure type (1.0 MPa)	(0.95 W)
R Note 2)	External pilot	

**Type of actuation**

1	2-position single
2	2-position double
3	3-position closed center
4	3-position exhaust center
5	3-position pressure center
A	4-position dual port (N.C. +N.C.)
B	4-position dual port (N.O. +N.O.)
C	4-position dual port (N.C. +N.O.)

Note 1) Metal seal only  
Note 2) Refer to "Semi-standard" on page 57 for external pilot specifications.  
Note 3) When two or more symbols are specified, indicate them alphabetically. Combination of [B] and [K] is not possible.

How to Order Manifold Assembly

Specify the part numbers for valves and options together beneath the manifold base part number.


<Example>

Flat ribbon cable kit with terminal block with cable (3 m)

- VV5Q11-08C6G2 ...1 set—Manifold base part no.
- \*VQ1100-51 ...4 sets—Valve part no. (Stations 1 to 4)
- \*VQ1200-51 ...1 set—Valve part no. (Station 5)
- \*VQ1300-51 ...3 sets—Valve part no. (Stations 6 to 8)

Prefix the asterisk to the part nos. of the solenoid valve, etc.

Write sequentially from the 1st station on the D-side. When part nos. written collectively are complicated, specify them by means of the manifold specification sheet.







# Series VQ1000/2000 kit (Flat ribbon cable with terminal block)

## VV5Q11

The dashed lines and dimensions in parentheses indicate DIN rail mounting [-D].

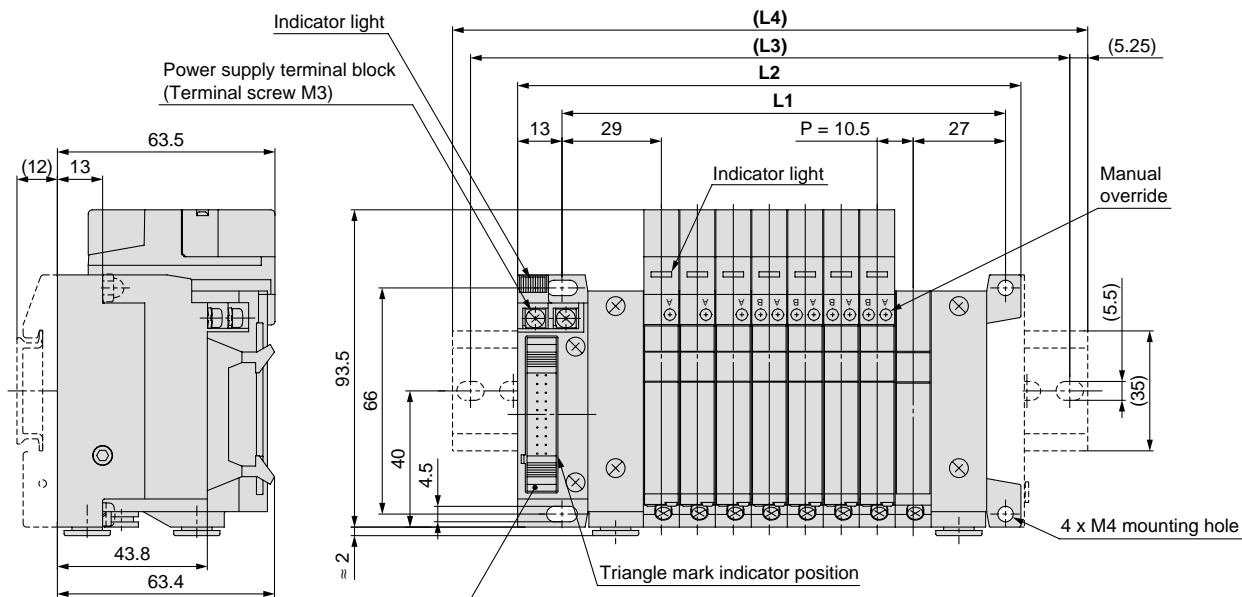

Applicable connector: Flat ribbon cable connector (20P)  
(Complies with MIL-C-83503)

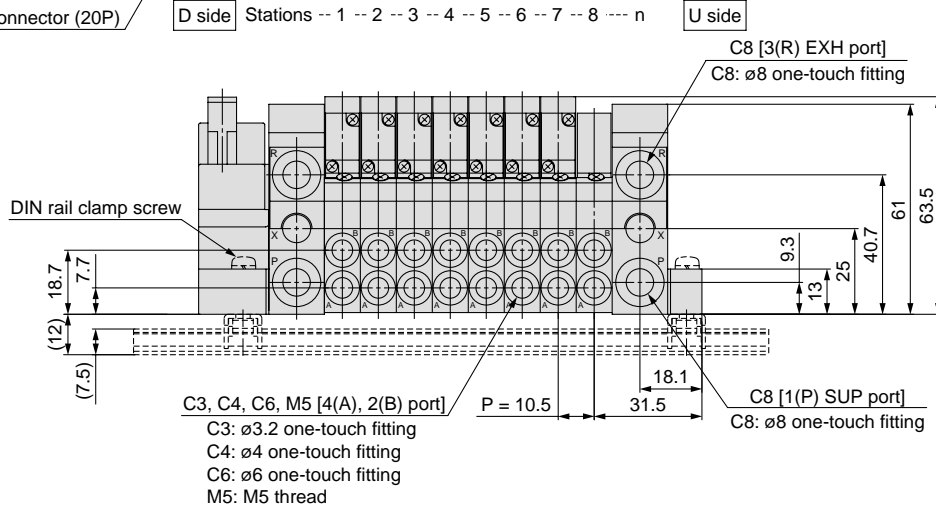

### Dimensions

Formula  $L1 = 10.5n + 45.5$ ,  $L2 = 10.5n + 63$  n: Station (Maximum 16 stations)


L \ n	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16
<b>L1</b>	66.5	77	87.5	98	108.5	119	129.5	140	150.5	161	171.5	182	192.5	203	213.5
<b>L2</b>	84	94.5	105	115.5	126	136.5	147	157.5	168	178.5	189	199.5	210	220.5	231
<b>(L3)</b>	112.5	125	125	137.5	150	162.5	175	187.5	187.5	200	212.5	225	237.5	250	262.5
<b>(L4)</b>	123	135.5	135.5	148	160.5	173	185.5	198	198	210.5	223	235.5	248	260.5	273

With ejector unit: Formula  $L1 = 10.5n + 29.7 + (\text{Number of ejector units} \times 26.7)$   
 $L2 = 10.5n + 46.8 + (\text{Number of ejector units} \times 26.7)$   
 L4 is L2 plus about 30.




# VV5Q21

The dashed lines indicate DIN rail mounting [-D] (with DIN rail mounting bracket).

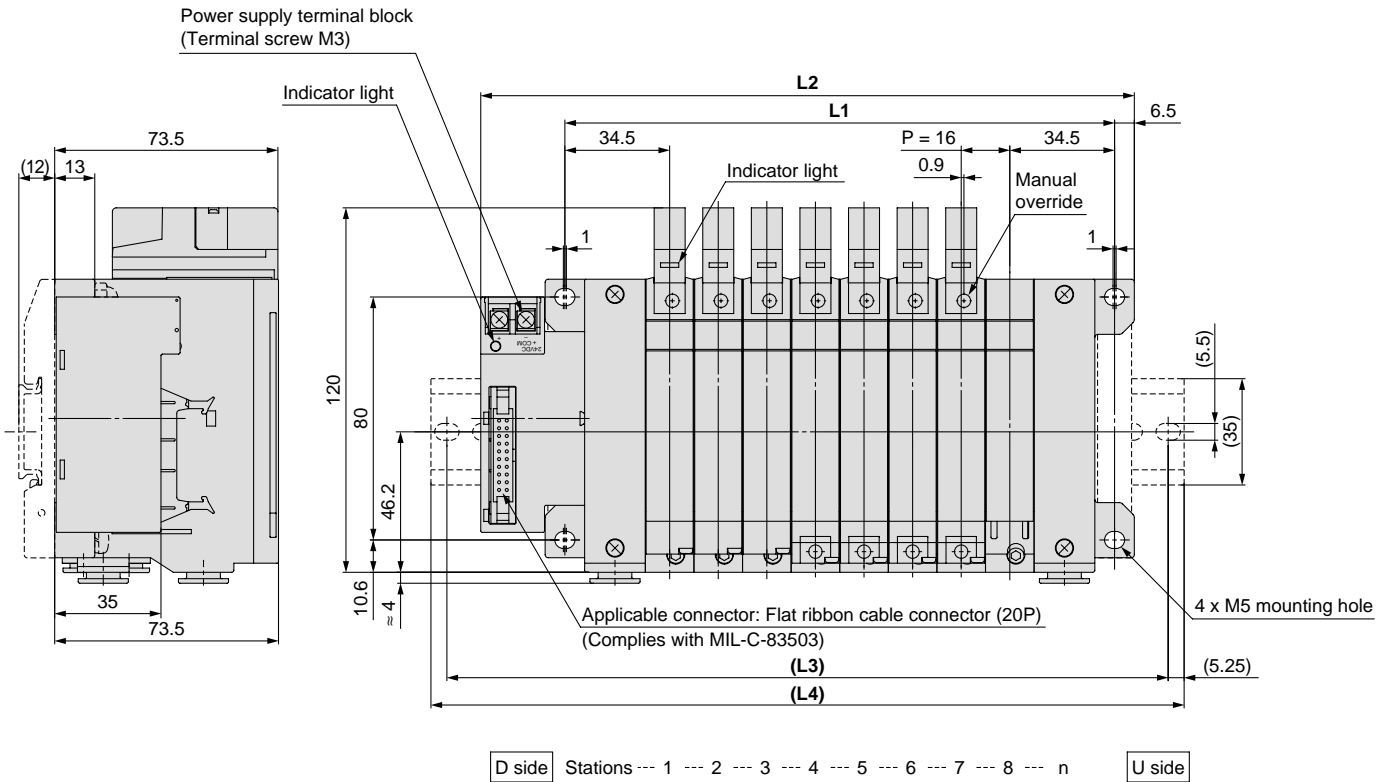

Flat ribbon cable connector assembly (20P)  
 AXT100-FC20-1: 1.5 m  
 AXT100-FC20-2: 3 m  
 AXT100-FC20-3: 5 m

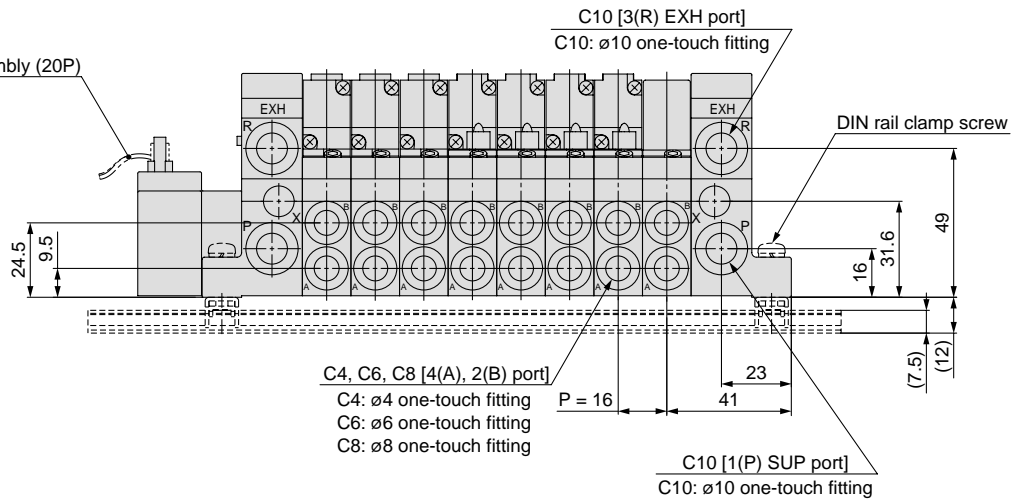

## Dimensions

Formula  $L1 = 16n + 53$ ,  $L2 = 16n + 87$  n: Station (Maximum 16 stations)

L \ n	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16
<b>L1</b>	85	101	117	133	149	165	181	197	213	229	245	261	277	293	309
<b>L2</b>	119	135	151	167	183	199	215	231	247	263	279	295	311	327	343
<b>(L3)</b>	150	162.5	175	187.5	212.5	225	237.5	262.5	275	287.5	300	325	337.5	350	362.5
<b>(L4)</b>	160.5	173	185.5	198	223	235.5	248	273	285.5	298	310.5	335.5	348	360.5	373



F kit  
 P kit  
 J kit  
**G kit**  
 T kit  
 L kit  
 S kit  
 M kit  
 Sub-plate Single Unit  
 Semi-standard  
 Construction  
 Exploded View of Manifold  
 Manifold Optional Parts  
 Safety Instructions  
 Specific Product Precautions

# T Series VQ1000/2000 kit (Terminal block box)

IP65 compliant

- This kit has a small terminal block inside a junction box. The electrical entry port {VQ1000: G 1/2, VQ2000: G 3/4} permits connection of conduit fittings.
- Maximum stations: 24 (VQ1000), 20 (VQ2000)
- Enclosure: Dust-tight, Water-jet-proof (IP65) compatible (Series VQ2000)

VV5Q11

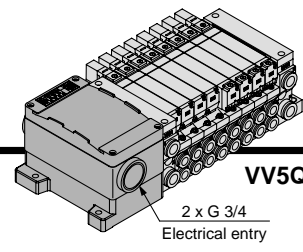

VV5Q21

## Manifold Specifications

Series	Piping specifications			Applicable stations
	Piping direction	Port size		
VQ1000	Side	1(P), 3(R)	4(A), 2(B)	Max. 24 stations
VQ2000	Side	C10	C4,C6,C8	Max. 20 stations


## Terminal Block Connection (VQ1000)

Open the terminal block cover to connect the wires to the terminal block.

**Step 1. Removing the terminal block cover**  
Loosen the screws on the terminal block cover and open it in the direction shown by the arrow. The cover can then be removed from the terminal block.

**Step 2. Wiring**  
The diagram on the left shows the terminal block wiring schematic. All stations are provided with double solenoid wiring. Insert each lead wire into the terminal opening and tighten the screw directly above.  
How to connect is inserting the lead wire into the terminal window, then tighten the screw on top. (Tightening torque: 0.25 to 0.35 N·m)

**Step 3. Mounting the terminal block cover**  
Hook groove (a) on shaft (b) and close the cover. Then tighten the screws.

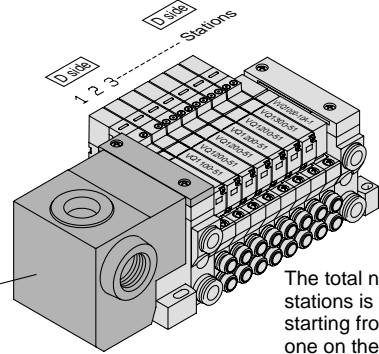

The total number of stations is tabulated starting from station one on the D-side.

## Electrical Wiring Specifications: VQ1000

Terminal no. Polarity

Station	Terminal	Polarity
Station 1	SOLA 1A	(-)
	SOLB 1B	(+)
Station 2	SOLA 2A	(-)
	SOLB 2B	(+)
Station 3	SOLA 3A	(-)
	SOLB 3B	(+)
Station 4	SOLA 4A	(-)
	SOLB 4B	(+)
Station 5	SOLA 5A	(-)
	SOLB 5B	(+)
Station 6	SOLA 6A	(-)
	SOLB 6B	(+)
Station 7	SOLA 7A	(-)
	SOLB 7B	(+)
Station 8	SOLA 8A	(-)
	SOLB 8B	(+)
Station 9	SOLA 9A	(-)
	SOLB 9B	(+)
Station 10	SOLA 10A	(-)
	SOLB 10B	(+)
Station 11	SOLA 11A	(-)
	SOLB 11B	(+)
Station 12	SOLA 12A	(-)
	SOLB 12B	(+)
COM.		(+)
COM.		(-)

1st row - 2nd row - 3rd row  
The quantity of terminal blocks used depends on the number of manifold stations:

Manifold	Terminal block
2 to 8 stations	2 rows
9 to 12 stations	3 rows

As the standard electrical wiring specifications, double wiring (connected to SOL. A and SOL. B) is adopted for the internal wiring of each station for 12 stations or less, regardless of valve and option types. Mixed single and double wiring is available as semi-standard. Refer to page 56 for details.

Note) When using the negative common specifications, use valves for negative common. Refer to "Semi-standard" on page 56 for details.

Positive COM spec. Negative COM spec.

## How to Order Manifold

VV5Q 1 1 - 08 C6 T 0 - - -

**Series**

1	VQ1000
2	VQ2000

**Manifold**

1	Plug-in unit
---	--------------

**Stations**

02	2 stations
⋮	⋮
24 (Note 1)	24 stations

**Cylinder port**

Symbol	Port size	VQ1000	VQ2000
C3	With ø3.2 one-touch fitting	●	—
C4	With ø4 one-touch fitting	●	●
C6	With ø6 one-touch fitting	●	●
C8	With ø8 one-touch fitting	—	●
M5	M5 thread	●	—
CM (Note 3)	Mixed sizes and with port plug	●	●
MM (Note 4)	Mixed size for different types of piping, option installed	●	●

**CE compliant**

Nil	—
Q	CE compliant

\* DC specification only

Note 1) VQ2000: Max. 20 stations  
Note 2) Refer to page 56 for details.

Note) For negative common specifications, refer to "Semi-standard" on page 56.

Note 1) Insert "L" (Top ported) or "B" (Bottom ported) for elbow type.  
Example B6 (Bottom ported elbow with ø6 one-touch fitting)

Note 2) Indicate "LM" for models with elbow fittings and mixed cylinder port sizes.

Note 3) Indicate "Mixed sizes and with port plug" by means of the manifold specification sheet.  
Note 4) When selecting the mixed size for different types of piping, dual flow fitting assembly, or double check block (direct mounting), enter "MM" and give instructions in the manifold specification sheet.

Note 5) Inch-size one-touch fittings are available. Refer to "Semi-standard" on page 57 for details.

## Option

Symbol	Option	VQ1000	VQ2000
Nil	None	●	●
B (Note 2)	With back pressure check valve	●	●
D	DIN rail mounting	●	●
D0	With DIN rail bracket (Without DIN rail)	●	●
D□ (Note 6)	DIN rail length specified (□: Stations 02 to 24)	●	●
G1 (Note 4)	1 set of regulator unit	●	—
G2 (Note 4)	2 sets of regulator unit	●	—
G3 (Note 4)	3 sets of regulator unit	●	—
J (Note 5)	With ejector unit	●	—
K (Note 6)	Special wiring spec. (Except double wiring)	●	●
N	With name plate	●	●
R (Note 7)	External pilot	●	●
S	Direct EXH outlet with built-in silencer	●	●
W	Enclosure: Dust-tight, Water-jet-proof (IP65)	—	●

Note 1) When two or more symbols are specified, indicate them alphabetically. Example -BRS

Note 2) Models with a suffix "B" have check valves for prevention of back pressure at all manifold stations. When a back pressure check valve is desired, and is to be installed only in certain manifold stations, specify the mounting position by means of the manifold specification sheet.

Note 3) The number of stations that may be displayed is longer than the manifold number of stations.

Note 4) Specify the mounting position by means of the manifold specification sheet. Note 5) Refer to page 69 for details on with ejector unit. A combination of "J" and "N" is not available.

Note 6) Specify the wiring specifications by means of the manifold specification sheet. Note 7) Indicate "R" for the valve with external pilot.

• Terminal Block Wiring (VQ2000)

Open the terminal block cover to connect the wires to the terminal block.



**Step 1. Removing the terminal block cover**

Loosen mounting screws (4 pcs.) on the terminal block cover and remove the cover.

**Step 2. Wiring**

Loosen screws on the terminal block, connect wiring and complete it by tightening screws. (Tightening torque: 0.5 to 0.7 N·m)

The diagram on the right shows the terminal block wiring. All stations are provided with double wiring regardless of the valves which are mounted.

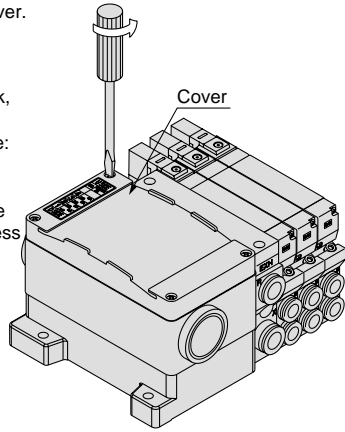


**Step 3. Mounting the terminal block cover**

Securely tighten the screws after confirming that the gasket is installed correctly. (Tightening torque: 0.7 to 1.2 N·m)

Applicable crimped terminal:  
1.25-3S, 1.25Y-3,  
1.25Y-3N, 1.25Y-3.5

• Special Wiring Specifications: VQ2000

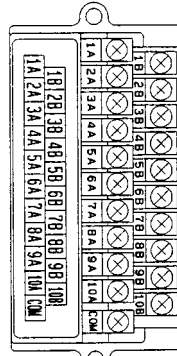

	Terminal no.	Polarity
Station 1	SOL.A 1A	(-) (+)
	SOL.B 1B	(-) (+)
Station 2	SOL.A 2A	(-) (+)
	SOL.B 2B	(-) (+)
Station 3	SOL.A 3A	(-) (+)
	SOL.B 3B	(-) (+)
Station 4	SOL.A 4A	(-) (+)
	SOL.B 4B	(-) (+)
Station 5	SOL.A 5A	(-) (+)
	SOL.B 5B	(-) (+)
Station 6	SOL.A 6A	(-) (+)
	SOL.B 6B	(-) (+)
Station 7	SOL.A 7A	(-) (+)
	SOL.B 7B	(-) (+)
Station 8	SOL.A 8A	(-) (+)
	SOL.B 8B	(-) (+)
Station 9	SOL.A 9A	(-) (+)
	SOL.B 9B	(-) (+)
Station 10	SOL.A 10A	(-) (+)
	SOL.B 10B	(-) (+)
	COM.	(+) (-)


As the standard electrical wiring specifications, double wiring (connected to SOL. A and SOL. B) is adopted for the internal wiring of each station for 10 stations or less, regardless of valve and option types.

Mixed single and double wiring is available as semi-standard. Refer to page 56 for details.

Note) When using the negative common specifications, use valves for negative common.

Refer to "Semi-standard" on page 56 for details.

**How to Order Valves**



**Series**

1	VQ1000
2	VQ2000

**Type of actuation**

1	2-position single
2	2-position double
3	3-position closed center
4	3-position exhaust center
5	3-position pressure center
A	4-position dual port (N.C. +N.C.)
B	4-position dual port (N.O. +N.O.)
C	4-position dual port (N.C. +N.O.)

**Seal**

0	Metal seal
1	Rubber seal

**CE compliant**

Nil	—
Q	CE compliant

\* DC specification only

**Enclosure**

Nil	Dust-protected
W Note)	Dust-tight, Water-jet-proof (IP65)

Note) VQ2000 only

**Manual override**

Nil	Non-locking push type (Tool required)
B	Locking type (Tool required)
C	Locking type (Manual)
D	Slide locking type (Manual)

**Light/surge voltage suppressor**

Nil	Yes
E	None

**Coil voltage**

1	100 VAC (50/60 Hz)
3	110 VAC (50/60 Hz)
5	24 VDC
6	12 VDC

**Function**

Symbol	Specifications	DC	AC
Nil	Standard	(0.4 W) ○	Note 1) ○
B	High-speed response type	(0.95 W) ○	—
K Note 2)	High-pressure type (1.0 MPa)	(0.95 W) ○	—
N Note 3)	Negative common	○	—
R Note 3)	External pilot	○	○

Note 1) Refer to page 16 for power consumption of AC type.  
 Note 2) Metal seal only  
 Note 3) Refer to "Semi-standard" on pages 56 to 57 for external pilot and negative common specifications.  
 Note 4) When two or more symbols are specified, indicate them alphabetically. Combination of [B] and [K] is not possible.


**Caution**  
 Use the standard (DC) specification when continuously energizing for long periods of time.

**How to Order Manifold Assembly**

Specify the part numbers for valves and options together beneath the manifold base part number.

**<Example>**  
 Terminal block box kit  
**VV5Q11-08C6T0 ...1 set—Manifold base part no.**  
 \*VQ1100-51 ...2 sets—Valve part no. (Stations 1 to 2)  
 \*VQ1200-51 ...4 sets—Valve part no. (Stations 3 to 6)  
 \*VQ1300-51 ...1 set—Valve part no. (Station 7)  
 \*VVQ1000-10A-1 ...1 set—Blanking plate part no. (Station 8)

Prefix the asterisk to the part nos. of the solenoid valve, etc.  
 Write sequentially from the 1st station on the D-side. When part nos. written collectively are complicated, specify them by means of the manifold specification sheet.




F kit  
 P kit  
 J kit  
 G kit  
 T kit  
 L kit  
 S kit  
 M kit  
 Sub-plate Single Unit  
 Semi-standard  
 Construction  
 Exploded View of Manifold  
 Manifold Optional Parts  
 Safety Instructions  
 Specific Product Precautions

# T Series VQ1000/2000 kit (Terminal block box)

## VV5Q11

< >: AC  
The dashed lines and dimensions in parentheses indicate DIN rail mounting [-D].

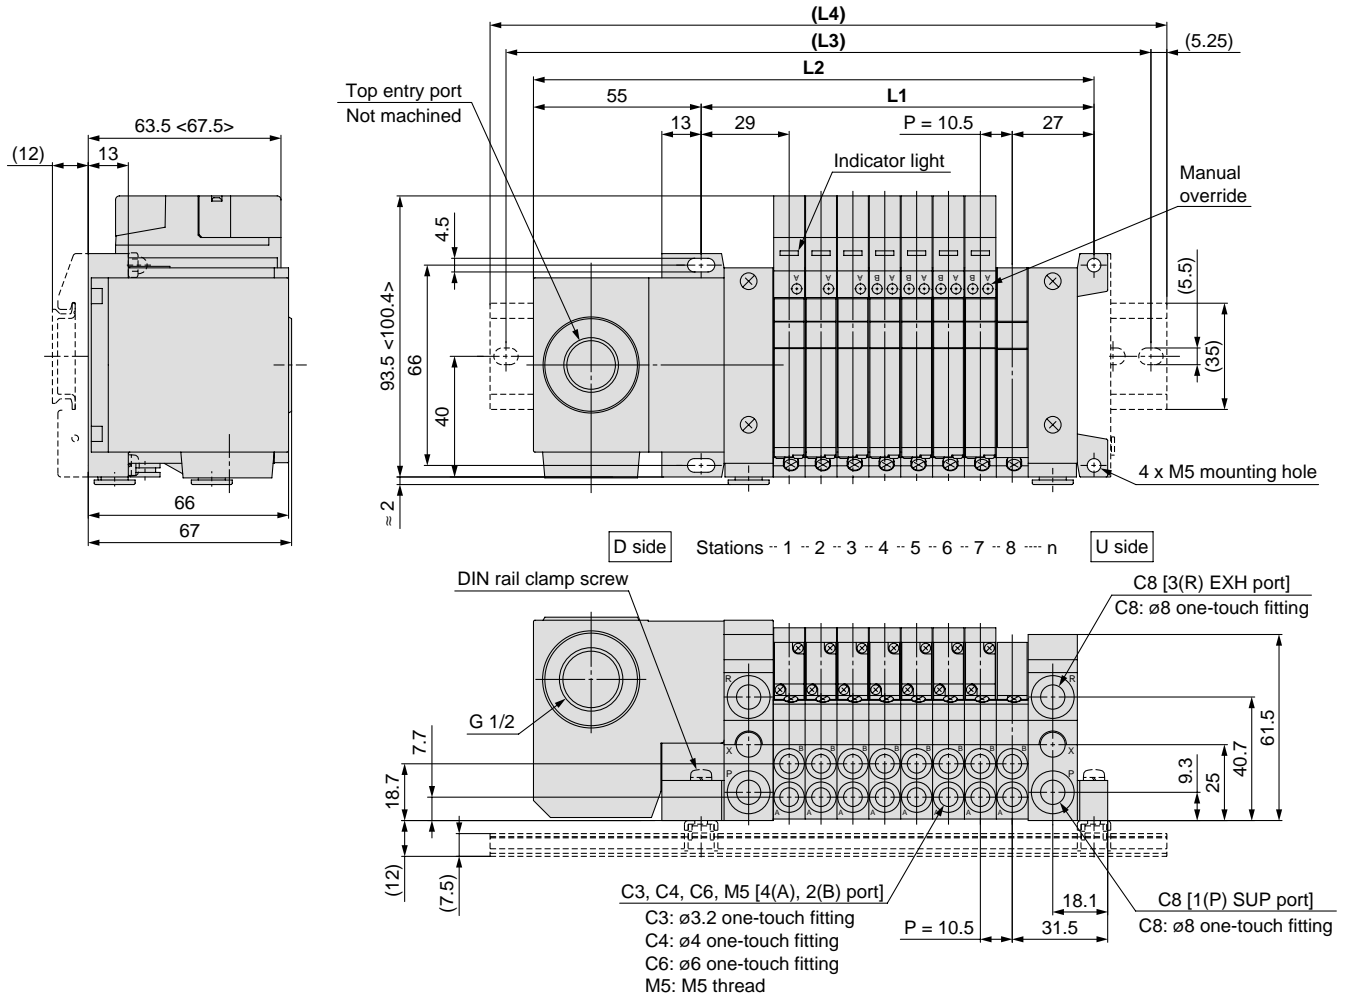

### Dimensions

Formula L1 = 10.5n + 45.5, L2 = 10.5n + 105 n: Station (Maximum 24 stations)


L \ n	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24
<b>L1</b>	66.5	77	87.5	98	108.5	119	129.5	140	150.5	161	171.5	182	192.5	203	213.5	224	234.5	245	255.5	266	276.5	287	297.5
<b>L2</b>	126	136.5	147	157.5	168	178.5	189	199.5	210	220.5	231	241.5	252	262.5	273	283.5	294	304.5	315	325.5	336	346.5	357
<b>(L3)</b>	150	162.5	175	187.5	187.5	200	212.5	225	237.5	250	262.5	262.5	275	287.5	300	312.5	325	325	337.5	350	362.5	375	387.5
<b>(L4)</b>	160.5	173	185.5	198	198	210.5	223	235.5	248	260.5	273	273	285.5	298	310.5	323	335.5	335.5	348	360.5	373	385.5	398

With ejector unit: Formula L1 = 10.5n + 29.7 + (Number of ejector units x 26.7)  
L2 = 10.5n + 88.8 + (Number of ejector units x 26.7)  
L4 is L2 plus about 30.

# VV5Q21

<>: AC

The dashed lines indicate DIN rail mounting [-D] (with DIN rail mounting bracket).

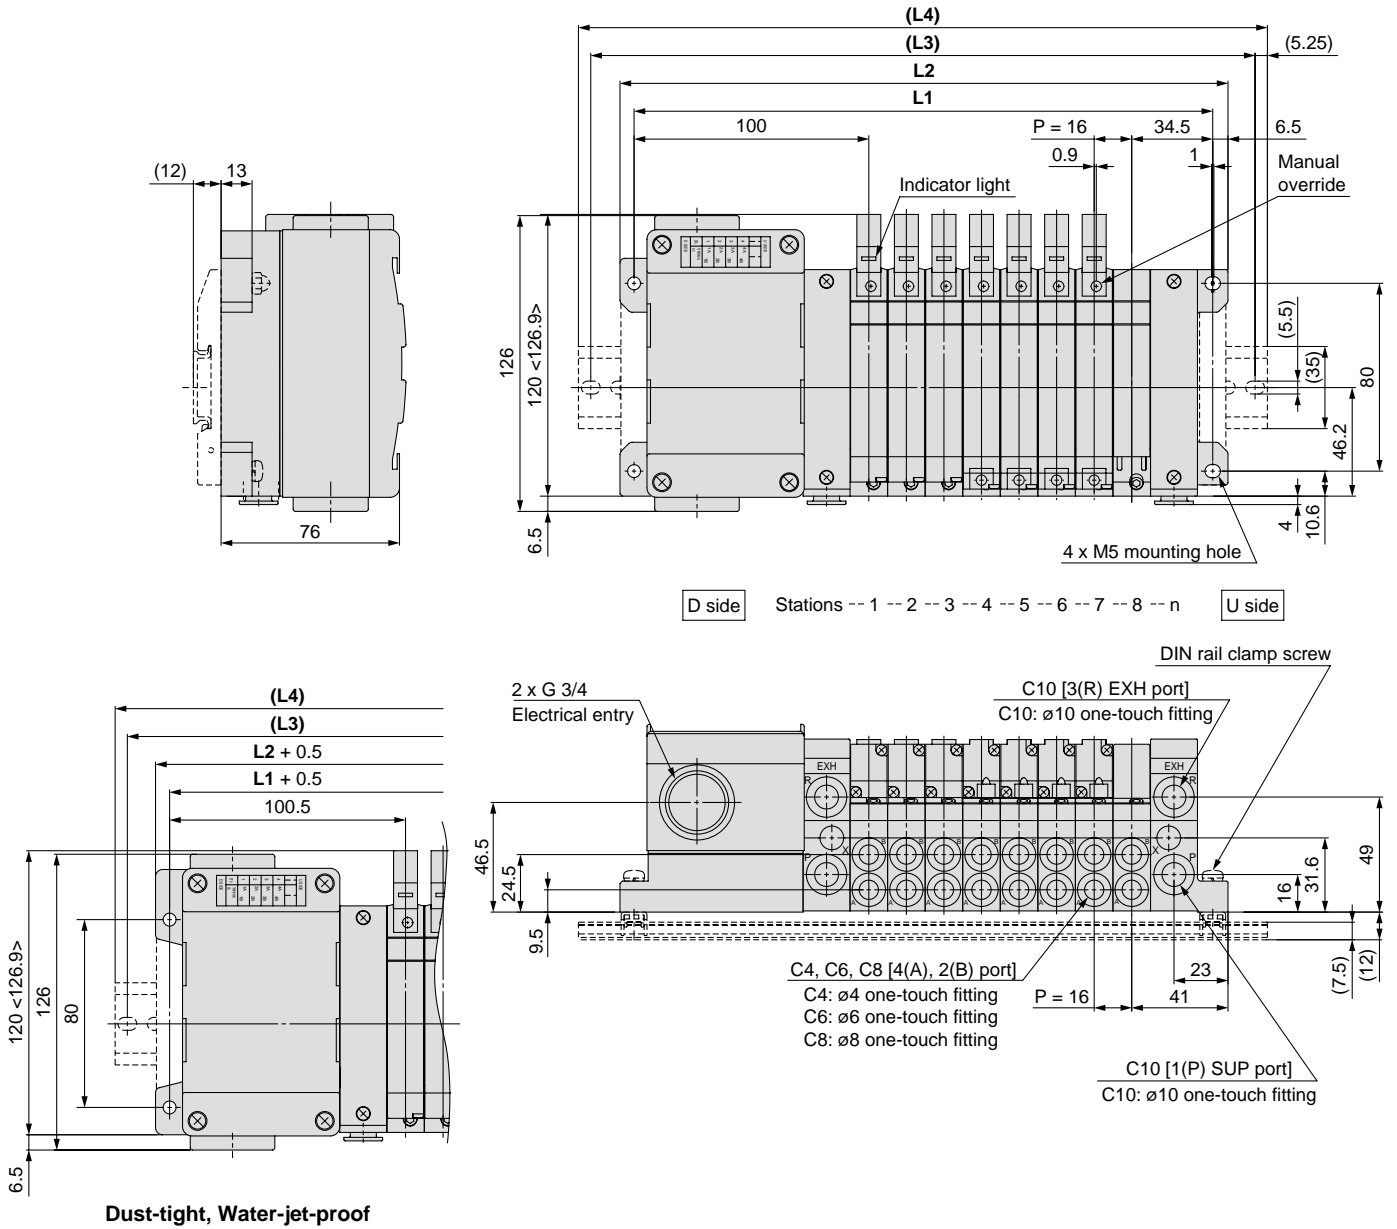

## Dimensions

Formula  $L1 = 16n + 118.5$ ,  $L2 = 16n + 131$  n: Station (Maximum 20 stations)


L	n	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20
<b>L1</b>		150.5	166.5	182.5	198.5	214.5	230.5	246.5	262.5	278.5	294.5	310.5	326.5	342.5	358.5	374.5	390.5	406.5	422.5	438.5
<b>L2</b>		163	179	195	211	227	243	259	275	291	307	323	339	355	371	387	403	419	435	451
<b>(L3)</b>		187.5	200	225	237.5	250	262.5	287.5	300	312.5	337.5	350	362.5	375	400	412.5	425	450	462.5	475
<b>(L4)</b>		198	210.5	235.5	248	260.5	273	298	310.5	323	348	360.5	373	385.5	410.5	423	435.5	460.5	473	485.5

F kit  
P kit  
J kit  
G kit  
T kit  
L kit  
S kit  
M kit  
Sub-plate  
Single Unit  
Semi-  
standard  
Construction  
Exploded  
View of  
Manifold  
Manifold  
Optional Parts  
Safety  
Instructions  
Specific  
Product  
Precautions

# Series VQ1000/2000 kit (Lead wire)

IP65 compliant

- Direct electrical entry. Models with one or more stations are available.
- (SUP) and (EXH) ports are provided on one side for further space savings.
- Maximum stations are 8.
- Enclosure: Dust-tight, Water-jet-proof (IP65) compatible (Series VQ2000)

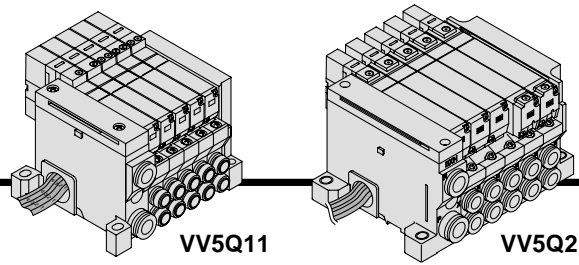


## Manifold Specifications

Series	Piping specifications		Applicable stations
	Piping direction	Port size	
VQ1000	Side	1(P), 3(R) 4(A), 2(B)	Max. 8 stations
VQ2000	Side	C8 C3, C4, C6, M5	Max. 8 stations

## Wiring Specifications: Positive COM ●

Three lead wires are attached to each station regardless of the type of valve which is mounted. The red wire is for COM connection.

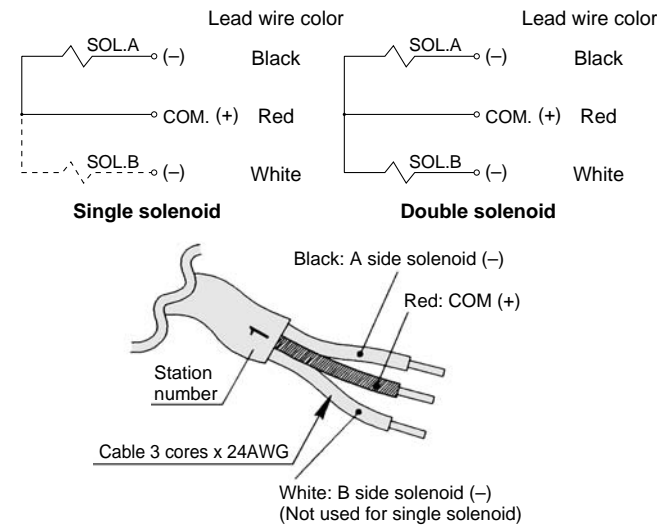


Use any of the below cable lead wire assembly to change the lead wire length:

### Lead wire assembly with connector


Lead wire length	Part no.
0.6 m	VVQ1000-84A-6-*
1.5 m	VVQ1000-84A-15-*
3 m	VVQ1000-84A-30-*

\* Station number 1 to 8

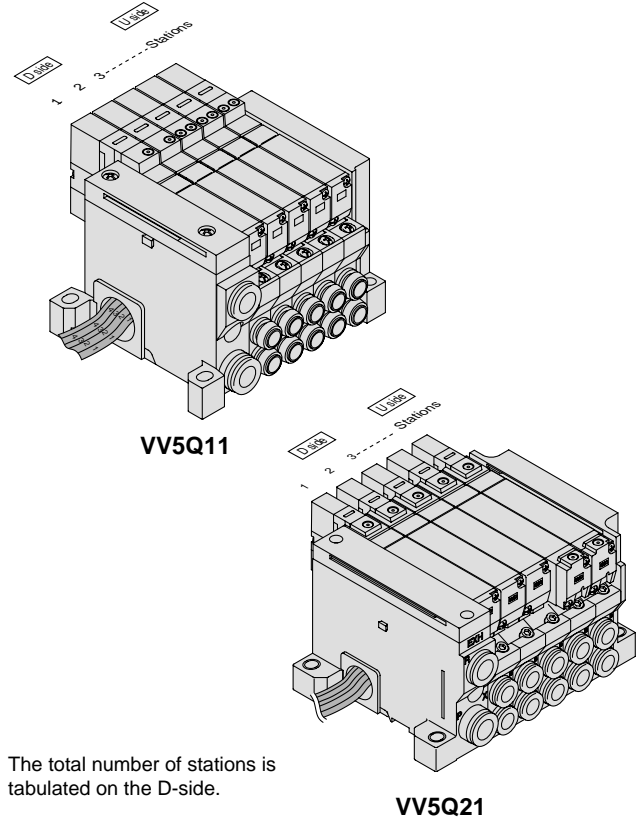

The total number of stations is tabulated on the D-side.

## How to Order Manifold

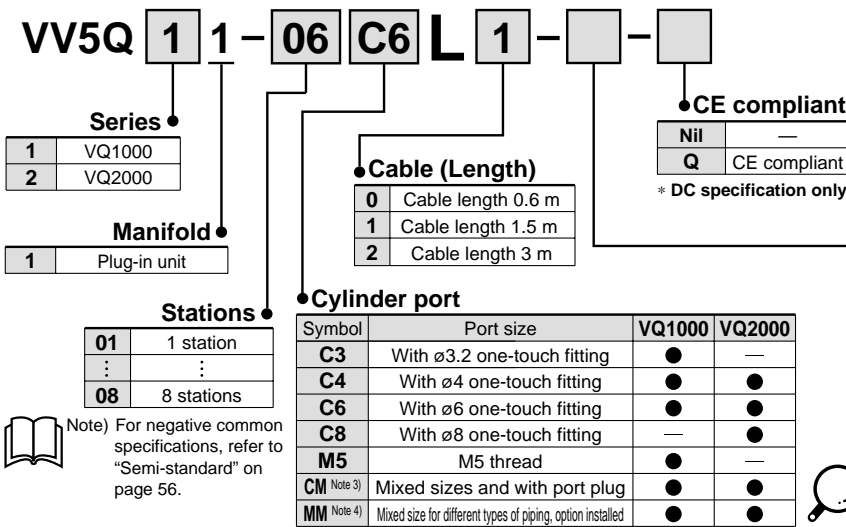

Symbol	Port size	VQ1000	VQ2000
C3	With ø3.2 one-touch fitting	●	—
C4	With ø4 one-touch fitting	●	●
C6	With ø6 one-touch fitting	●	●
C8	With ø8 one-touch fitting	—	●
M5	M5 thread	●	—
CM <sup>Note 3)</sup>	Mixed sizes and with port plug	●	●
MM <sup>Note 4)</sup>	Mixed size for different types of piping, option installed	●	●


## Option

Symbol	Option	VQ1000	VQ2000
Nil	None	●	●
2	200/220 VAC models (F/L kit only)	●	●
B <sup>Note 2)</sup>	With back pressure check valve	●	●
D	DIN rail mounting	●	●
D0	With DIN rail bracket (Without DIN rail)	●	●
D□ <sup>Note 3)</sup>	DIN rail length specified (□: Stations 02 to 24)	●	●
G1 <sup>Note 4)</sup>	1 set of regulator unit	●	—
G2 <sup>Note 4)</sup>	2 sets of regulator unit	●	—
G3 <sup>Note 4)</sup>	3 sets of regulator unit	●	—
J□ <sup>Note 5)</sup>	With ejector unit	●	—
N	With name plate	●	●
R <sup>Note 6)</sup>	External pilot	●	●
S	Direct EXH outlet with built-in silencer	●	●
W	Enclosure: Dust-tight, Water-jet-proof (IP65)	—	●

- Note 1) When two or more symbols are specified, indicate them alphabetically. Example) -BRS
- Note 2) Models with a suffix "B" have check valves for prevention of back pressure at all manifold stations. When a back pressure check valve is desired, and is to be installed only in certain manifold stations, specify the mounting position by means of the manifold specification sheet.
- Note 3) The number of stations that may be displayed is longer than the manifold number of stations.
- Note 4) Specify the mounting position by means of the manifold specification sheet.
- Note 5) Refer to page 69 for details on with ejector unit. A combination of "J" and "N" is not available.
- Note 6) Indicate "R" for the valve with external pilot.



Note) For negative common specifications, refer to "Semi-standard" on page 56.

- Note 1) Insert "L" (Top ported) or "B" (Bottom ported) for elbow type. Example) B6 (Bottom ported elbow with ø6 one-touch fitting)
- Note 2) Indicate "LM" for models with elbow fittings and mixed cylinder port sizes.
- Note 3) Indicate "Mixed sizes and with port plug" by means of the manifold specification sheet.
- Note 4) When selecting the mixed size for different types of piping, dual flow fitting assembly, or double check block (direct mounting), enter "MM" and give instructions in the manifold specification sheet.
- Note 5) Inch-size one-touch fittings are available. Refer to "Semi-standard" on page 57 for details.

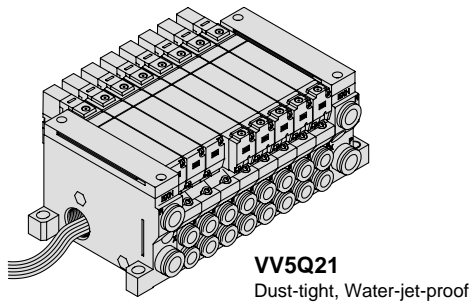

● **Wiring Specifications: Negative COM (Semi-standard)**

Three lead wires are attached to each station regardless of the type of valve which is mounted.  
The black wire is for COM connection.

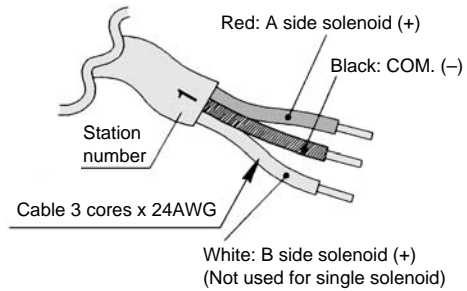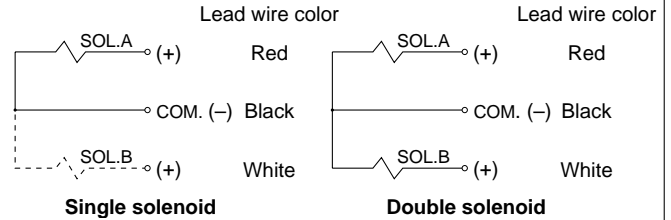

**Lead wire assembly with connector**

Lead wire length	Part no.
0.6 m	VVQ1000-84AN-6-*
1.5 m	VVQ1000-84AN-15-*
3 m	VVQ1000-84AN-30-*

\* Station number 1 to 8



Note) When using the negative common specifications, use valves for negative common. For negative common specifications, refer to "Semi-standard" on page 56.

**How to Order Valves**

**VQ 1 1 0 0 - 5 - 1 -**

**Series**

1	VQ1000
2	VQ2000

**Seal**

0	Metal seal
1	Rubber seal

**Type of actuation**

1	2-position single
2	2-position double
3	3-position closed center
4	3-position exhaust center
5	3-position pressure center
A	4-position dual port (N.C. +N.C.)
B	4-position dual port (N.O. +N.O.)
C	4-position dual port (N.C. +N.O.)

**Function**

Symbol	Specifications	DC	AC
Nil	Standard	(0.4 W) ○	○ Note 1)
B	High-speed response type	(0.95 W) ○	—
K Note 2)	High-pressure type (1.0 MPa)	(0.95 W) ○	—
N Note 3)	Negative common	○	—
R Note 3)	External pilot	○	○

**CE compliant**

Nil	—
Q	CE compliant

\* DC specification only

**Enclosure**

Nil	Dust-protected
W Note)	Dust-tight, Water-jet-proof (IP65)

Note) VQ2000 only

**Manual override**

Nil	Non-locking push type (Tool required)
B	Locking type (Tool required)
C	Locking type (Manual)
D	Slide locking type (Manual)

**Light/surge voltage suppressor**

Nil	Yes
E	None

**Coil voltage**

1	100 VAC (50/60 Hz)
2	200 VAC (50/60 Hz)
3	110 VAC (50/60 Hz)
4	220 VAC (50/60 Hz)
5	24 VDC
6	12 VDC



Note 1) Refer to page 16 for power consumption of AC type.  
Note 2) Metal seal only  
Note 3) For external pilot and negative common specifications, refer to "Semi-standard" on pages 56 to 57.  
Note 4) When two or more symbols are specified, indicate them alphabetically. Combination of [B] and [K] is not possible.


**How to Order Manifold Assembly**

Specify the part numbers for valves and options together beneath the manifold base part number.

**<Example>**

Lead wire kit with cable (3 m)  
VV5Q11-06C6L2 ...1 set—Manifold base part no.  
\*VQ1100-51 ...2 sets—Valve part no. (Stations 1 to 2)  
\*VQ1200-51 ...2 sets—Valve part no. (Stations 3 to 4)  
\*VQ1300-51 ...1 set—Valve part no. (Station 5)  
\*VVQ1000-10A-1 ...1 set—Blanking plate part no. (Station 6)

Write sequentially from the 1st station on the D-side. When part nos. written collectively are complicated, specify them by means of the manifold specification sheet.

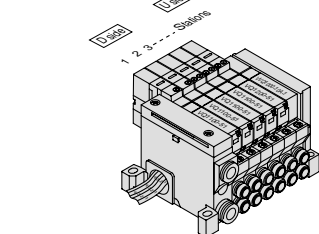

**Caution**

Use the standard (DC) specification when continuously energizing for long periods of time.


F kit  
P kit  
J kit  
G kit  
T kit  
L kit  
S kit  
M kit  
Sub-plate Single Unit  
Semi-standard  
Construction  
Exploded View of Manifold  
Manifold Optional Parts  
Safety Instructions  
Specific Product Precautions

# Series VQ1000/2000 kit (Lead wire)

## VV5Q11

< >: AC


The dashed lines indicate DIN rail mounting [-D] (with DIN rail mounting bracket).

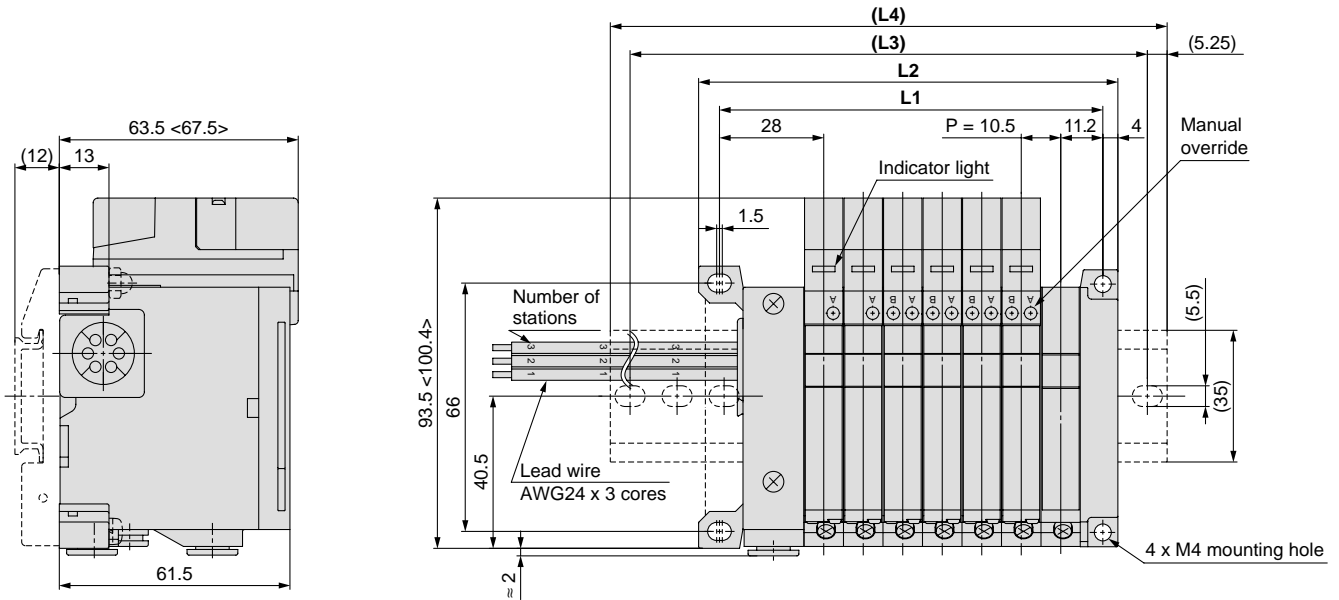

D side

Stations -- 1 -- 2 -- 3 -- 4 -- 5 -- 6 -- 7 -- n

U side

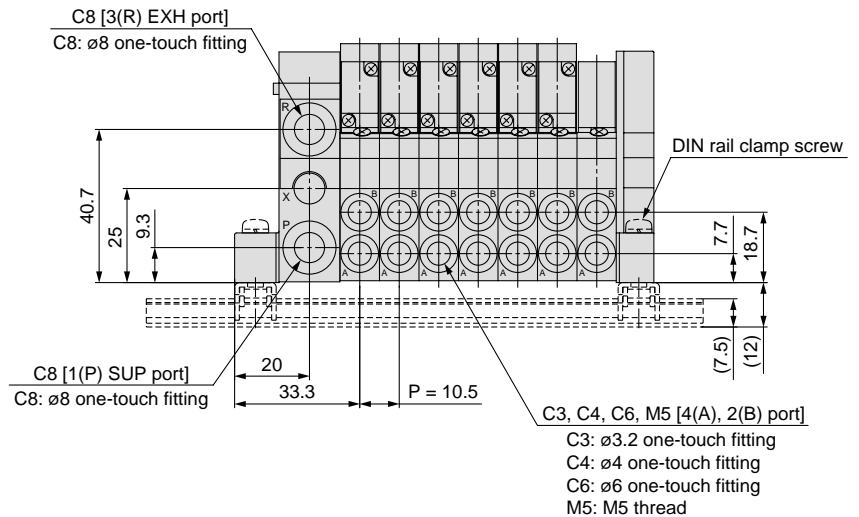

Formula  $L1 = 10.5n + 28.5$ ,  $L2 = 10.5n + 38$   
n: Station (Maximum 8 stations)

### Dimensions

L \ n	1	2	3	4	5	6	7	8
<b>L1</b>	39	49.5	60	70.5	81	91.5	102	112.5
<b>L2</b>	48.5	59	69.5	80	90.5	101	111.5	122
<b>(L3)</b>	75	87.5	87.5	100	112.5	125	137.5	150
<b>(L4)</b>	85.5	98	98	110.5	123	135.5	148	160.5


With ejector unit: Formula  $L1 = 10.5n + 28.5 + (\text{Number of ejector units} \times 26.7)$   
 $L2 = 10.5n + 38 + (\text{Number of ejector units} \times 26.7)$   
 $L4$  is  $L2$  plus about 30.



# VV5Q21


< >: AC

The dashed lines indicate DIN rail mounting [-D] (with DIN rail mounting bracket).

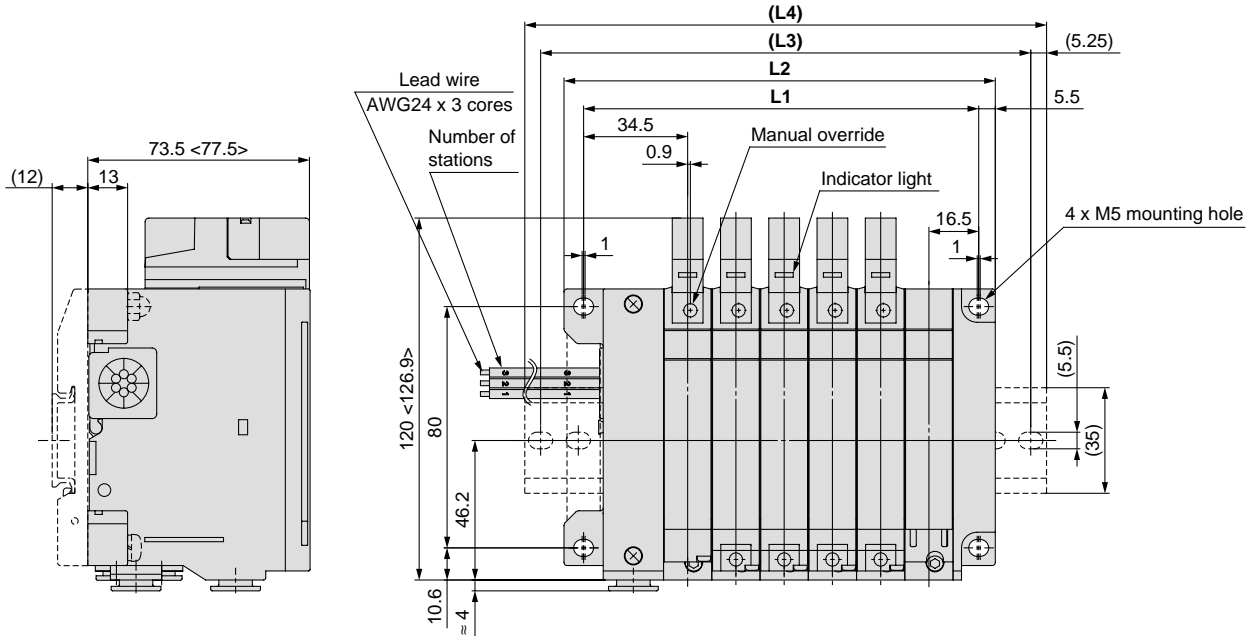

Dust-tight, Water-jet-proof

D side Stations --- 1 --- 2 --- 3 --- 4 --- 5 --- 6 --- n U side

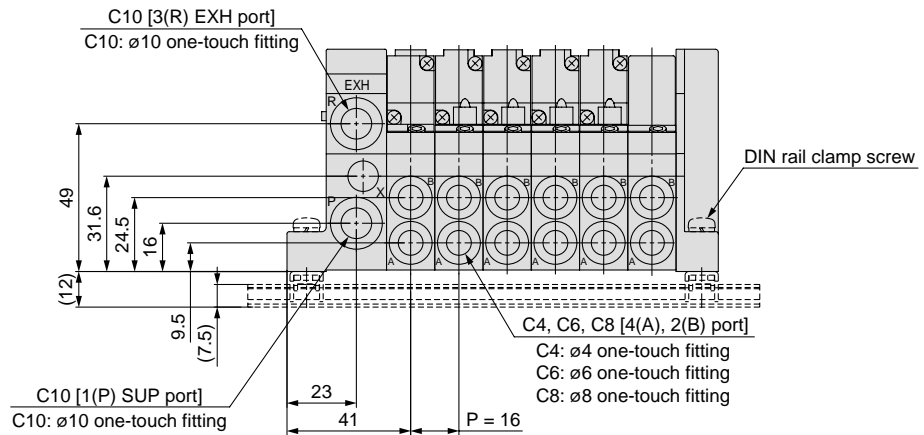

## Dimensions

Formula L1 = 16n + 35, L2 = 16n + 47  
n: Station (Maximum 8 stations)

L \ n	1	2	3	4	5	6	7	8
L1	51	67	83	99	115	131	147	163
L2	63	79	95	111	127	143	159	175
(L3)	87.5	100	125	137.5	150	162.5	184.5	200
(L4)	98	110.5	135.5	148	160.5	173	198	210.5

F kit

P kit

J kit

G kit

T kit

L kit

S kit

M kit

Sub-plate  
Single Unit

Semi-  
standard

Construction

Exploded  
View of  
Manifold

Manifold  
Optional Parts

Safety  
Instructions


Specific  
Product  
Precautions



# Series VQ1000/2000

## kit (Serial transmission) Base mounted plug-in manifold: For EX510 Gateway-type serial transmission system

### How to Order Manifold

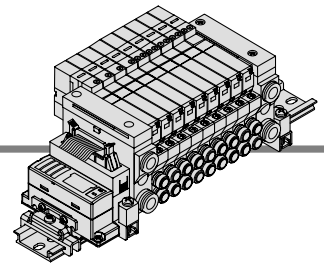

# VV5Q 1 1 - SB 08 - D -

Manifold series

1	VQ1000
2	VQ2000

SI unit specifications

Nil	NPN output (+COM.)
N	PNP output (-COM.)

Valve stations

Symbol	Stations
01	1 station
⋮	⋮
08	8 stations

Note) Max. 16 stations. (Special wiring specifications)

CE compliant

Nil	—
Q	CE compliant

Option

Nil	None
B Note 2)	With back pressure check valve
D <input type="checkbox"/> Note 8)	DIN rail length specified ( <input type="checkbox"/> : Stations 02 to 16)
G1 Note 3) Note 7)	1 set of regulator unit
G2 Note 3) Note 7)	2 sets of regulator unit
G3 Note 3) Note 7)	3 sets of regulator unit
J <input type="checkbox"/> Note 4) Note 7)	With ejector unit
K Note 5)	Special wiring spec. (Except double wiring)
N	With name plate
R Note 6)	with external pilot
S	Direct EXH outlet with built-in silencer

SI unit part no.

Symbol	SI unit specifications	SI unit part no.
Nil	NPN output (+COM.)	EX510-S002A
N	PNP output (-COM.)	EX510-S102A

Cylinder port

Symbol	Port size	VQ1000	VQ2000	
Metric size	C3	With ø3.2 one-touch fitting	○	—
	C4	With ø4 one-touch fitting	○	○
	C6	With ø6 one-touch fitting	○	○
	C8	With ø8 one-touch fitting	—	○
	M5	M5 thread	○	—
	CM Note 1)	With mixed sizes and with port plug	○	○
	L3	Top ported elbow with ø3.2 one-touch fitting	○	—
	L4	Top ported elbow with ø4 one-touch fitting	○	○
	L6	Top ported elbow with ø6 one-touch fitting	○	○
	L8	Top ported elbow with ø8 one-touch fitting	—	○
	L5	Top ported elbow M5 thread	○	—
	B3	Bottom ported elbow with ø3.2 one-touch fitting	○	—
	B4	Bottom ported elbow with ø4 one-touch fitting	○	○
	B6	Bottom ported elbow with ø6 one-touch fitting	○	○
	B8	Bottom ported elbow with ø8 one-touch fitting	—	○
	B5	Bottom ported elbow M5 thread	○	—
LM Note 1)	Elbow port, mixed sizes	○	○	
Inch size	N1	ø1/8" with one-touch fitting	○	—
	N3	ø5/32" with one-touch fitting	○	○
	N7	ø1/4" with one-touch fitting	○	○
	N9	ø5/16" with one-touch fitting	—	○
	M5T	UNF10-32 thread	○	—
	NM Note 1)	With mixed sizes and with port plug	○	○
	LN1	Top ported elbow with ø1/8" one-touch fitting	○	—
	LN3	Top ported elbow with ø5/32" one-touch fitting	○	○
	LN7	Top ported elbow with ø1/4" one-touch fitting	○	○
	LN9	Top ported elbow with ø5/16" one-touch fitting	—	○
	L5T	Top ported elbow UNF10-32 thread	○	—
	BN1	Bottom ported elbow with ø1/8" one-touch fitting	○	—
	BN3	Bottom ported elbow with ø5/32" one-touch fitting	○	○
	BN7	Bottom ported elbow with ø1/4" one-touch fitting	○	○
	BN9	Bottom ported elbow with ø5/16" one-touch fitting	—	○
	B5T	Bottom ported elbow UNF10-32 thread	○	—
LNM Note 1)	Elbow port, mixed sizes	○	○	
MM Note 2)	Mixed size for different types of piping, option installed	○	○	

Note 1) Indicate "Mixed sizes and with port plug" in the manifold specification sheet.  
 Note 2) When selecting the mixed size for different types of piping, dual flow fitting assembly, or double check block (direct mounting), enter "MM" and give instructions in the manifold specification sheet.




- Note 1) When two or more symbols are specified, indicate them alphabetically. Example) -BRS
- Note 2) Models with a suffix "B" have check valves for prevention of back pressure at all manifold stations. When a back pressure check valve is desired, and is to be installed only in certain manifold stations, specify the mounting position by means of the manifold specification sheet.
- Note 3) Specify the mounting position by means of the manifold specification sheet.
- Note 4) Refer to page 69 for details on with ejector unit. A combination of "J" and "N" is not available.
- Note 5) Specify the wiring specifications by means of the manifold specification sheet.
- Note 6) Indicate "R" for the valve with external pilot.
- Note 7) VQ1000 only
- Note 8) The number of stations that may be displayed is longer than the manifold number of stations.

DIN rail mounting

### How to Order Manifold Assembly

#### Example

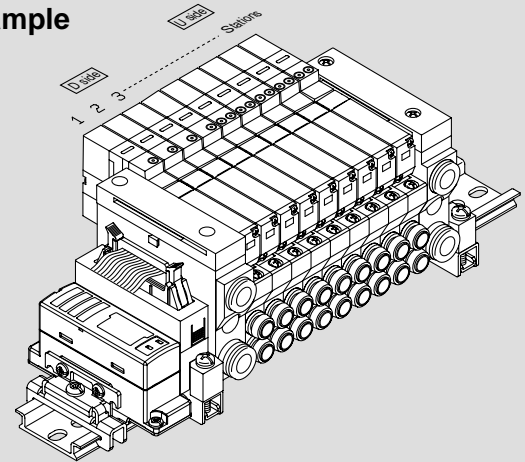

VV5Q11-SB08C6-D ... 1 set (SB kit, 8-station manifold part no.)  
 \*VQ1100-51 ..... 4 sets (Single type part no.)  
 \*VQ1200-51 ..... 3 sets (Double type part no.)  
 \*VQ1300-51 ..... 1 set (3 position type part no.)

The asterisk denotes the symbol for assembly. Prefix it to the part nos. of the solenoid valve, etc.  
 Enter in order starting from the first station on the D-side.

Add the valve and option part numbers under the manifold base part number. In the case of complex arrangement, specify them by means of the manifold specification sheet.

**How to Order Valves**

VQ 1 1 0 0 - 5 1 -










• **Series**


1	VQ1000
2	VQ2000

• **CE compliant**


Nil	—
Q	CE compliant


• **Type of actuation**


1	2-position single (A)(B)  (R1)(P)(R2)	
	2	Metal 2-position double (A)(B)  (R1)(P)(R2)
Rubber 2-position double (A)(B)  (R1)(P)(R2)		
3	3-position closed center (A)(B)  (R1)(P)(R2)	
4	3-position exhaust center (A)(B)  (R1)(P)(R2)	
5	3-position pressure center (A)(B)  (R1)(P)(R2)	
A (Note)	4-position dual 3-port valve (A)  N.C. 1 N.C.	
B (Note)	4-position dual 3-port valve (B)  N.O. 1 N.O.	
C (Note)	4-position dual 3-port valve (C)  N.C. 1 N.O.	


 Note) Rubber seal only

• **Manual override**

**Nil:** Non-locking push type (Tool required)  


**B:** Locking type (Tool required)  


**C:** Locking type (Manual)  


**D:** Slide locking type (Manual)  


• **Rated voltage**

5	24 VDC
---	--------

• **Function**

Symbol	Specifications
Nil	Standard (0.4 W)
B	High-speed response type (0.95 W)
K Note 1)	High-pressure type (1.0 MPa) [0.95 W]
N Note 2)	Negative common
R Note 2)	External pilot

Note 1) Metal seal only

Note 2) For external pilot and negative common specifications, refer to "Semi-standard" on pages 56 to 57.

Note 3) When two or more symbols are specified, indicate them alphabetically. Combination of [B] and [K] is not possible.

• **Seal**

0	Metal seal
1	Rubber seal

F kit

P kit

J kit

G kit

T kit

L kit

S kit

M kit

Sub-plate Single Unit

Semi-standard

Construction

Exploded View of Manifold

Manifold Optional Parts

Safety Instructions



Specific Product Precautions

# S Series VQ1000/2000


kit (Serial transmission) Base mounted plug-in manifold: For EX510 Gateway-type serial transmission system

## VV5Q11

Applicable connector: Flat ribbon cable connector (20P)  
(Complies with MIL-C-83503)

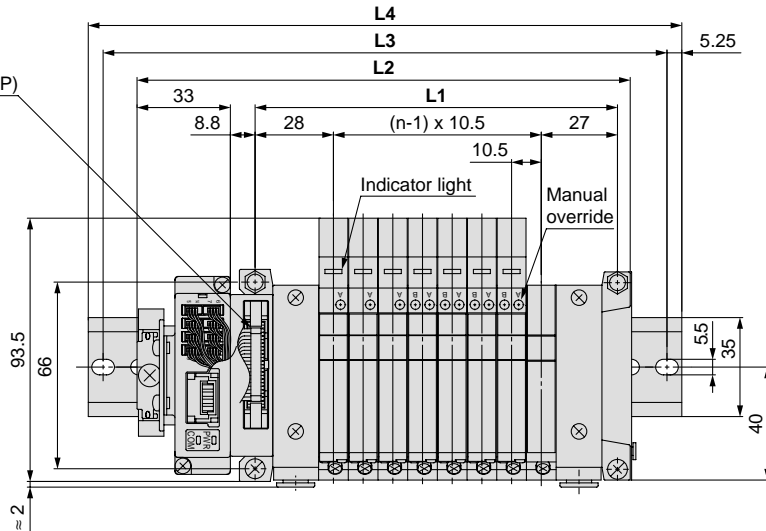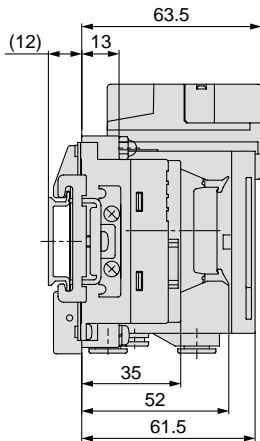

D side Stations 1 2 3 4 5 6 7 8 ... n U side

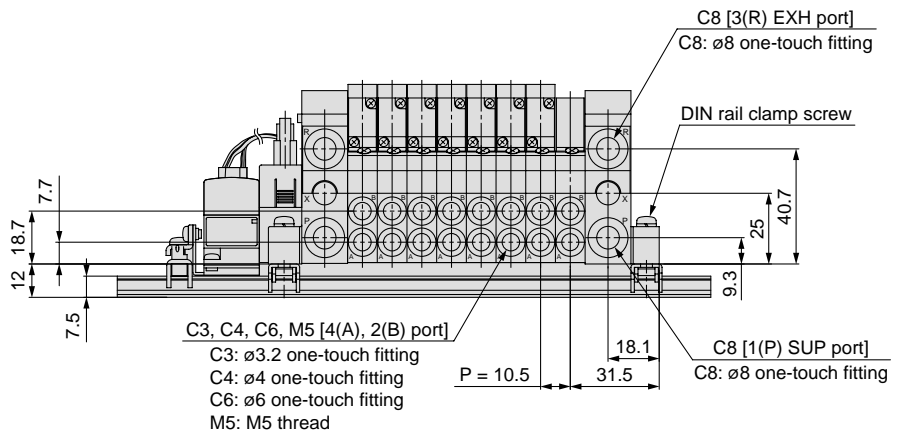



### Dimensions

Formula  $L1 = 10.5n + 44.5$ ,  $L2 = 10.5n + 91$  n: Station (Maximum 16 stations)


L \ n	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16
L1	55	65.5	76	86.5	97	107.5	118	128.5	139	149.5	160	170.5	181	191.5	202	212.5
L2	101.5	112	122.5	133	143.5	154	164.5	175	185.5	196	206.5	217	227.5	238	248.5	259
L3	125	137.5	150	162.5	175	175	187.5	200	212.5	225	237.5	237.5	250	262.5	275	287.5
L4	135.5	148	160.5	173	185.5	185.5	198	210.5	223	235.5	248	248	260.5	273	285.5	298

# VV5Q21

Applicable connector: Flat ribbon cable connector (20P)  
(Complies with MIL-C-83503)

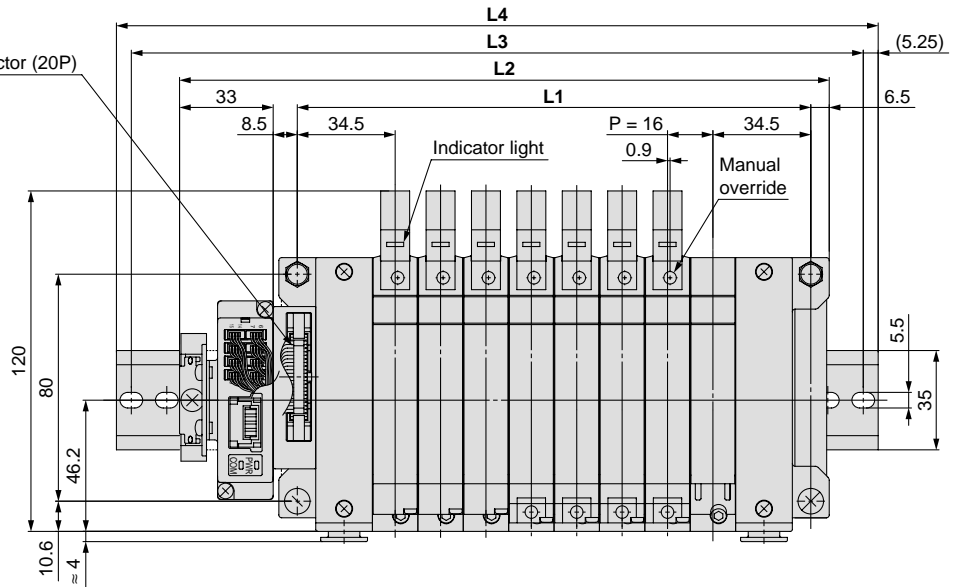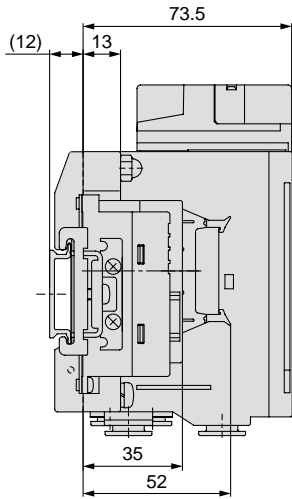

D side Stations -- 1 -- 2 -- 3 -- 4 -- 5 -- 6 -- 7 -- 8 -- n U side

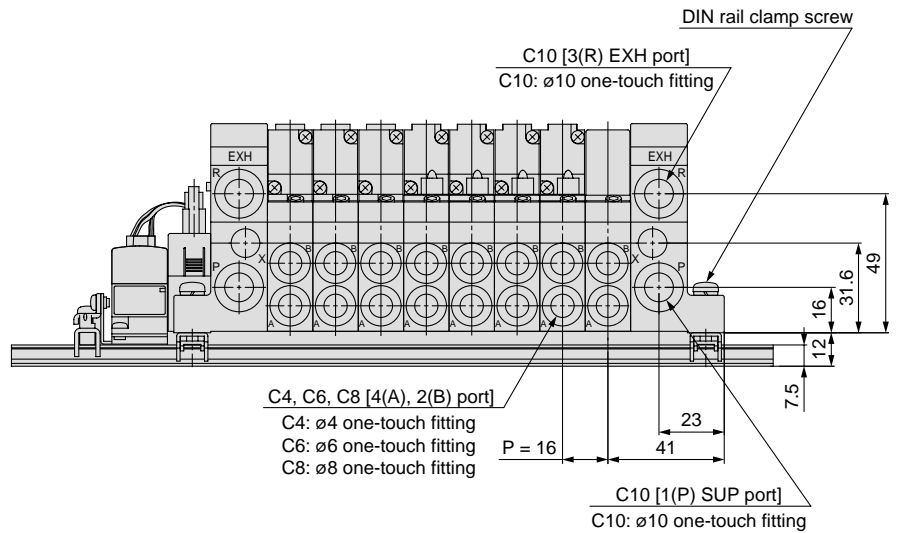

## Dimensions

Formula  $L1 = 16n + 53$ ,  $L2 = 16n + 101$  n: Station (Maximum 16 stations)

L \ n	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16
L1	69	85	101	117	133	149	165	181	197	213	229	245	261	277	293	309
L2	117	133	149	165	181	197	213	229	245	261	277	293	309	325	341	357
L3	137.5	162.5	175	187.5	212.5	225	237.5	250	275	287.5	300	312.5	337.5	350	362.5	387.5
L4	148	173	185.5	198	223	235.5	248	260.5	285.5	298	310.5	323	348	360.5	373	398

- F kit
- P kit
- J kit
- G kit
- T kit
- L kit
- S kit
- M kit
- Sub-plate Single Unit
- Semi-standard
- Construction
- Exploded View of Manifold
- Manifold Optional Parts
- Safety Instructions
- Specific Product Precautions



# Series VQ1000/2000

## kit (Serial transmission): For EX120/123/124 Integrated-type (Output) serial transmission system

### IP65 compliant

- The serial transmission system reduces wiring work, while minimizing wiring and saving space.
- Enclosure: Dust-tight, Water-jet-proof (IP65) compatible (Series VQ2000)

### Manifold Specifications

Series	Piping specifications			Applicable stations
	Piping direction	Port size		
		1(P), 3(R)	4(A), 2(B)	
VQ1000	Side	C8	C3, C4, C6, M5	Max. 16 stations
VQ2000	Side	C10	C4, C6, C8	Max. 16 stations

### How to Order Manifold

**VV5Q 1 1 - 08 C6 S V - - XP -**

**Series**

1	VQ1000
2	VQ2000

**Manifold**

1	Plug-in unit
---	--------------

**Stations**

02	2 stations
⋮	⋮
16 (Note 1)	16 stations

**SI unit specifications**

Symbol	Protocol	Stations
0	Without SI unit	Max. 16 stations
F1	NKE Corp.: Uni-wire System	
H	NKE Corp.: Uni-wire H System	
J1	SUNX Corp.: S-LINK (16 outputs)	
J2	SUNX Corp.: S-LINK (8 outputs)	
Q	DeviceNet™ System	Max. 16 stations
R1	OMRON Corp.: CompoBus/S (16 outputs)	Max. 8 stations
R2	OMRON Corp.: CompoBus/S (8 outputs)	
V	CC-LINK	Max. 16 stations

**Dust-protected (-XP)**

Suffix "-XP" to the end of the part number for the dust-protected SI units.  
(Except Q when the SI unit specifications are compatible with DeviceNet™.)

**CE compliant**

Nil	—
Q	CE compliant

\* Refer to "SI Unit Part No." when ordering the CE-compliant SI unit.

**Option**

Symbol	Option	VQ1000	VQ2000
Nil	None	●	●
B (Note 2)	With back pressure check valve	●	●
D	DIN rail mounting	●	●
D <input type="checkbox"/> (Note 3)	DIN rail mounting ( <input type="checkbox"/> : Stations 02 to 24)	●	●
G1 (Note 4)	1 set of regulator unit	●	—
G2 (Note 4)	2 sets of regulator unit	●	—
G3 (Note 4)	3 sets of regulator unit	●	—
J <input type="checkbox"/> (Note 5)	With ejector unit	●	—
K (Note 6)	Special wiring specifications (Except double wiring)	●	●
N	With name plate	●	●
R (Note 7)	With external pilot	●	●
S	Direct EXH outlet with built-in silencer	●	●
W (Note 8, Note 9)	Enclosure: Dust-tight, Water-jet-proof (IP65)	—	●

**Cylinder port**

Symbol	Port size	VQ1000	VQ2000
C3	With ø3.2 one-touch fitting	●	—
C4	With ø4 one-touch fitting	●	●
C6	With ø6 one-touch fitting	●	●
C8	With ø8 one-touch fitting	—	●
M5	M5 thread	●	—
CM (Note 3)	Mixed sizes and with port plug	●	●
MM (Note 4)	Mixed size for different types of piping, option installed	●	●

- Note 1) Insert "L" (Top ported) or "B" (Bottom ported) for elbow type.  
Example) B6 (Bottom ported elbow with ø6 one-touch fitting)
- Note 2) Indicate as "LM" for models with elbow fittings and mixed cylinder port sizes.
- Note 3) Indicate "Mixed sizes and with port plug" by means of the manifold specification sheet.
- Note 4) When selecting the mixed size for different types of piping, dual flow fitting assembly, or double check block (direct mounting), enter "MM" and give instructions in the manifold specification sheet.
- Note 5) Inch-size one-touch fittings are available. Refer to "Semi-standard" on page 57 for details.

### SI Unit Part No. (Without option W [Dust-protected (-XP) is included.] )


Symbol	Protocol	SI unit part no.	CE compliant
F1	NKE Corp.: Uni-wire System	Standard: EX120-SUW1 Dust-protected: EX120-SUW1-XP	—
H	NKE Corp.: Uni-wire H System	Standard: EX120-SUH1 Dust-protected: EX120-SUH1-XP	—
J1	SUNX Corp.: S-LINK (16 outputs)	Standard: EX120-SSL1 Dust-protected: EX120-SSL1-XP	—
J2	SUNX Corp.: S-LINK (8 outputs)	Standard: EX120-SSL2 Dust-protected: EX120-SSL2-XP	—
Q	DeviceNet™	Standard: EX120-SDN1 Dust-protected: No part no.	○
R1	OMRON Corp.: CompoBus/S (16 outputs)	Standard: EX120-SCS1 Dust-protected: EX120-SCS1-XP	○
R2	OMRON Corp.: CompoBus/S (8 outputs)	Standard: EX120-SCS2 Dust-protected: EX120-SCS2-XP	○
V	CC-LINK	Standard: EX120-SMJ1 Dust-protected: EX120-SMJ1-XP	○

### SI Unit Part No. (With option W)


Symbol	Protocol	SI unit part no.	CE compliant
F1	NKE Corp.: Uni-wire System	EX123D-SUW1	—
H	NKE Corp.: Uni-wire H System	EX123D-SUH1	—
J1	SUNX Corp.: S-LINK (16 outputs)	EX123D-SSL1	—
J2	SUNX Corp.: S-LINK (8 outputs)	EX123D-SSL2	—
Q	DeviceNet™ System	EX124D-SDN1	○
R1	OMRON Corp.: CompoBus/S (16 outputs)	EX124D-SCS1	○
R2	OMRON Corp.: CompoBus/S (8 outputs)	EX124D-SCS2	○
V	CC-LINK	EX124D-SMJ1	○

Refer to Best Pneumatics No. ① for details on the EX120/123/124 integrated-type (Output) serial transmission system.



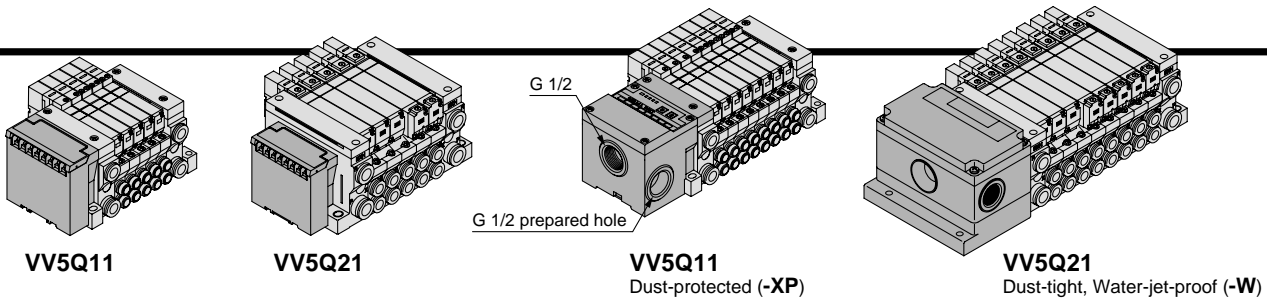

## How to Order Valves

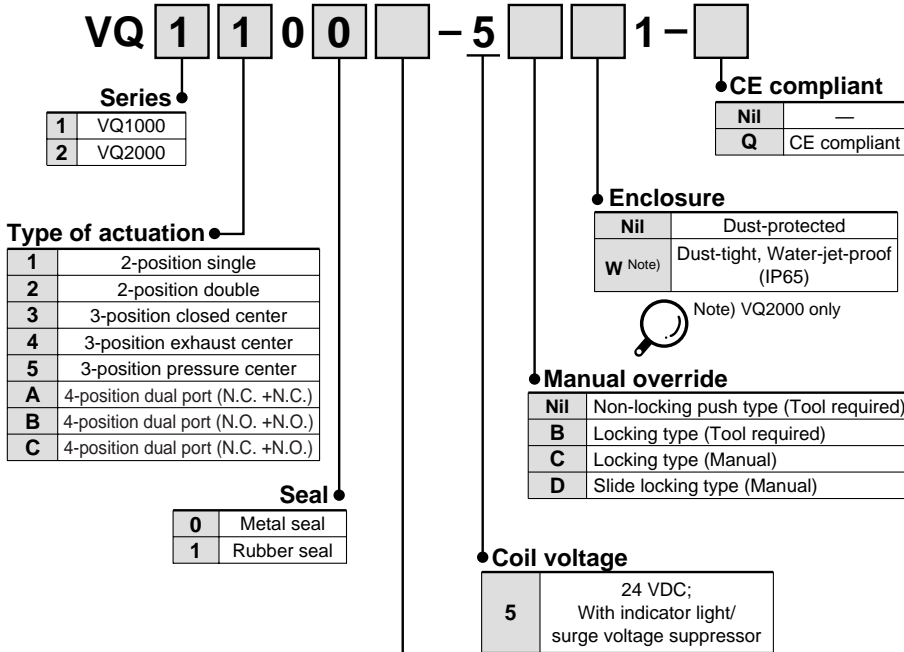

## How to Order Manifold Assembly


Specify the part numbers for valves and options together beneath the manifold base part number.

### <Example>

VV5Q11-08C6SV...1 set—Manifold base part no.  
 \*VQ1100-51.....2 sets—Valve part no. (Stations 1 to 2)  
 \*VQ1200-51.....4 sets—Valve part no. (Stations 3 to 6)  
 \*VQ1300-51.....1 set—Valve part no. (Station 7)  
 \*VVQ1000-10A-1...1 set—Blanking plate part no. (Station 8)

Write sequentially from the 1st station on the D-side. When part nos. written collectively are complicated, specify them by means of the manifold specification sheet.

Prefix the asterisk to the part nos. of the solenoid valve, etc.



### Function

Symbol	Specifications	DC
Nil	Standard	(0.4 W) ○
B	High-speed response type	(0.95 W) ○
K (Note 1)	High-pressure type (1.0 MPa)	(0.95 W) ○
N (Note 2)	Negative common	○
R (Note 2)	External pilot	○



Note 1) Metal seal only  
 Note 2) For external pilot and negative common specifications, refer to "Semi-standard" on pages 56 to 57.  
 Note 4) When two or more symbols are specified, indicate them alphabetically. Combination of [B] and [K] is not possible.


- F kit
- P kit
- J kit
- G kit
- T kit
- L kit
- S kit
- M kit
- Sub-plate Single Unit
- Semi-standard
- Construction
- Exploded View of Manifold
- Manifold Optional Parts
- Safety Instructions
- Specific Product Precautions





# Series VQ1000/2000

kit (Serial transmission): For EX120 Integrated-type (Output) serial transmission system

## VV5Q11

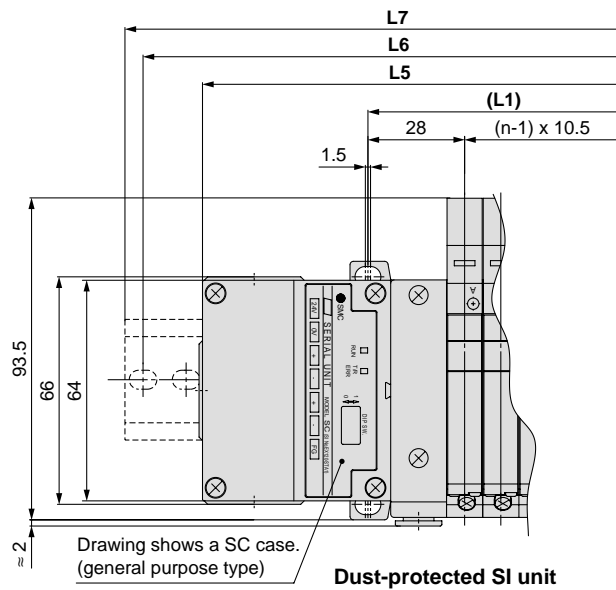

The dashed lines indicate DIN rail mounting [-D] with DIN rail mounting bracket).

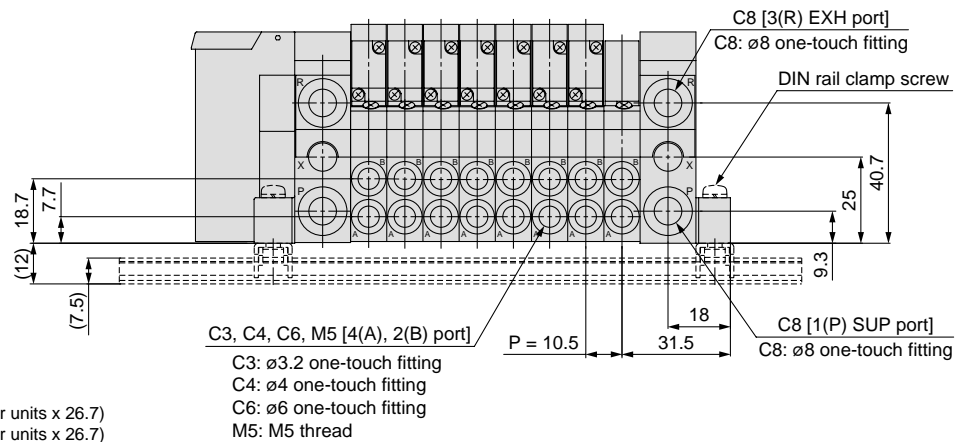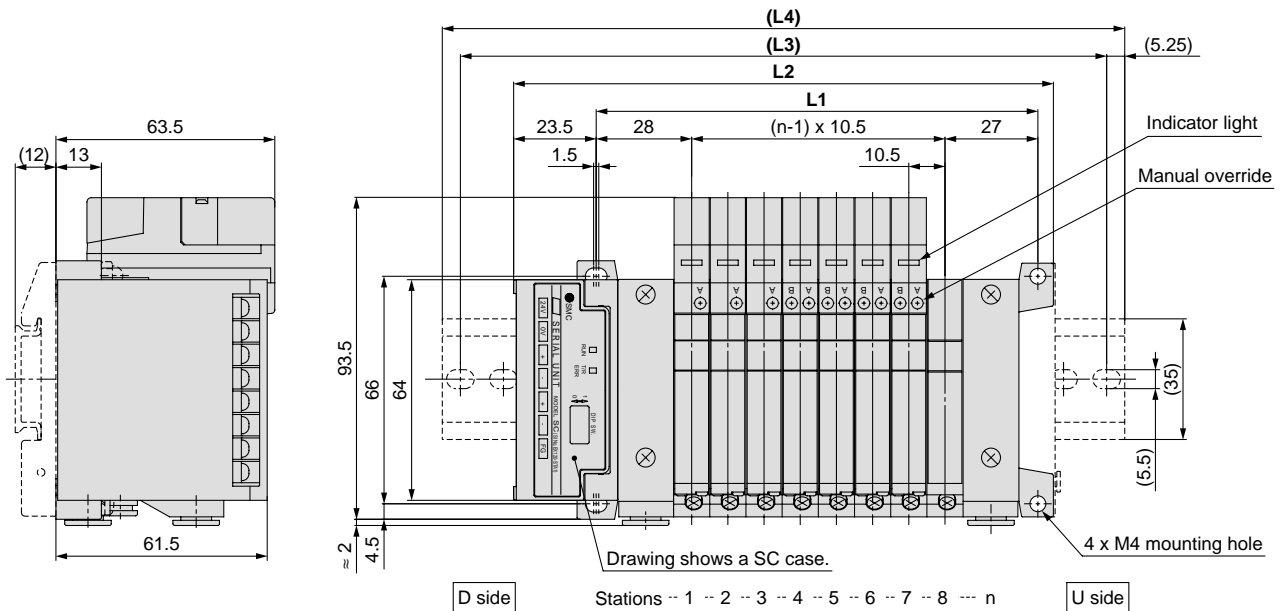

With ejector unit: Formula  
 $L1 = 10.5n + 28.7 + (\text{Number of ejector units} \times 26.7)$   
 $L2 = 10.5n + 56.3 + (\text{Number of ejector units} \times 26.7)$   
 $L4$  is  $L2$  plus about 30.

Dust-protected SI unit:  $L5 = 10.5n + 97$ ,  $L6 = L3 + 25$ ,  $L7 = L4 + 25$   
 Formula  $L1 = 10.5n + 44.5$ ,  $L2 = 10.5n + 72.5$     n: Station (Maximum 16 stations)


### Dimensions

L \ n	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16
<b>L1</b>	65.5	76	86.5	97	107.5	118	128.5	139	149.5	160	170.5	181	191.5	202	212.5
<b>L2</b>	93.5	104	114.5	125	135.5	146	156.5	167	177.5	188	198.5	209	219.5	230	240.5
<b>(L3)</b>	125	125	137.5	150	162.5	175	187.5	187.5	200	212.5	225	237.5	250	250	262.5
<b>(L4)</b>	135.5	135.5	148	160.5	173	185.5	198	198	210.5	223	235.5	248	260.5	260.5	273




# VV5Q21



The dashed lines indicate DIN rail mounting [-D] (with DIN rail mounting bracket).

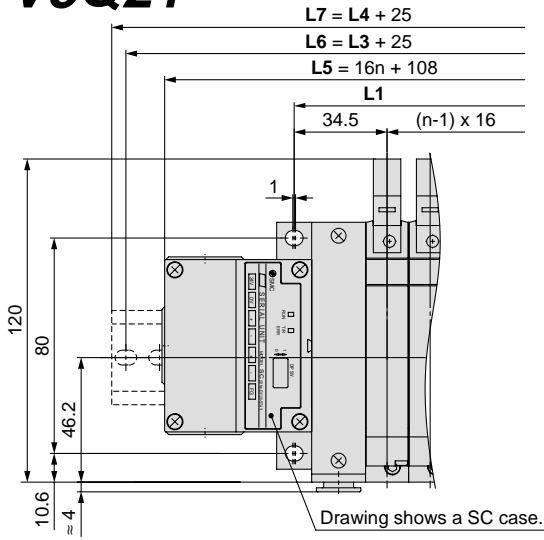

Dust-protected SI unit

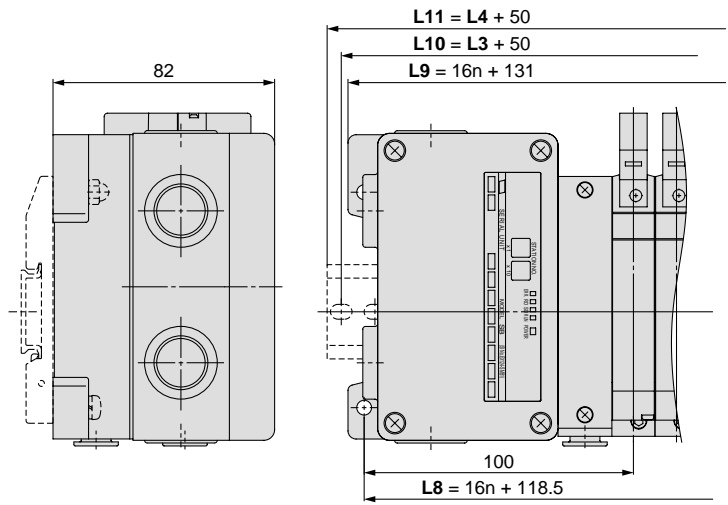

Dust-tight, Water-jet-proof (IP65) SI unit  
(EX123/124 Integrated-type (output) serial transmission system)

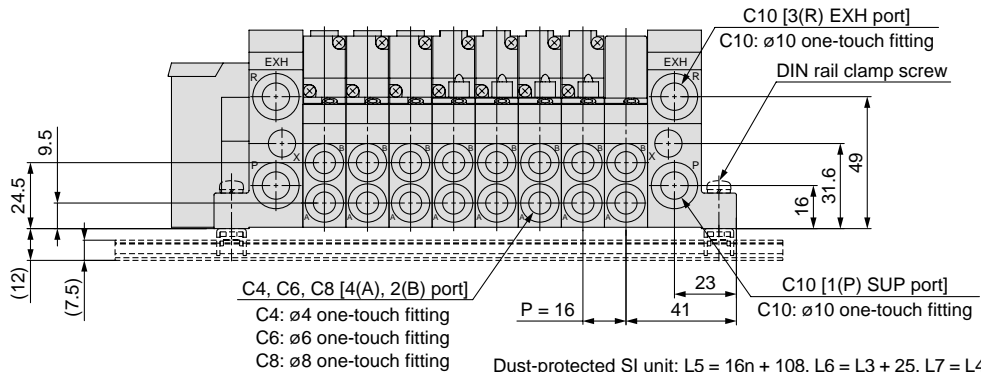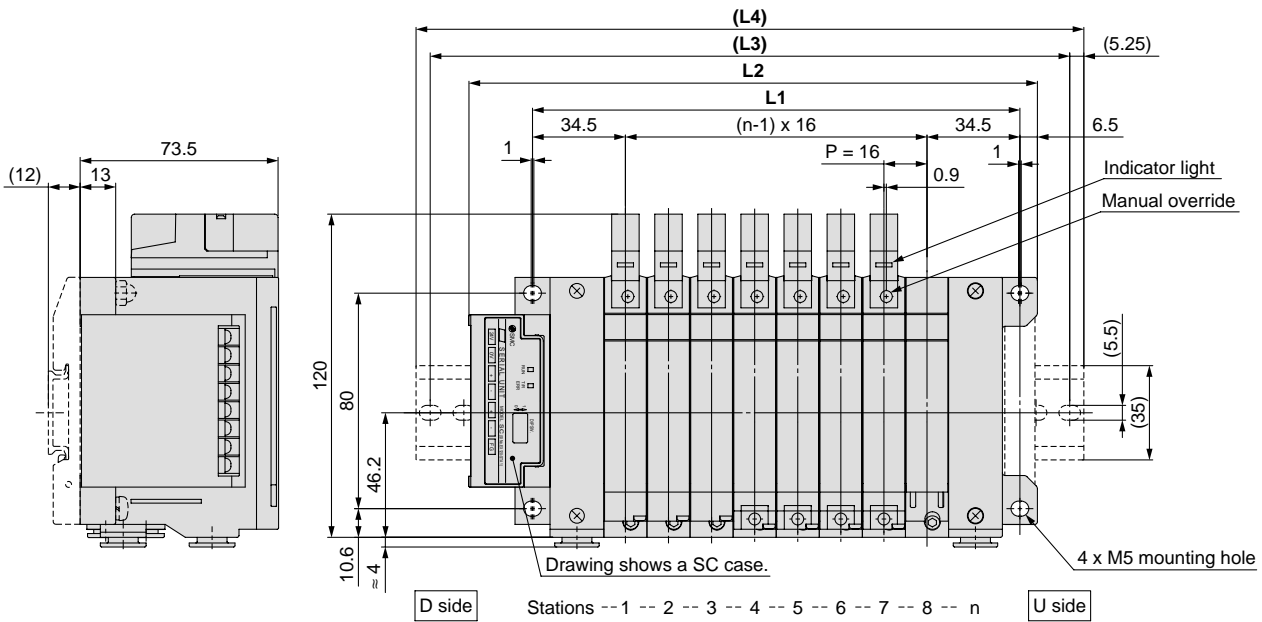

Dust-protected SI unit: L5 = 16n + 108, L6 = L3 + 25, L7 = L4 + 25  
Dust-tight, Water-jet-proof SI unit: L8 = 16n + 118.5, L9 = 16n + 131  
L10 = L3 + 50, L11 = L4 + 50

Formula L1 = 16n + 53, L2 = 16n + 83 n: Station (Maximum 16 stations)

## Dimensions

L \ n	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16
L1	85	101	117	133	149	165	181	197	213	229	245	261	277	293	309
L2	115	131	147	163	179	195	211	227	243	259	275	291	307	323	339
(L3)	137.5	162.5	175	187.5	200	225	237.5	250	262.5	287.5	300	312.5	337.5	350	362.5
(L4)	148	173	185.5	198	210.5	235.5	248	260.5	273	298	310.5	323	348	360.5	373

- F kit
- P kit
- J kit
- G kit
- T kit
- L kit
- S kit
- M kit
- Sub-plate  
Single Unit
- Semi-  
standard
- Construction
- Exploded  
View of  
Manifold
- Manifold  
Optional Parts
- Safety  
Instructions
- Specific  
Product  
Precautions




# Series VQ2000

kit (Serial transmission): For EX240 Integrated-type (I/O) serial transmission system

IP65 compliant

## VQ2000 only

- The serial transmission system reduces wiring work, while minimizing wiring and saving space.

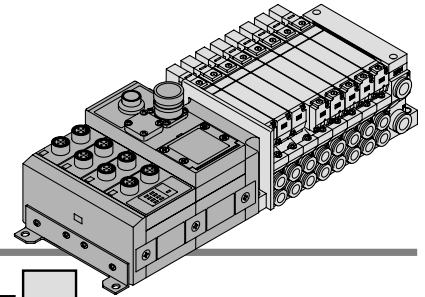

## How to Order Manifold

**VV5Q21 - 08 C6 S D QW 1 - N W -**

**VQ2000 Plug-in series**

**Stations**

01	1 station
⋮	⋮
16	16 stations

**Cylinder port**

Symbol	Port size
C4	With ø4 one-touch fitting
C6	With ø6 one-touch fitting
C8	With ø8 one-touch fitting
CM <small>Note 3</small>	Mixed sizes and with port plug
MM <small>Note 4</small>	Mixed size for different types of piping, option installed

**SI unit mounting**  
D: D side mounting

**CE compliant**

Nil	—
Q	CE compliant

**Enclosure IP65 (Dust-tight, Water-jet-proof)**

**Option**

Symbol	Option
Nil	None
B	With back pressure check valve
K	Special wiring spec. (Except double wiring)
N	With name plate
R	External pilot

Note) When two or more symbols are specified, indicate them alphabetically.  
Example: -BNR

**DI unit specifications**

Nil	PNP sensor input (+COM) or without SI/DI unit
N	NPN sensor input (-COM)

**Number of DI unit**

Nil	Without SI unit or DI unit
0	DI unit: None
1	DI unit: 1 pc.
2	DI unit: 2 pcs.
3	DI unit: 3 pcs.
4	DI unit: 4 pcs.

**Model**

0W	Without SI unit	
QW	DeviceNet™	+COM.
NWN	PROFIBUS-DP	-COM.

Note) Only +COM is available for DeviceNet™. Order a mounting valve with +COM. Since PROFIBUS is -COM only, order -COM for valves to be mounted.

**Refer to Best Pneumatics No. ① for details on the EX240 integrated-type (Output) serial transmission system.**

Note 1) Insert "L" (Top ported) or "B" (Bottom ported) for elbow type.  
Example) B6 (Bottom ported elbow with ø6 one-touch fitting)

Note 2) Indicate "LM" for models with elbow fittings and mixed cylinder port sizes.

Note 3) Indicate "Mixed sizes and with port plug" by means of the manifold specification sheet.

Note 4) When selecting the mixed size for different types of piping, dual flow fitting assembly, or double check block (direct mounting), enter "MM" and give instructions in the manifold specification sheet.

Note 5) Inch-size one-touch fittings are available. Refer to "Semi-standard" on page 57 for details.

## How to Order Manifold

**VQ 2 1 0 0 - 5 W 1 -**

**Seal**

0	Metal seal
1	Rubber seal

**Type of actuation**

1	2-position single
2	2-position double
3	3-position closed center
4	3-position exhaust center
5	3-position pressure center
A	4-position dual port (N.C. +N.C.)
B	4-position dual port (N.O. +N.O.)
C	4-position dual port (N.C. +N.O.)

**Enclosure IP65 (Dust-tight, Water-jet-proof)**

**CE compliant**

Nil	—
Q	CE compliant

\* Refer to "SI Unit Part No." when ordering the CE-compliant SI unit.

**Manual override**

Nil	Non-locking push type (Tool required)
B	Locking type (Tool required)
C	Locking type (Manual)
D	Slide locking type (Manual)

**Coil voltage**

5	24 VDC; With indicator light/surge voltage suppressor
---	---

**Function**


Symbol	Specifications	DC
Nil	Standard	(0.4 W) ○
B	High-speed response type	(0.95 W) ○
K <small>Note 1</small>	High-pressure type (1.0 MPa)	(0.95 W) ○
N <small>Note 2</small>	Negative common	○
R <small>Note 2</small>	External pilot	○

Note 1) Metal seal only  
Note 2) For external pilot and negative common specifications, refer to "Semi-standard" on pages 56 to 57.  
Note 3) When a valve is compatible with PROFIBUS DP, the SI unit is negative common. Select valves for negative common.  
Note 4) When two or more symbols are specified, indicate them alphabetically. Combination of [B] and [K] is not possible.

**Caution**  
Use the standard (DC) specification when continuously energizing for long periods of time.

# VV5Q21

(Serial transmission kit: EX240)

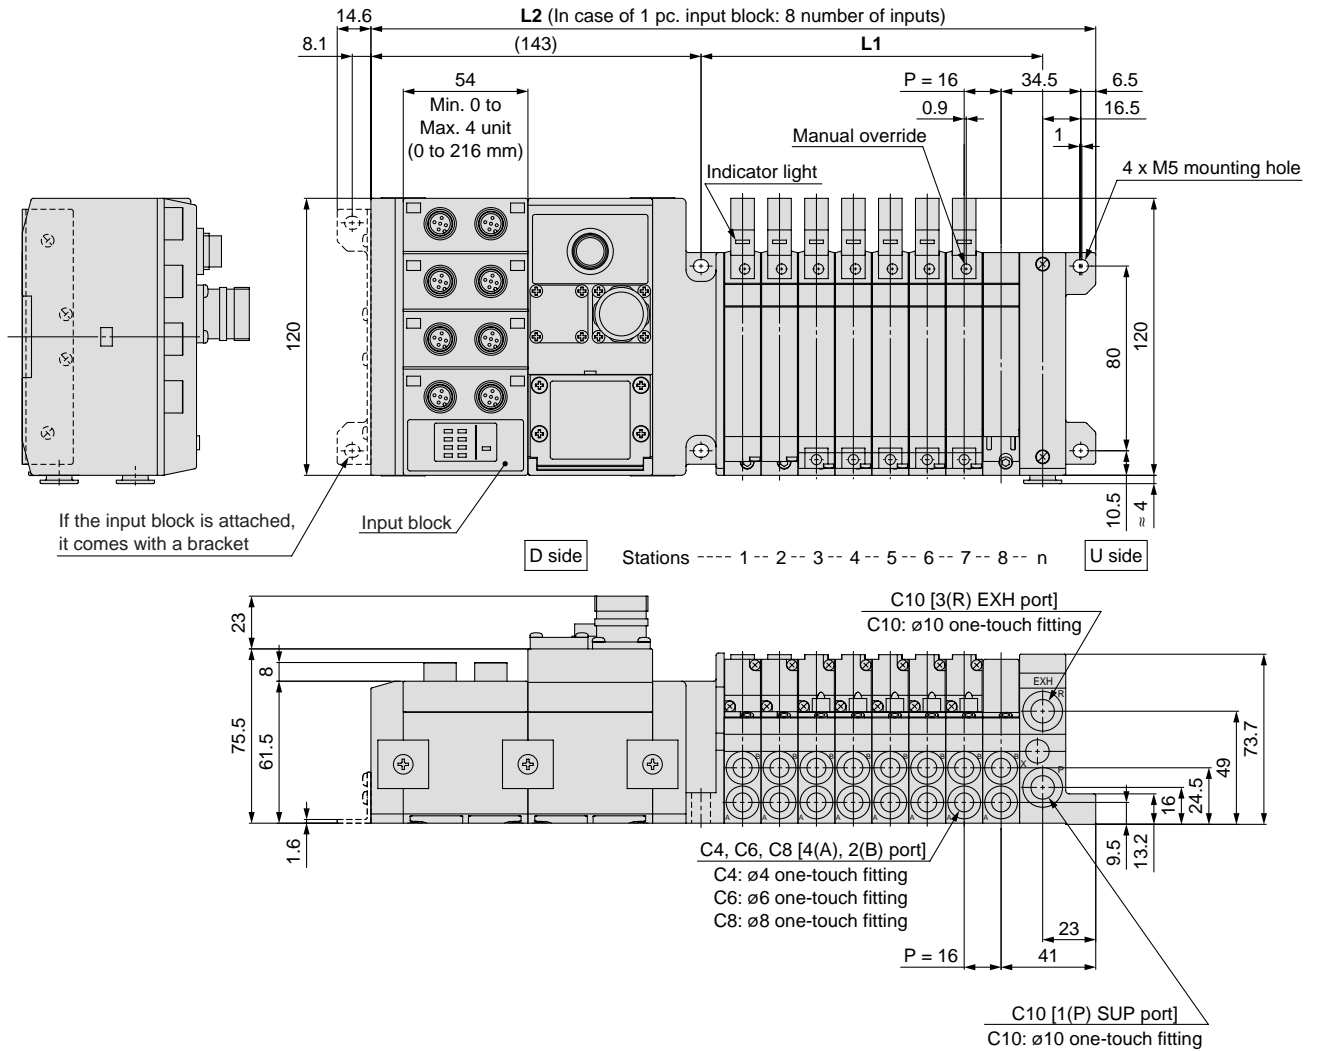

Formula  $L_1 = 16n + 36.5$   $L_2 = 16n + 186$  (In case of 1 pc. DI unit, 54 mm will be added for increasing every 1 pc.)  
 n: Station (Maximum 24 stations)

## Dimensions

L \ n	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24
<b>L1</b>	68.5	84.5	100.5	116.5	132.5	148.5	164.5	180.5	196.5	212.5	228.5	244.5	260.5	276.5	292.5	308.5	324.5	340.5	356.5	372.5	388.5	404.5	420.5
<b>L2</b>	218	234	250	266	282	298	314	330	346	362	378	394	410	426	442	458	474	490	506	522	538	554	570

F kit

P kit

J kit

G kit

T kit

L kit

S kit

M kit

Sub-plate  
Single Unit

Semi-  
standard

Construction


Exploded  
View of  
Manifold

Manifold  
Optional Parts

Safety  
Instructions

Specific  
Product  
Precautions

# M Series VQ2000 kit (Circular connector)



VQ2000 only

- MIL flat cable connector reduces installation labor for electrical connection.
- Manifold and connectors, both compliant with the IP65 rating (Dust-tight, Water-jet-proof), provide a high-degree of protection for the electrical parts.
- Maximum stations are 24.

## Manifold Specifications

Series	Piping specifications		Applicable stations
	Piping direction	Port size	
VQ2000	Side	1(P), 3(R)	C4, C6, M8
		4(A), 2(B)	

## Circular Connector (26 Pins)

## Cable Assembly ●

**AXT100-MC26-015**  
030  
050  
(Circular connector cable assembly included in a specific manifold model no.)  
Refer to "How to Order Manifold."

**Circular connector cable assembly**

Cable length (L)	Assembly part no.	Note
1.5 m	AXT100-MC26-015	Cable 25-core x 24AWG
3 m	AXT100-MC26-030	
5 m	AXT100-MC26-050	

\* Cannot be used for transfer wiring.

**Electrical characteristics**

Item	Property
Conductor resistance Ω/km, 20°C	65 or less
Voltage limit V, 1 min, AC	1000
Insulation resistance MΩ/km, 20°C	5 or more

Note) The minimum bending radius of the circular connector cable is 20 mm.

**Circular connector cable assembly terminal no.**

Terminal no.	Lead wire color	Dot marking
1	Black	None
2	Brown	None
3	Red	None
4	Orange	None
5	Yellow	None
6	Pink	None
7	Blue	None
8	Purple	White
9	Gray	Black
10	White	Black
11	White	Red
12	Yellow	Red
13	Orange	Red
14	Yellow	Black
15	Pink	Black
16	Blue	White
17	Purple	None
18	Gray	None
19	Orange	Black
20	Red	White
21	Brown	White
22	Pink	Red
23	Gray	Red
24	Black	White
25	White	None
26	White	None

Note) Lengths other than the above are also available. Please contact SMC for details.

## How to Order Manifold

**VV5Q 2 1 - 08 C6 M 1 - N W -**

**Series**  
2 VQ2000

**Manifold**  
1 Plug-in unit

**Stations**  
02 2 stations  
⋮ ⋮  
24 24 stations

**Cylinder port**

Symbol	Port size
C4	With ø4 one-touch fitting
C6	With ø6 one-touch fitting
C8	With ø8 one-touch fitting
CM Note 3)	Mixed sizes and with port plug
MM Note 4)	Mixed size for different types of piping, option installed

**Cable (Length)**

Symbol	Option
0	Without cable
1	With cable (1.5 m)
2	With cable (3 m)
3	With cable (5 m)

**Enclosure**  
IP65 (Dust-tight, Water-jet-proof)

**Option**

Symbol	Option
Nil	None
B Note 2)	With back pressure check valve
D	DIN rail mounting
D0	With DIN rail bracket (Without DIN rail)
D□ Note 3)	DIN rail mounting (□: Stations 02 to 24)
K Note 4)	Special wiring spec. (Except double wiring)
N	With name plate
R Note 5)	External pilot

**CE compliant**

Nil	—
Q	CE compliant

\* DC specification only

Note) Refer to page 56 for details.

Note 1) Insert "L" (Top ported) or "B" (Bottom ported) for elbow type. Example) B6 (Bottom ported elbow with ø6 one-touch fitting)

Note 2) Indicate "LM" for models with elbow fittings and mixed cylinder port sizes.

Note 3) Indicate "Mixed sizes and with port plug" by means of the manifold specification sheet.

Note 4) When selecting the mixed size for different types of piping, dual flow fitting assembly, or double check block (direct mounting), enter "MM" and give instructions in the manifold specification sheet.

Note 5) Inch-size one-touch fittings are available. Refer to "Semi-standard" on page 57 for details.


Note 1) When two or more symbols are specified, indicate them alphabetically. Example) -BKR

Note 2) Models with a suffix "-B" have check valves for prevention of back pressure at all manifold stations. When a back pressure check valve is desired, and is to be installed only in certain manifold stations, specify the mounting position by means of the manifold specification sheet.

Note 3) The number of stations that may be displayed is longer than the manifold number of stations.


Note 4) Specify the wiring specifications by means of the manifold specification sheet.

Note 5) Indicate "R" for the valve with external pilot.

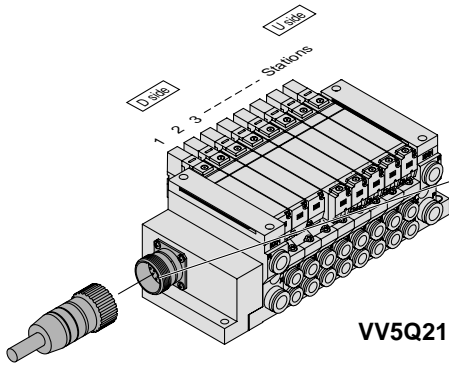

The total number of stations is tabulated starting from station one on the D-side.

● **Electrical Wiring Specifications**



As the standard electrical wiring specifications, double wiring (connected to SOL. A and SOL. B) is adopted for the internal wiring of each station for 12 stations or less, regardless of valve and option types. Mixed single and double wiring is available as semi-standard. Refer to page 56 for details.




Note) When using the negative common specifications, use valves for negative common. (Refer to page 56.) Refer to "Semi-standard" on page 56 for details.

**Circular connector cable assembly**  
015  
AXT100-MC26-030  
050 Wire color

Terminal no.	Polarity	Lead wire color	Dot marking	
Station 1 SOL.A 1	(-)	(+)	Black	None
Station 1 SOL.B 2	(-)	(+)	Brown	None
Station 2 SOL.A 3	(-)	(+)	Red	None
Station 2 SOL.B 4	(-)	(+)	Orange	None
Station 3 SOL.A 5	(-)	(+)	Yellow	None
Station 3 SOL.B 6	(-)	(+)	Pink	None
Station 4 SOL.A 7	(-)	(+)	Blue	None
Station 4 SOL.B 8	(-)	(+)	Purple	White
Station 5 SOL.A 9	(-)	(+)	Gray	Black
Station 5 SOL.B 10	(-)	(+)	White	Black
Station 6 SOL.A 11	(-)	(+)	White	Red
Station 6 SOL.B 12	(-)	(+)	Yellow	Red
Station 7 SOL.A 13	(-)	(+)	Orange	Red
Station 7 SOL.B 14	(-)	(+)	Yellow	Black
Station 8 SOL.A 15	(-)	(+)	Pink	Black
Station 8 SOL.B 16	(-)	(+)	Blue	White
Station 9 SOL.A 17	(-)	(+)	Purple	None
Station 9 SOL.B 18	(-)	(+)	Gray	None
Station 10 SOL.A 19	(-)	(+)	Orange	Black
Station 10 SOL.B 20	(-)	(+)	Red	White
Station 11 SOL.A 21	(-)	(+)	Brown	White
Station 11 SOL.B 22	(-)	(+)	Pink	Red
Station 12 SOL.A 23	(-)	(+)	Gray	Red
Station 12 SOL.B 24	(-)	(+)	Black	White
(Max.) COM. 25	(+)	Note (-)	White	None
COM. 26	(+)	Note (-)	White	None

Positive COM spec.      Negative COM spec.

**How to Order Valves**

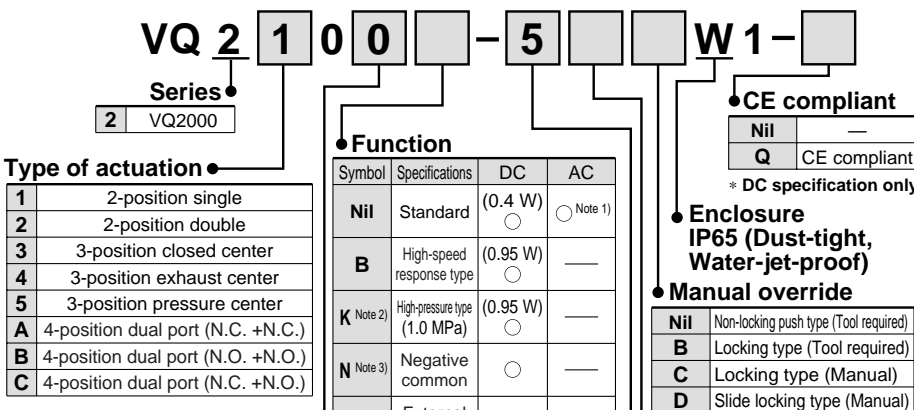

Note 1) For power consumption of AC type, refer to page 16.  
 Note 2) Metal seal only  
 Note 3) For external pilot and negative common specifications, refer to "Semi-standard" on pages 56 to 57.  
 Note 4) When two or more symbols are specified, indicate them alphabetically. Combination of [B] and [K] is not possible.

**Caution**  
 Use the standard (DC) specification when continuously energizing for long periods of time.


**How to Order Manifold Assembly**

Specify the part numbers for valves and options together beneath the manifold base part number.

**<Example>**  
 Circular connector kit with cable (3 m)  
 VV5Q21-09C6M2-W ... 1 set—Manifold base part no.  
 \*VQ2100-51 ... 3 sets—Valve part no. (Stations 1 to 3)  
 \*VQ2200-51 ... 3 sets—Valve part no. (Stations 4 to 6)  
 \*VQ2300-51 ... 2 sets—Valve part no. (Stations 7 to 8)  
 \*VVQ2000-10A-1 ... 1 set—Blanking plate part no. (Station 9)

Prefix the asterisk to the part nos. of the solenoid valve, etc.

Write sequentially from the 1st station on the D-side. When part nos. written collectively are complicated, specify them by means of the manifold specification sheet.

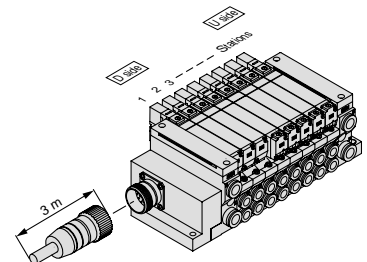



F kit  
 P kit  
 J kit  
 G kit  
 T kit  
 L kit  
 S kit  
 M kit  
 Sub-plate Single Unit  
 Semi-standard  
 Construction  
 Exploded View of Manifold  
 Manifold Optional Parts  
 Safety Instructions  
 Specific Product Precautions

# M Series VQ2000 kit (Circular connector)

## VV5Q21

< >: AC

The dashed lines and dimensions in parentheses indicate DIN rail mounting [-D].

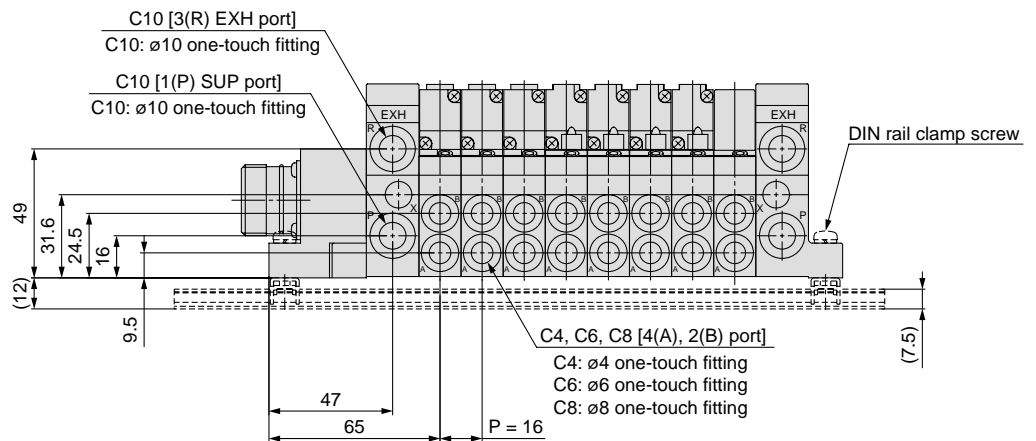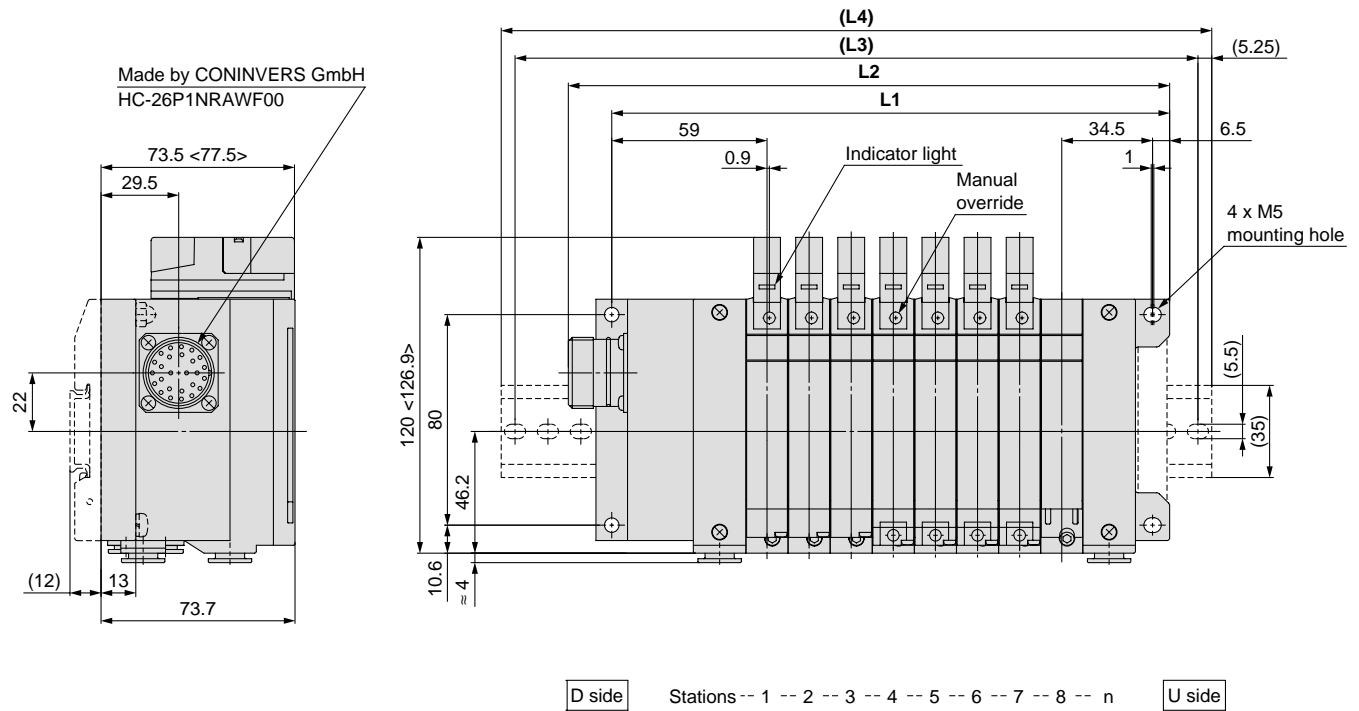

### Dimensions

Formula  $L1 = 16n + 77.5$ ,  $L2 = 16n + 100.5$     n: Station (Maximum 12 stations)

L \ n	2	3	4	5	6	7	8	9	10	11	12
L1	109.5	125.5	141.5	157.5	173.5	189.5	205.5	221.5	237.5	253.5	269.5
L2	132.5	148.5	164.5	180.5	196.5	212.5	228.5	244.5	260.5	276.5	292.5
(L3)	162.5	175	187.5	200	225	237.5	250	275	287.5	300	312.5
(L4)	173	185.5	198	210.5	235.5	248	260.5	285.5	298	310.5	323

# Sub-plate Single Unit



## VQ2000 Only

# Series VQ2000

### How to Order

IP65 enclosure in standard specifications

Easy-to-use terminal block



In the case of **Valve** + **Sub-plate**

VQ2 **1** **0** **0** - **5** **W** **1** - **02** **□** - **□**

Entry is the same as standard products.

Enclosure

Nil	Dust-protected
W Note 1)	IP65 (Dust-tight, Water-jet-proof)

Note 1) Valves are IP65 specifications.  
Note 2) When the valve is a standard (dust-protected) specification, it is not compatible with 200 or 220 VAC.

CE compliant

Nil	—
Q	CE compliant

\* DC specification only

Thread type

Nil	Rc
N	NPT
T	NPTF
F	G


In the case of **Sub-plate** alone

Port size

02	1/4
----	-----

## VQ2000 - PW - 02

### Dimensions

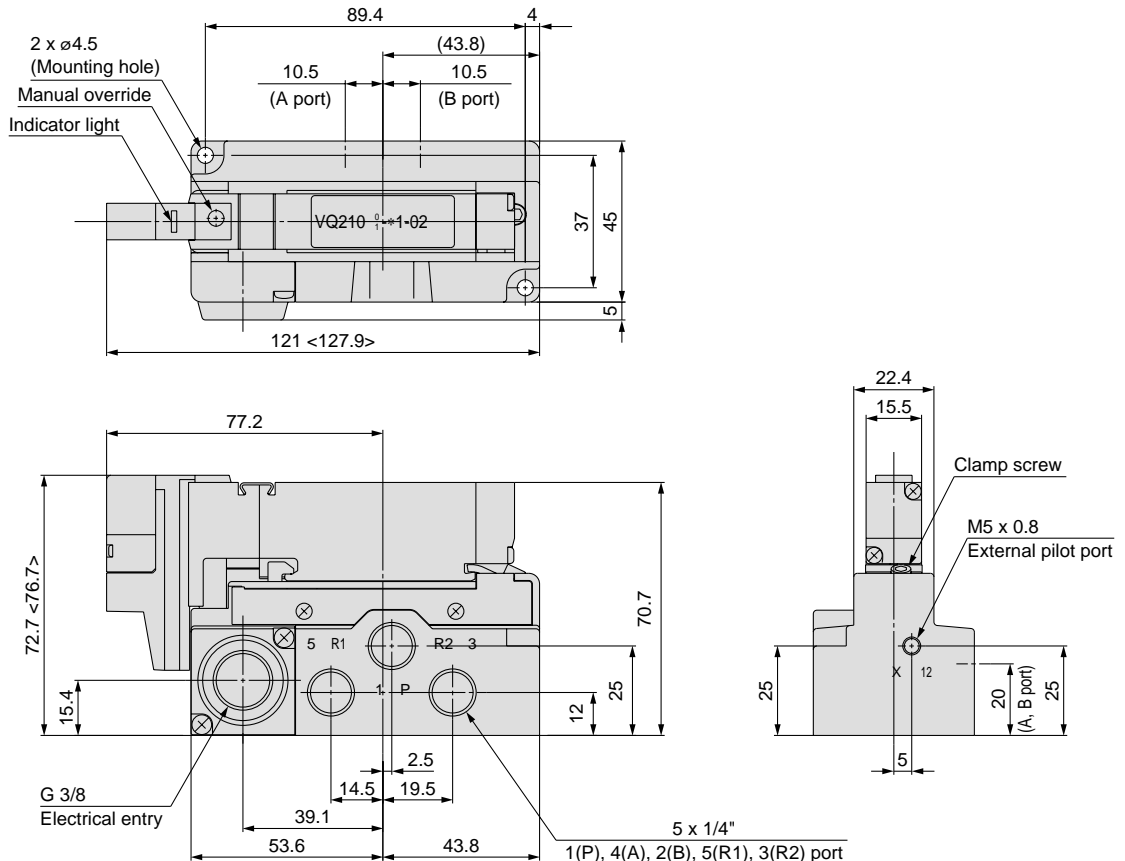

< >: AC

Note) When using this valve for IP65, mount a seal connector to the electrical entry.



- F kit
- P kit
- J kit
- G kit
- T kit
- L kit
- S kit
- M kit
- Sub-plate Single Unit
- Semi-standard
- Construction
- Exploded View of Manifold
- Manifold Optional Parts
- Safety Instructions
- Specific Product Precautions


# Series VQ1000/2000

## Semi-standard


### Different Number of Connector Pins

F and P kits with the following number of pins are available besides the standard number (F = 25P; P = 26P). Select the desired number of pins and cable length from the cable assembly list. Place an order for the cable assembly separately.

#### **F** kit (D-sub connector) 15 pins

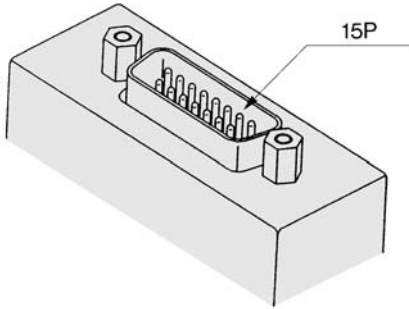


#### How to Order Manifold

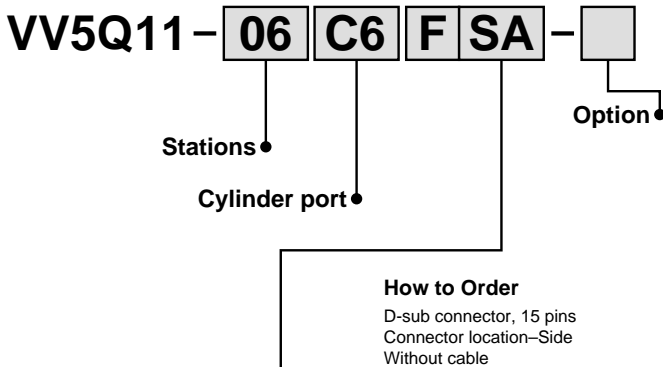

#### Kit type/Electrical entry

Pins	Location	Top entry		Side entry	
		F kit	UA	F kit	SA
15P (Max. 7 stations)		F kit	UA	F kit	SA

\* In the same way as the 25-pin models (standard), the terminal no. 1 is for SOL.A at the 1st station, the terminal no. 9 for SOL.B at the 1st station, and the terminal no. 8 for COM.

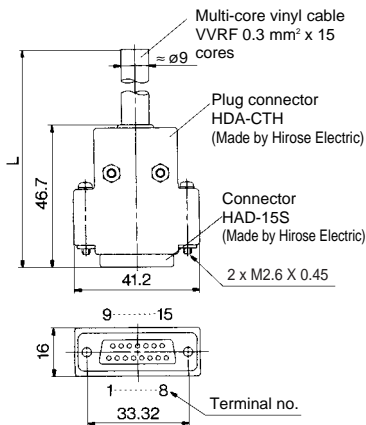

#### Wire Color Table by Terminal No. of D-sub Connector Cable Assembly


Terminal no.	Lead wire color	Dot marking
1	Black	None
2	Brown	None
3	Red	None
4	Orange	None
5	Yellow	None
6	Pink	None
7	Blue	None
8	Purple	White
9	Gray	Black
10	White	Black
11	White	Red
12	Yellow	Red
13	Orange	Red
14	Yellow	Black
15	Pink	Black

#### D-sub Connector Cable Assembly


Cable length (L)	Pins	15P
1.5 m		AXT100-DS15-1
3 m		AXT100-DS15-2
5 m		AXT100-DS15-3

\* For other commercial connectors, use a type conforming to MIL-C-24308.

#### **P** kit (Flat ribbon cable) 10/16/20 pins

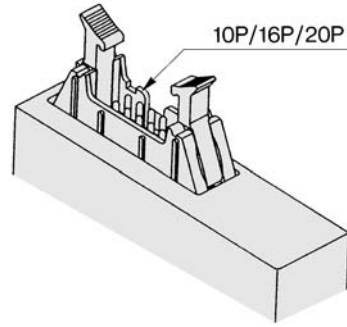


#### How to Order Manifold

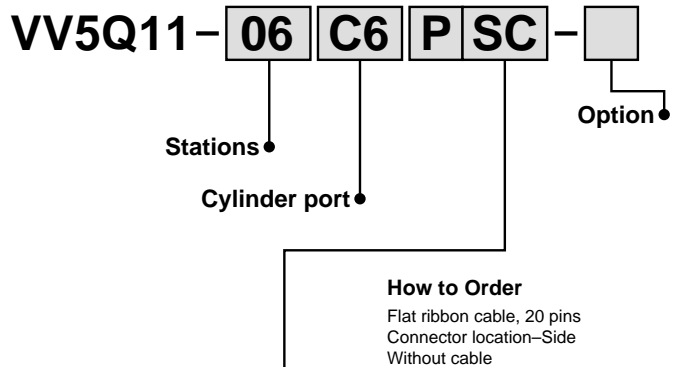

#### Kit type/Electrical entry

Pins	Location	Top entry		Side entry	
		P kit	UA	P kit	SA
10P (Max. 4 stations)		P kit	UA	P kit	SA
16P (Max. 7 stations)			UB		SB
20P (Max. 9 stations)			UC		SC

\* In the same way as the 26-pin models (standard), the terminal no. 1 is for SOL.A at the 1st station, the terminal no. 2 for SOL.B at the 1st station, and two pins from the max. terminal numbers are for COM.

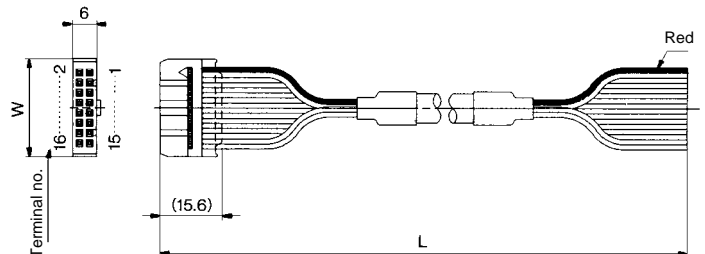

#### Flat Ribbon Cable Assembly

Cable length (L)	Pins	10P	16P	20P
1.5 m		AXT100-FC10-1	AXT100-FC16-1	AXT100-FC20-1
3 m		AXT100-FC10-2	AXT100-FC16-2	AXT100-FC20-2
5 m		AXT100-FC10-3	AXT100-FC16-3	AXT100-FC20-3
Connector width (W)		17.2	24.8	30

\* For other commercial connectors, use a type with strain relief conforming to MIL-C-83503.




## Special Wiring Specifications

In the internal wiring of F/P/J/G/T/S kit, double wiring (connected to SOL. A and SOL. B) is adopted for each station regardless of the valve and option types. Mixed single and double wiring is available as an option.

### 1. How to Order


Indicate an option symbol “-K”, for the manifold no. and be sure to specify the mounting position and number of stations of the single and double wiring by means of the manifold specification sheet.

Example) **VV5Q11-08C6FU1-D K S**

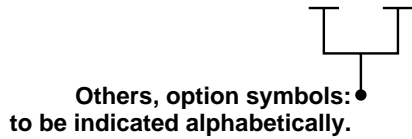

### 2. Wiring specifications

With the A side solenoid of the 1st station as no.1 (meaning, to be connected to no.1 terminal), without making any terminals vacant.

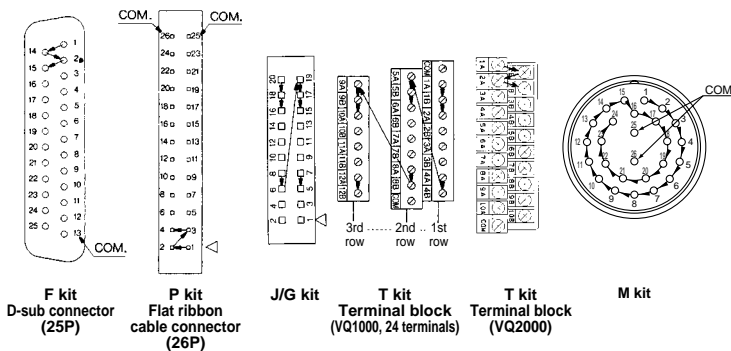

### 3. Max. number of stations

The maximum number of stations depends upon the number of solenoids. Assuming one for a single and two for a double, determine the number of stations so that the total number is not more than the max. number given in the following table.

Kit	F kit (D-sub connector)		P kit (Flat ribbon cable)				J kit (Flat ribbon cable)	G kit (Flat ribbon cable with terminal block)
Type	F <sub>S</sub> 25P	F <sub>S</sub> A 15P	P <sub>S</sub> 26P	P <sub>S</sub> C 20P	P <sub>S</sub> B 16P	P <sub>S</sub> A 10P	J <sub>S</sub> 20P	G
Max. points	24	14	24	18	14	8	16	16

Kit	T kit (Terminal block box)		S kit (Serial transmission)	M kit (Circular connector)
Type	VQ1000		S	M
	2 rows of terminal blocks	3 rows of terminal blocks		
Max. points	20		16	24

## Negative Common Specifications

Specify the valve model no. as shown below for negative common specification.

The manifold no. shown below is for the T (VQ1000) and L (VQ1000/2000) kits. For other kits the standard manifold can be used. However, negative common is not compatible with S (except EX510 gateway-type and EX240 integrated-type) and G kits.


### How to Order Valves

**VQ1100 N-51**




### How to Order Manifold

T kit (VQ1000):

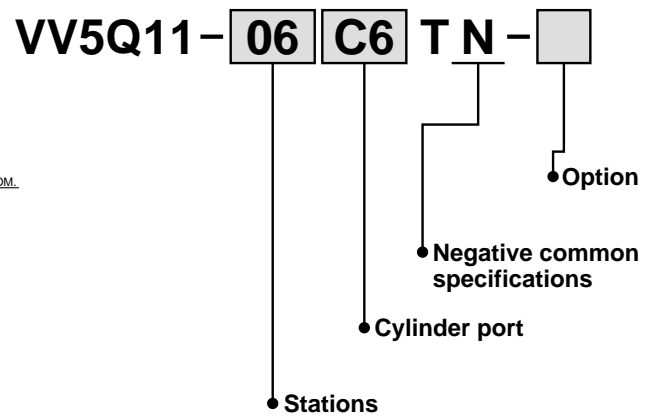

L kit (VQ1000/2000):

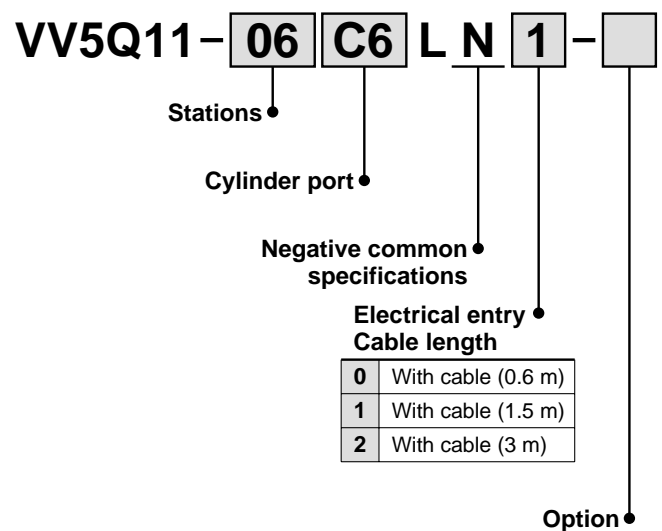

Electrical entry Cable length	
0	With cable (0.6 m)
1	With cable (1.5 m)
2	With cable (3 m)

- F kit
- P kit
- J kit
- G kit
- T kit
- L kit
- S kit
- M kit
- Sub-plate Single Unit
- Semi-standard
- Construction
- Exploded View of Manifold
- Manifold Optional Parts
- Safety Instructions
- Specific Product Precautions

# Series VQ1000/2000


## Semi-standard

### External Pilot Specifications

When the supply air pressure is lower than the required minimum operating pressure (0.1 to 0.2 MPa) for the solenoid valve (or when the valve is used for vacuum), specify an external pilot model. Order a manifold or valve by suffixing the external pilot specification, "R". The X-port of the manifold base is equipped with one-touch fittings for external pilot.  
 VQ1000: C4 (ø4 one-touch fitting)  
 VQ2000: C6 (ø6 one-touch fitting)

### How to Order Manifold

**VV5Q11-08C6FU1-R S**

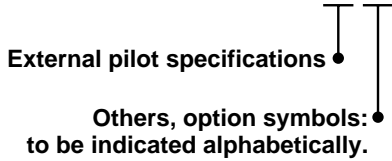

### How to Order Valves


**VQ1100 R - 51**



Note 1) When two or more functions are specified, indicate them alphabetically.  
 Note 2) Since the pilot EXH of this valve is released from the R1 passage, it is not possible to vacuum from a part other than EXH pressure and SUP ports.

### Inch-size One-touch Fittings

The valve with inch-size one-touch fittings is shown below.

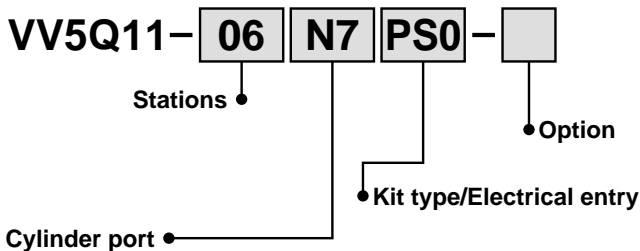

Symbol	N1	N3	N7	N9	M5T	NM
Applicable tubing O.D. (Inch)	ø1/8"	ø5/32"	ø1/4"	ø5/16"	10-32UNF (M5 thread)	Mixed
4(A), 2(B) port	<b>VQ1000</b>	●	●	—	●	●
	<b>VQ2000</b>	—	●	●	—	●

Note) When inch-size fittings are selected for the cylinder port, inch-size fittings are selected on 1(P), 3(R) port, too.

1(P), 3(R) port size  
 VQ1000 ..... ø5/16" (N9)  
 VQ2000 ..... ø3/8" (N11)

### DIN Rail Mounting

Each manifold can be mounted on a DIN rail. Order it by indicating a DIN rail mounting option symbol, "-D". In this case, a DIN rail which is approx. 30 mm longer than the manifold with the specified number of stations is attached.

- **When DIN rail is unnecessary (DIN rail mounting brackets only are attached.)**  
 Indicate the option symbol, -D0, for the manifold part number.

#### Example)

**VV5Q11-08C6FU1-D0S**

Others, option symbols: to be indicated alphabetically.

- **When using DIN rail longer than the manifold with specified number of stations**  
 Clearly indicate the necessary number of stations next to the option symbol "-D" for the manifold part number.

#### Example)

**VV5Q11-08C6FU1-D09S**

DIN rail for 9 stations

Others, option symbols: to be indicated alphabetically.


\*The number of stations that may be displayed is longer than the manifold number of stations.

- **When changing to a DIN rail mounting.**  
 Order brackets for mounting a DIN rail. (Refer to "Manifold Optional Parts" on pages 67 and 73.)

No. VVQ1000-57A (For VQ1000)  
 VVQ2000-57A (For VQ2000)  
 2 pcs. per one set.

- **When ordering DIN rail only**  
 DIN rail no.: AXT100-DR-□

\* As for □, specify the number from the DIN rail table. Refer to the dimensions of each kit for L dimension.

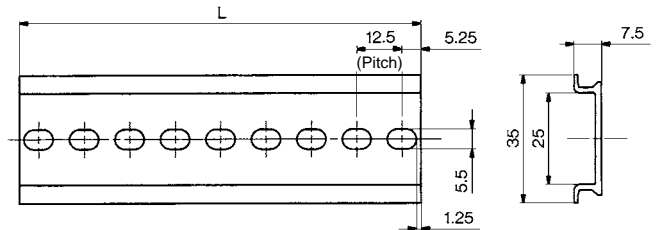

### L Dimension

$L = 12.5 \times n + 10.5$









No.	1	2	3	4	5	6	7	8	9	10
L dimension	23	35.5	48	60.5	73	85.5	98	110.5	123	135.5
No.	11	12	13	14	15	16	17	18	19	20
L dimension	148	160.5	173	185.5	198	210.5	223	235.5	248	260.5
No.	21	22	23	24	25	26	27	28	29	30
L dimension	273	285.5	298	310.5	323	335.5	348	360.5	373	385.5
No.	31	32	33	34	35	36	37	38	39	40
L dimension	398	410.5	423	435.5	448	460.5	473	485.5	498	510.5

Specific Product Precautions	Safety Instructions	Manifold Optional Parts	Exploded View of Manifold	Construction	<b>Semi-standard</b>	Sub-plate Single Unit	<b>M kit</b>	<b>S kit</b>	<b>L kit</b>	<b>T kit</b>	<b>G kit</b>	<b>J kit</b>	<b>P kit</b>	<b>F kit</b>
------------------------------	---------------------	-------------------------	---------------------------	--------------	----------------------	-----------------------	--------------	--------------	--------------	--------------	--------------	--------------	--------------	--------------













# Series VQ1000/2000 Construction

## VQ1000 Plug-in Unit: Main Parts/Replacement Parts

### Metal seal

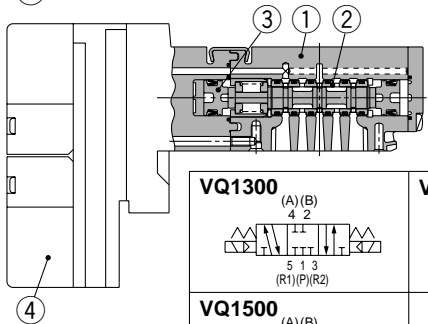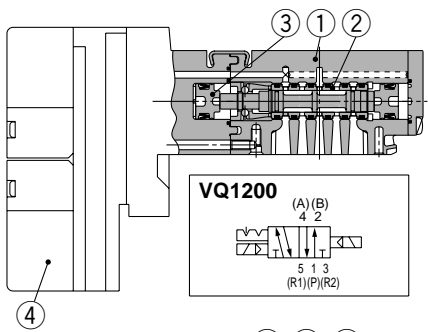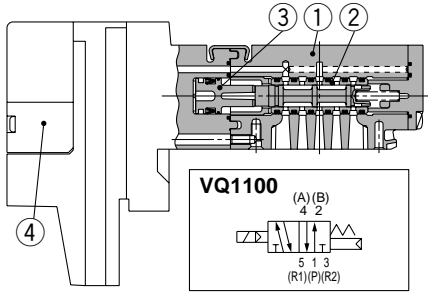

### Rubber seal

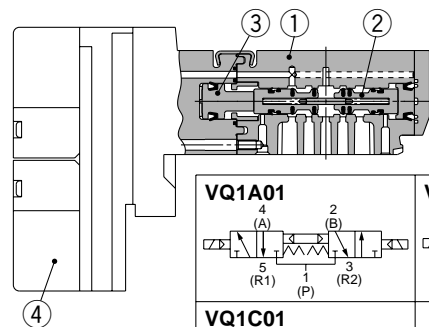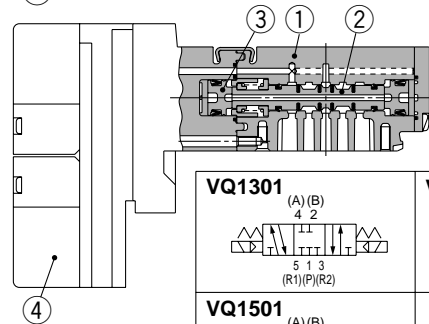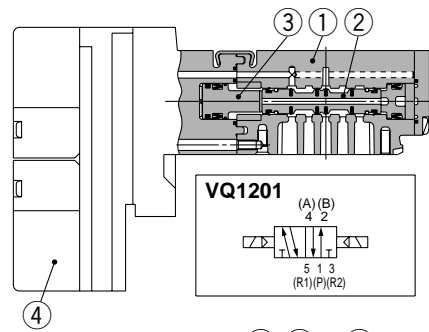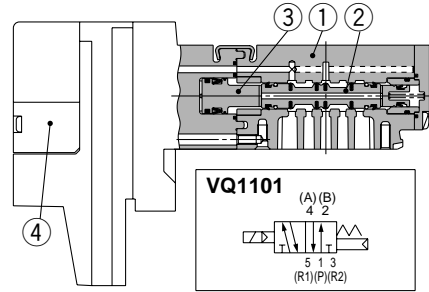

### Component Parts

No.	Description	Material	Note
1	Body	Zinc die-casted	
2	Spool/Sleeve	Stainless steel	
3	Piston	Resin	
4	Pilot valve assembly	—	

Note) Refer to page 62 for "How to Order Pilot Valve Assembly".


### Component Parts

No.	Description	Material	Note
1	Body	Zinc die-casted	
2	Spool valve	Aluminum, HNBR	
3	Piston	Resin	
4	Pilot valve assembly	—	

Note) Refer to page 62 for "How to Order Pilot Valve Assembly".

**VQ2000 Plug-in Unit: Main Parts/Replacement Parts**

**Metal seal**

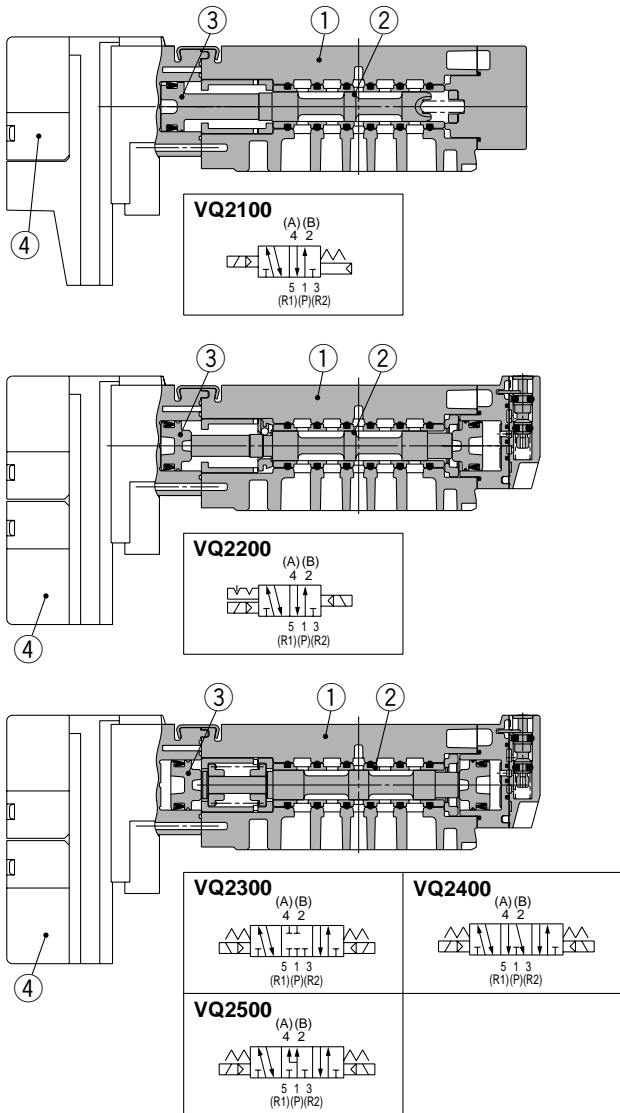


**Component Parts**

No.	Description	Material	Note
1	Body	Zinc die-casted	
2	Spool/Sleeve	Stainless steel	
3	Piston	Resin	
4	Pilot valve assembly	—	

Note) Refer to page 62 for "How to Order Pilot Valve Assembly".

**Rubber seal**

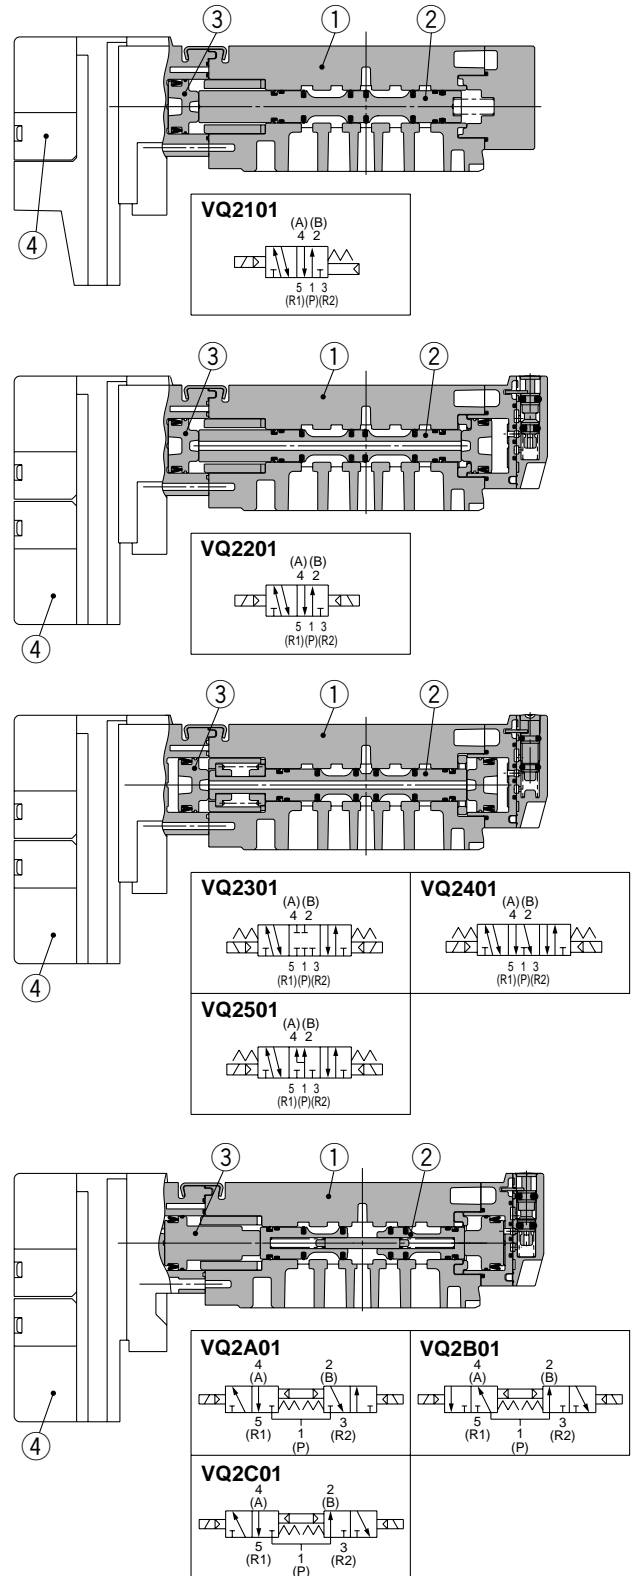

**Component Parts**

No.	Description	Material	Note
1	Body	Zinc die-casted	
2	Spool valve	Aluminum, HNBR	
3	Piston	Resin	
4	Pilot valve assembly	—	


Note) Refer to page 62 for "How to Order Pilot Valve Assembly".

F kit  
P kit  
J kit  
G kit  
T kit  
L kit  
S kit  
M kit  
Sub-plate  
Single Unit  
Semi-  
standard  
Construction  
Exploded  
View of  
Manifold  
Manifold  
Optional Parts  
Safety  
Instructions  
Specific  
Product  
Precautions

# Exploded View of Manifold

## VQ1000 Plug-in Unit: Exploded View

(F/P/J/L/S kit)

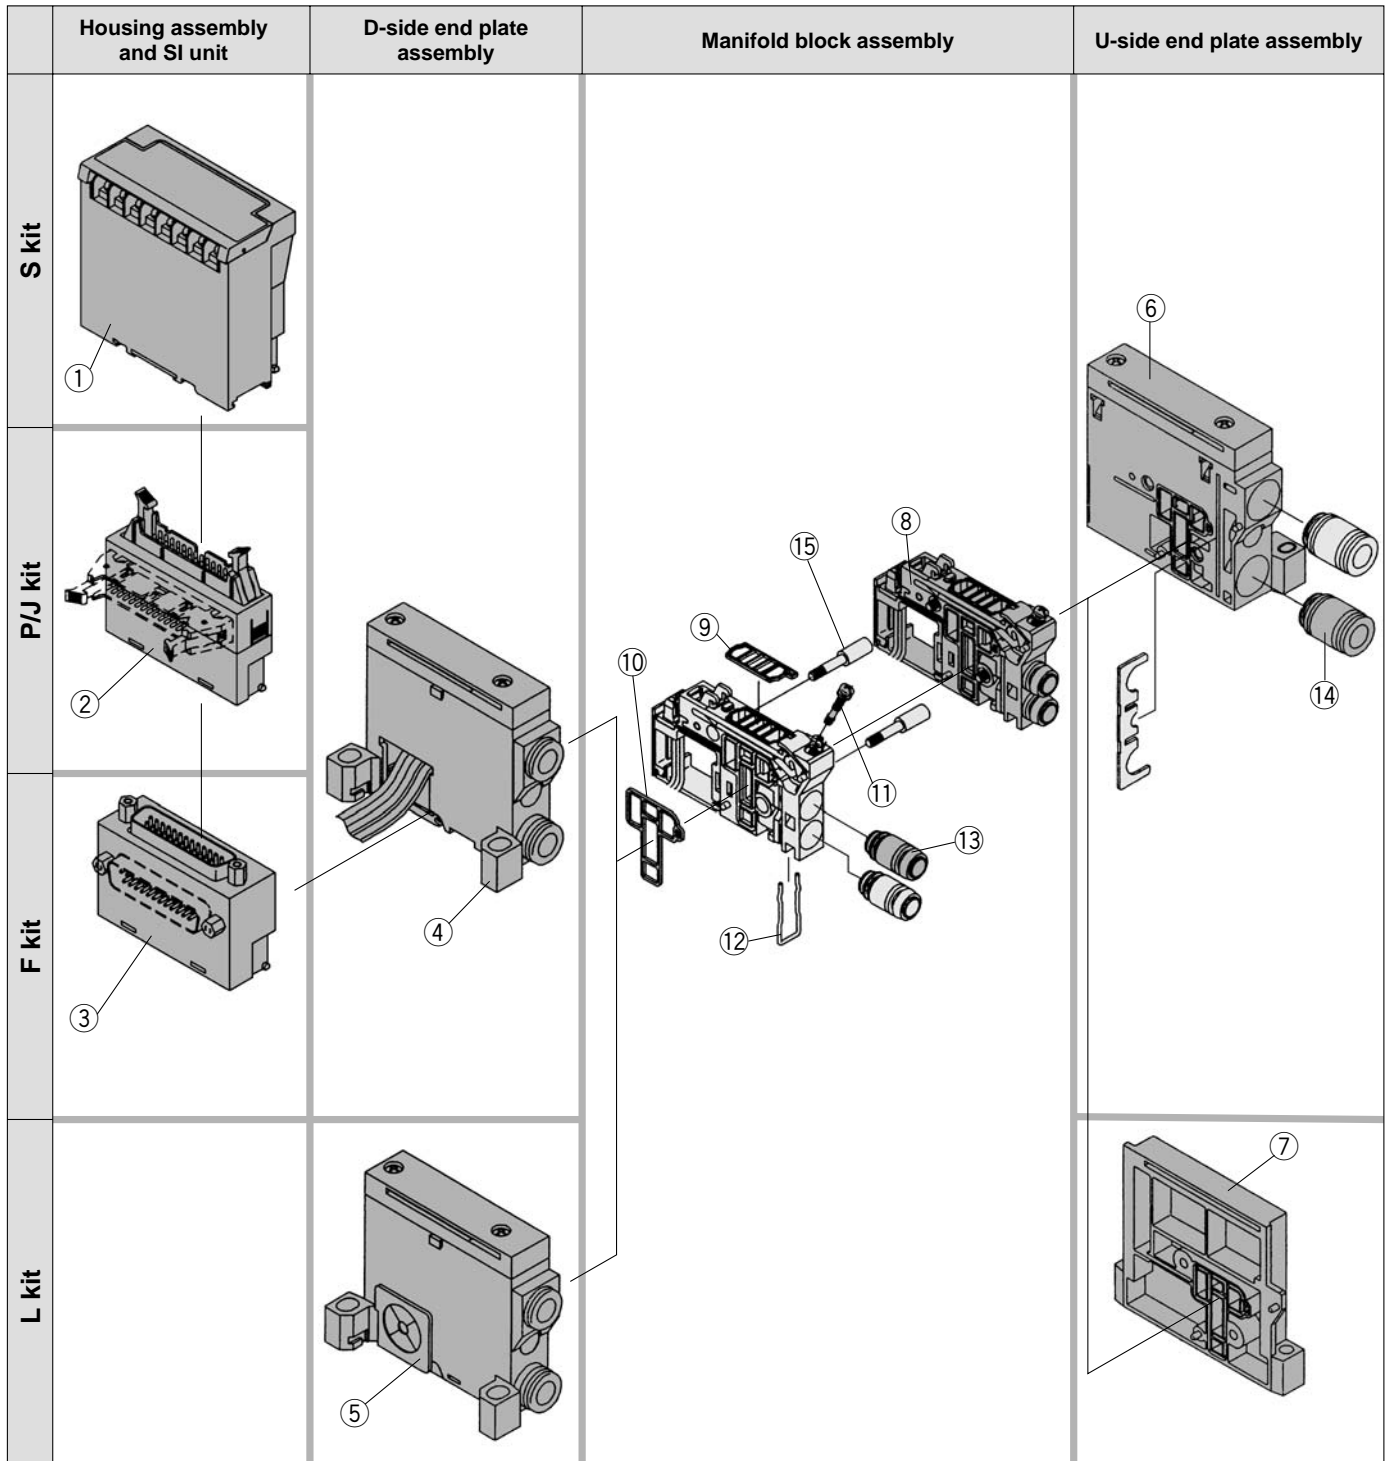

# Exploded View of Manifold

## <Housing Assembly and SI Unit>

Housing assembly and SI unit no.

No.	Manifold	Part no.	Description
①	(SF1 kit)	<b>EX120-SUW1(-XP)</b> <small>Note 2)</small>	NKE Corp.: Uni-wire System (16 outputs)
	(SH kit)	<b>EX120-SUH1(-XP)</b> <small>Note 2)</small>	NKE Corp.: Uni-wire H System (16 outputs)
	(SJ1 kit)	<b>EX120-SSL1(-XP)</b> <small>Note 2)</small>	SUNX Corp.: S-LINK System (16 outputs)
	(SJ2 kit)	<b>EX120-SSL2(-XP)</b> <small>Note 2)</small>	SUNX Corp.: S-LINK System (8 outputs)
	(SQ kit)	<b>EX120-SDN1</b>	DeviceNet™
	(SR1 kit)	<b>EX120-SCS1(-XP)</b> <small>Note 2)</small>	OMRON Corp.: CompoBus/S (16 outputs)
	(SR2 kit)	<b>EX120-SCS2(-XP)</b> <small>Note 2)</small>	OMRON Corp.: CompoBus/S (8 outputs)
	(SV kit)	<b>EX120-SMJ1(-XP)</b> <small>Note 2)</small>	CC-LINK
②	P <sub>S</sub> <sup>U</sup> kit	<b>AXT100-1-P<sub>S</sub><sup>U</sup></b> <small>Note 1)</small>	Flat ribbon cable housing assembly □ = Number of pins: 26/20/16/10
	J <sub>S</sub> <sup>U</sup> kit	<b>AXT100-1-J<sub>S</sub><sup>U</sup>20</b> <small>Note 1)</small>	Flat ribbon cable housing assembly
③	F <sub>g</sub> kit	<b>AXT100-1-F<sub>g</sub></b> <small>Note 1)</small>	D-sub connector housing assembly □ = Number of pins: 25/15

Note 1) Top entry connector for FU, PU, JU while side entry connector for FS, JS, PS.

Note 2) Suffix "-XP" to the end of the part number for dust-protected SI unit. (Not available for S/SQ kit)

## <D-Side End Plate Assembly>

④⑤ D-side end plate assembly no.

**VVQ1000-3A-1-**□-□

Electrical entry ● Option

<b>F</b>	For F kit	<b>Nil</b>	Common EXH
<b>P</b>	For P kit	<b>R</b> <small>Note 1)</small>	External pilot
<b>J</b>	For J kit	<b>S</b> <small>Note 1)</small>	Direct EXH outlet with built-in silencer
<b>L</b>	For L kit		
<b>S</b>	For S kit		

Note 1) When both options are specified, indicate as RS.

Note 2) The housing assembly and SI unit of F/P/J/S kit are not included. Separately place an order for ①, ②, ③.

## <U-Side End Plate Assembly>

⑥ U-side end plate assembly no. (For F/P/J/S kit)

**VVQ1000-2A-1-**□

● Option

<b>Nil</b>	Common EXH
<b>R</b>	External pilot
<b>S</b>	Direct EXH outlet with built-in silencer

Note) The ⑭'s fitting assembly is included.

⑦ U-side end plate assembly no. (For L kit)

**VVQ1000-2A-1-L**

## <Fitting Assembly>

⑬ Fitting assembly part no. (For cylinder port)

**VVQ1000-50A-**□

● Port size

<b>C3</b>	Applicable tubing ø3.2
<b>C4</b>	Applicable tubing ø4
<b>C6</b>	Applicable tubing ø6
<b>M5</b>	M5 thread

Note) Purchasing order is available in units of 10 pieces.

⑭ Fitting assembly part no. (For 1(P), 3(R) port)

**VVQ1000-51A-C8**

● Applicable tubing ø8

Note) Purchasing order is available in units of 10 pieces.

⑮ Tie-rod assembly part no. (2 pcs./set)

**VVQ1000-TR-**□

Note 1) Please order when eliminating manifold stations.

When adding stations, tie-rods are attached to the manifold block assembly. Therefore, it is not necessary to order.

Note 2) □: Stations 02 to 24

Note 3) For S/P/J/F/L kit

## Pilot valve assembly

**V112** □ - □ □

● Function

Symbol	Specifications	DC	AC
<b>Nil</b>	Standard	(0.4 W)	<small>Note 1)</small>
<b>B</b>	High-speed response type	(0.95 W)	—
<b>K</b>	High-pressure type (1.0 MPa)	(0.95 W)	—

● Coil voltage

<b>1</b>	100 VAC (50/60 Hz)
<b>2</b>	200 VAC (50/60 Hz)
<b>3</b>	110 VAC (50/60 Hz)
<b>4</b>	220 VAC (50/60 Hz)
<b>5</b>	24 VDC
<b>6</b>	12 VDC

● Enclosure

<b>A</b>	Dust-tight, Water-jet-proof (IP65)
<b>B</b>	Dust-protected

Note 1) Refer to page 16 for power consumption of AC type.

Note 2) Common to single solenoid and double solenoid

## <Manifold Block Assembly>

⑧ Manifold block assembly no.

**VVQ1000-1A-**□ - □

Electrical entry ●

Tie-rod (2 pcs.) and lead wire assembly for extensions are attached.

● Port size

<b>F0</b>	Without lead wire	<b>C3</b>	With ø3.2 one-touch fitting
<b>F1</b>	F kit for 2 to 12 stations/Double wiring	<b>C4</b>	With ø4 one-touch fitting
<b>F2</b>	F kit for 13 to 24 stations/Double wiring	<b>C6</b>	With ø6 one-touch fitting
<b>F3</b>	F kit for 2 to 24 stations/Single wiring	<b>M5</b>	M5 thread
<b>P1</b>	P/J/S kit for 2 to 12 stations/Double wiring	<b>C0</b>	Without one-touch fitting (With clip)
<b>P2</b>	P/J/S kit for 13 to 24 stations/Double wiring		
<b>P3</b>	P/J/S kit for 2 to 24 stations/Single wiring		
<b>L0</b> □	L0 kit □: Stations (1 to 8)		
<b>L1</b> □	L1 kit □: Stations (1 to 8)		
<b>L2</b> □	L2 kit □: Stations (1 to 8)		

## <Replacement Parts for Manifold Block>

### Replacement Parts

No.	Part no.	Description	Material	Quantity
⑨	<b>VVQ1000-80A-1</b>	Gasket	HNBR	12
⑩	<b>VVQ1000-80A-2</b>	Packing	HNBR	12
⑪	<b>VVQ1000-80A-3</b>	Clamp screw	Carbon steel	12
⑫	<b>VVQ1000-80A-4</b>	Clip	Stainless steel	12

Note) A set of parts containing 12 pcs. each is enclosed.

F kit

P kit

J kit

G kit

T kit

L kit

S kit

M kit

Sub-plate Single Unit

Semi-standard

Construction

Exploded View of Manifold

Manifold Optional Parts


Safety Instructions

Specific Product Precautions

# Exploded View of Manifold

## VQ2000 Plug-in Unit: Exploded View

(F/P/J/L/G/S kit)

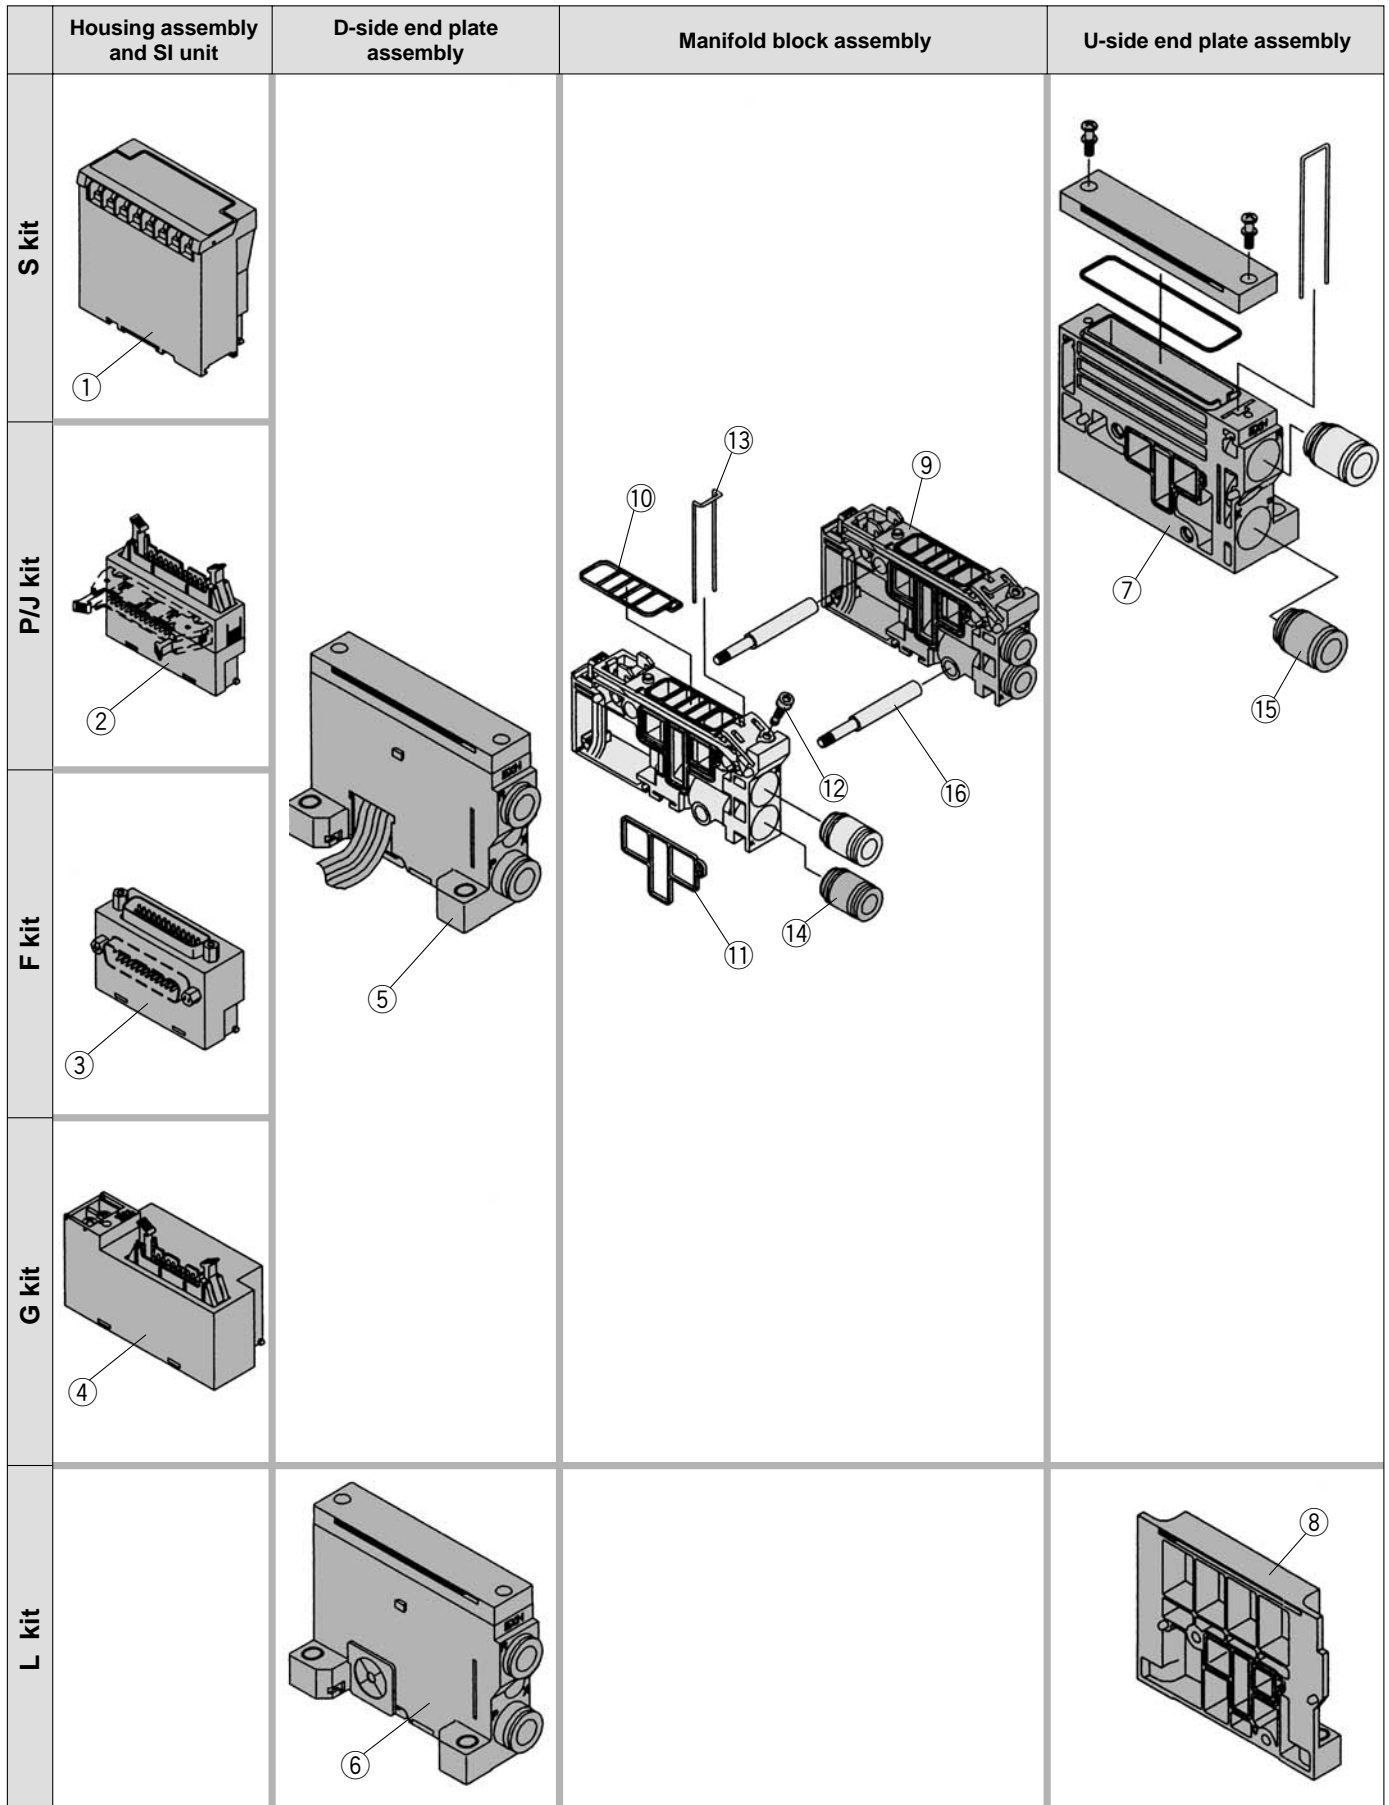



# Exploded View of Manifold

## <Housing Assembly and SI Unit> Housing assembly and SI unit no.

No.	Manifold	Part no.	Description
①	(SF1 kit)	EX120-SUW1(-XP) <sup>Note 1</sup> [EX123D-SUW1] <sup>Note 2</sup>	NKE Corp.: Uni-wire System (16 outputs)
	(SH1 kit)	EX120-SUH1(-XP) <sup>Note 1</sup> [EX123D-SUH1] <sup>Note 2</sup>	NKE Corp.: Uni-wire H System (16 outputs)
	(SJ1 kit)	EX120-SSL1(-XP) <sup>Note 1</sup> [EX123D-SSL1] <sup>Note 2</sup>	SUNX Corp.: S-LINK System (16 outputs)
	(SJ2 kit)	EX120-SSL2(-XP) <sup>Note 1</sup> [EX123D-SSL2] <sup>Note 2</sup>	SUNX Corp.: S-LINK System (8 outputs)
	(SQ kit)	EX120-SDN1 [EX124D-SDN1] <sup>Note 2</sup>	DeviceNet™
	(SR1 kit)	EX120-SCS1(-XP) <sup>Note 1</sup> [EX124D-SCS1] <sup>Note 2</sup>	OMRON Corp.: CompoBus/S (16 outputs)
	(SR2 kit)	EX120-SCS2(-XP) <sup>Note 1</sup> [EX124D-SCS2] <sup>Note 2</sup>	OMRON Corp.: CompoBus/S (8 outputs)
	(SV kit)	EX120-SMJ1(-XP) <sup>Note 1</sup> [EX124D-SMJ1] <sup>Note 2</sup>	CC-LINK
②	P <sub>S</sub> <sup>U</sup> kit	AXT100-1-P <sub>S</sub> <sup>U</sup> <sup>Note 3</sup>	Flat ribbon cable housing assembly □: Number of pins: 26/20/16/10
	J <sub>S</sub> <sup>U</sup> kit	AXT100-1-J <sub>S</sub> <sup>U</sup> <sup>Note 3</sup>	Flat ribbon cable housing assembly
③	F <sub>S</sub> <sup>U</sup> kit	AXT100-1-F <sub>S</sub> <sup>U</sup> <sup>Note 3</sup>	D-sub connector housing assembly □: Number of pins: 25/15
④	G kit	AXT100-1-GU20	Flat ribbon cable housing assembly with terminal block

Note 1) Suffix "-XP" to the end of the part number for dust-protected SI unit.

Note 2) Dust-tight, Water-jet-proof (IP65)

Note 3) Top entry connector for FU, PU, JU while side entry connector for FS, PS, JS.

## <D-Side End Plate Assembly>

### ⑤⑥ D-side end plate assembly no.

VVQ2000-3A-1-□-□-□

**Electrical entry**

F	For F kit
P	For P kit
J	For J kit
L	For L kit
G	For G kit
S	For S kit

**Enclosure**

Nil	Dust-protected
W	Dust-tight, Water-jet-proof (IP65)

Note) F/P/J/G kit are available with "Nil" only.  
M kit is available with [W] only.  
S/L/T kit are selectable depending on the manifold type.

**Option**

Nil	Common EXH
R <sup>Note 1</sup>	External pilot
S <sup>Note 1</sup>	Direct EXH outlet with built-in silencer

Note 1) When both options are specified, indicate as RS.

Note 2) The housing assembly and SI unit of F/P/J/G/S kit are not included.

Separately place an order for ①, ②, ③, ④.

Note 3) "S" (Built-in silencer) and "W" (IP65) cannot be combined.

## <U-Side End Plate Assembly>

### ⑦ U-side end plate assembly no. (For F/P/J/G/T/S/M kit)

VVQ2000-2A-1-□-□

**Option**

Nil	Common EXH
R	External pilot
S	Direct EXH outlet with built-in silencer

**Enclosure**

Nil	Dust-protected
W	Dust-tight, Water-jet-proof (IP65)

Note) F/P/J/G kit are available with "Nil" only.  
M kit is available with [W] only.  
S/T kit are selectable depending on the manifold type.

Note 1) The ⑮'s fitting assembly is included.  
Note 2) The housing assembly and SI unit of F/P/J/G/S kit are not included. Separately place an order for ①, ②, ③, ④.

Note 3) "S" (Built-in silencer) and "W" (IP65) cannot be combined.

### ⑧ U-side end plate assembly no. (For L kit)

VVQ2000-2A-1-L-□

**Enclosure**

Nil	Dust-protected
W	Dust-tight, Water-jet-proof (IP65)

Note) Select it depending on the manifold type.

## <Manifold Block Assembly>

### ⑨ Manifold block assembly no.

Tie-rod (2 pcs.) and lead wire assembly for extensions are attached.

VVQ2000-1A-□-□-□

**Electrical entry**

F0	Without lead wire
F1	F kit for 2 to 12 stations/Double wiring
F2	F kit for 13 to 24 stations/Double wiring
F3	F kit for 2 to 24 stations/Single wiring
P1	P/J/G/S kit for 2 to 12 stations/Double wiring
P2	P/J/G/S kit for 13 to 24 stations/Double wiring
P3	P/J/G/S kit for 2 to 24 stations/Single wiring
L0□	L0 kit □: Stations (1 to 8)
L1□	L1 kit □: Stations (1 to 8)
L2□	L2 kit □: Stations (1 to 8)
T1	T kit for 2 to 20 stations/Double wiring
T3	T kit for 2 to 20 stations/Single wiring
M1	M kit for 2 to 12 stations/Double wiring
M2	M kit for 13 to 24 stations/Double wiring
M3	M kit for 2 to 24 stations/Single wiring

**Port size**

C4	With ø4 one-touch fitting
C6	With ø6 one-touch fitting
C8	With ø8 one-touch fitting
C0	Without one-touch fitting (With clip)

**Enclosure**

Nil	Dust-protected
W	Dust-tight, Water-jet-proof (IP65)

Note) F/P/J/G kit are available with "Nil" only.  
M kit is available with [W] only.  
S/L/T kit are selectable depending on the manifold type.

## <Fitting Assembly>

### ⑭ Fitting assembly part no. (For cylinder port)

VVQ1000-51A-□

**Port size**

C4	Applicable tubing ø4
C6	Applicable tubing ø6
C8	Applicable tubing ø8

Note) Purchasing order is available in units of 10 pieces.

### ⑮ Fitting assembly part no. (For 1(P), 3(R) port)

VVQ2000-51A-C10

Applicable tubing ø10

Note) Purchasing order is available in units of 10 pieces.

### ⑯ Tie-rod assembly part no. (2 pcs./set)

VVQ2000-TR-□

Note 1) Please order when eliminating manifold stations.  
When adding stations, tie-rods are attached to the manifold block assembly. Therefore, it is not necessary to order.

Note 2) □: Stations 02 to 24

Note 3) For S/P/J/F/L kit

## <Replacement Parts for Manifold Block>

### Replacement Parts

No.	Part no.	Description	Material	Quantity
⑩	VVQ2000-80A-1	Gasket	HNBR	12
⑪	VVQ2000-80A-2	Seal	HNBR	12
⑫	VVQ2000-80A-3	Clamp screw	Carbon steel	12
⑬	VVQ2000-80A-4	Clip	Stainless steel	12


Note) A set of parts containing 12 pcs. each is enclosed.

F kit  
P kit  
J kit  
G kit  
T kit  
L kit  
S kit  
M kit  
Sub-plate Single Unit  
Semi-standard  
Construction  
Exploded View of Manifold  
Manifold Optional Parts  
Safety Instructions  
Specific Product Precautions


# Series VQ1000

## VQ1000: Manifold Optional Parts

### Blanking plate assembly VVQ1000-10A-1




It is used by attaching on the manifold block for being prepared for removing a valve for maintenance reasons or planning to mount a spare valve, etc.

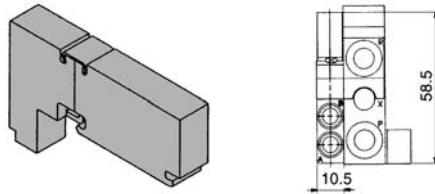

### Individual SUP spacer VVQ1000-P-1-C6-N7

When the same manifold is to be used for different pressures, individual SUP spacers are used as SUP ports for different pressures. (One station space is occupied.) Block both sides of the individual station, for which the supply pressure from the individual SUP spacer is used, with SUP block plates. (Refer to the application example.)


- \* Specify the spacer mounting position and SUP block plate position by means of the manifold specification sheet.
- The block plate is used in one or two places for one set. (Two SUP block plates for blocking SUP station are attached to the individual SUP spacer.)
- \* As a standard, electric wiring is connected to the position of the manifold station where the individual SUP spacer is mounted.
- \* If wiring is not required for stations equipped with spacers, enter "X" in the special wiring specifications column in the manifold specification sheet.

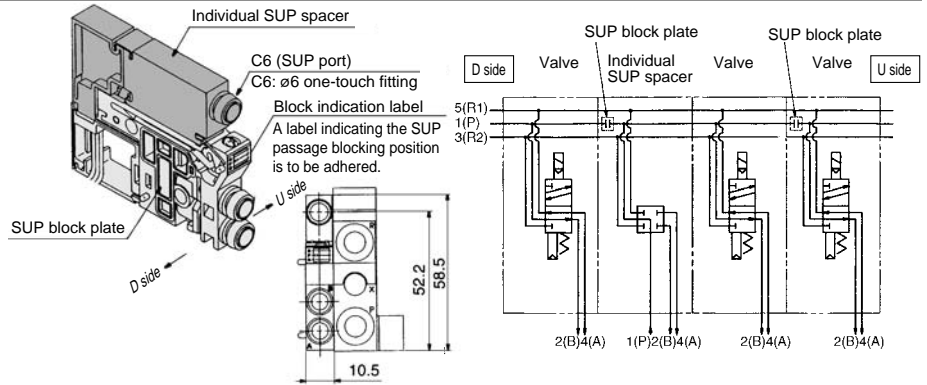

### Individual EXH spacer VVQ1000-R-1-C6-N7

When valve exhaust affects other stations due to the circuit configuration, this spacer is used for individual valve exhaust. (One station space is occupied.) Block both sides of the individual valve EXH station. (Refer to the application example.)

- \* Specify the mounting position, as well as the EXH block base or EXH block plate position by means of the manifold specification sheet. The block plate is used in one or two places for one set.
- \* An EXH block base assembly is used in the blocking position when ordering an EXH spacer incorporated with a manifold no. However, do not order an EXH block base assembly because it is attached to the spacer.
- When separately ordering an individual EXH spacer, separately order an EXH block base assembly because it is not attached to the spacer.
- \* As a standard, electric wiring is connected to the position of the manifold station where the individual EXH spacer is mounted.
- \* If wiring is not required for stations equipped with spacers, enter "X" in the special wiring specifications column in the manifold specification sheet.

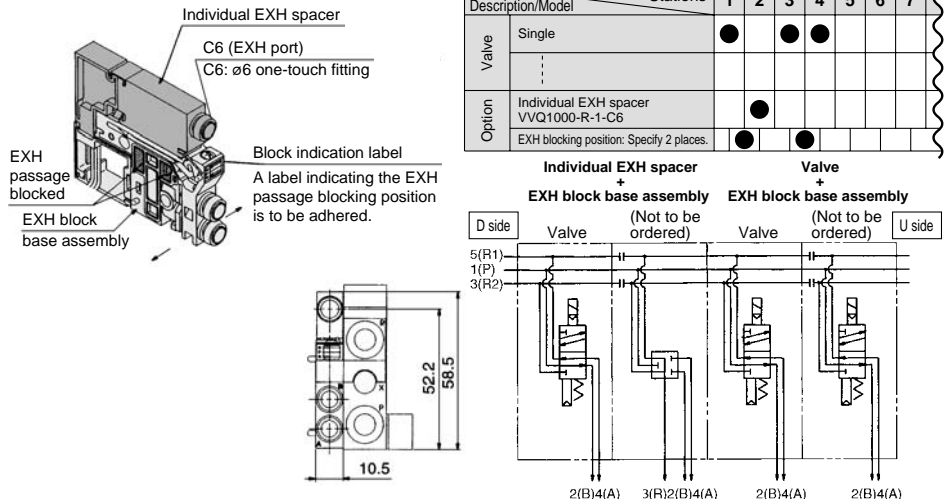

Description/Model		Stations						
Valve	Single	1	2	3	4	5	6	7
	Individual EXH spacer VVQ1000-R-1-C6							
Option	EXH blocking position: Specify 2 places.							

### SUP block plate VVQ1000-16A

When different pressures are supplied to a manifold, a SUP block plate is used to block the stations under different pressures.


- \* Specify the mounting position by means of the manifold specification sheet.




#### <Block indication label>

Indication labels to confirm the blocking position are attached (Each for SUP passage and SUP/EXH passage blocking positions).

- \* When ordering a block plate incorporated with a manifold, a block indication label is attached to the manifold.




SUP passage blocked



SUP/EXH passage blocked

### Blanking plate with connector VVQ1000-1C




Connector		Connector lead wire length (mm)			
Nil	Without connector	300	20	2000	
6	With connector/2-wire	600	25	2500	
10	With connector/2-wire	1000	30	3000	
2	With connector/4-wire	1500			

Connector lead wire length (mm)		Connector lead wire length (mm)			
Nil	300	20	2000		
6	600	25	2500		
10	1000	30	3000		
15	1500				


Blanking plate with a connector for individually outputting electricity to drive a single valve or equipment that are not on the manifold base.

- \* When "N" is suffixed to the end of the name plate, the plate will be different from a standard shape.
- Note) Electric current should be 1A or less (including the mounted valves).

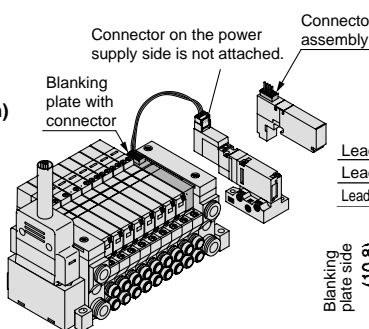

### Connector assembly part no. AXT661-43 A-6

Lead wire length (mm)		Lead wire length (mm)	
43	4-wire	Nil	300
44	2-wire	6	600
		10	1000
		20	2000
		30	3000

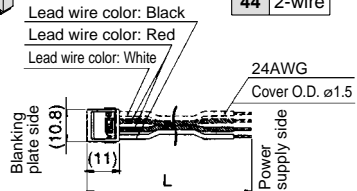

## EXH block base assembly

VVQ1000-19A-□-(C3/C4/C6/M5/N1/N3/N7)

### Manifold block assembly Electrical entry


F0	Without lead wire
F1	For F kit (2 to 12 stations)/Double wiring
F2	For F kit (13 to 24 stations)/Double wiring
F3	For F kit (2 to 24 stations)/Single wiring
P1	For P, G, T, S kit (2 to 12 stations)/Double wiring
P2	For P, G, T, S kit (13 to 24 stations)/Double wiring
P3	For P, G, T, S kit (2 to 24 stations)/Single wiring
L0*	L0 kit
L1*	L1 kit } * 1 to 8 stations
L2*	L2 kit }

The manifold block assembly is used between stations for which exhaust is desired to be divided when valve exhaust affects other stations due to the circuit configuration. The EXH passage on the D-side is blocked in the EXH block base assembly. It is also used in combination with an individual EXH spacer for individual exhaust.

### <Block indication label>


Indication labels to confirm the blocking position are attached. (Each for EXH passage and SUP/EXH passage blocking positions)

\* When ordering a EXH block base incorporated with a manifold, a block indication label is attached to the manifold.

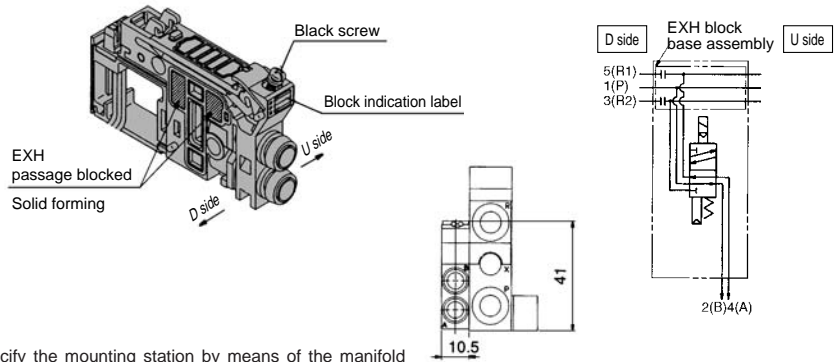


\* Specify the mounting station by means of the manifold specification sheet.

\* When ordering this option incorporated with a manifold, specify the EXH block base assembly part number with "\*" in front of it beneath the manifold part number.



EXH passage blocked



SUP/EXH passage blocked


## Back pressure check valve assembly [-B]

VVQ1000-18A

It prevents cylinder malfunction caused by other valve exhaust entry. Insert it into R (EXH) port on the manifold side of a valve which is affected. It is effective when a single-acting cylinder is used or an exhaust center type solenoid valve is used.

\* When ordering it being mounted on all manifold stations, suffix "B" to the end of the manifold part number.

Note) When a back pressure check valve is desired, and is to be installed only in certain manifold stations, clearly indicate the part number and specify the mounting station by means of the manifold specification sheet.

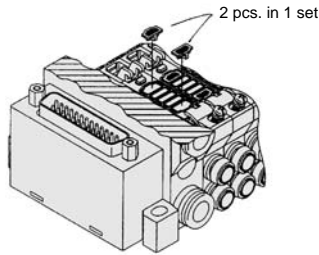

### (Precautions)

1. The back pressure check valve assembly is the parts with a check valve structure. However, since the valve has slight air leakage, take precautions for the exhaust air not to be restricted at the exhaust port.
2. When a back pressure check valve is mounted, the effective area of the valve will decrease by about 20%.

## Name plate [-N]



VVQ1000-<sup>N</sup>NC-N-Station (1 to Max. stations)

It is a transparent resin plate for placing a label that indicates solenoid valve function, etc. Insert it into the groove on the side of the end plate and bend it as shown in the figure.

\* When the blanking plate with connector is mounted, it automatically will be "VVQ1000-NC-n"

\* When ordering this option incorporated with a manifold, suffix "-N" to the end of the manifold part number.



N: Standard  
NC: For mounting blanking plate with connector

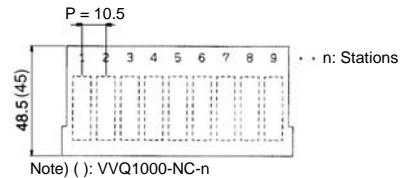

## Blanking plug (For one-touch fittings)

KQ2P-□

It is inserted into an unused cylinder port and SUP/EXH ports. Purchasing order is available in units of 10 pieces.



### Dimensions

Applicable fitting size ød	Model	A	L	D	Applicable fitting size ød	Model	A	L	D
3.2	KQ2P-23	16	31.5	3.2	1/8"	KQ2P-01	16	31.5	5
4	KQ2P-04	16	32	6	5/32"	KQ2P-03	16	32	6
6	KQ2P-06	18	35	8	1/4"	KQ2P-07	18	35	8.5
8	KQ2P-08	20.5	39	10	5/16"	KQ2P-09	20.5	39	10



## Port plug

VVQ0000-58A

The plug is used to block the cylinder port.

\* When ordering this option incorporated with a manifold, indicate "CM" for the port size of the manifold part number, as well as, the mounting station and cylinder port mounting positions 4(A) and 2(B) by means of the manifold specification sheet.

\* Gently screw an M3 screw in the port plug hole and pull it for removal.



## Elbow fitting assembly



VVQ1000-F-L(C3/C4/C6/M5/N1/N3/N7)

It is used for piping that extends upward or downward from the manifold.


\* When ordering this option incorporated with a manifold, indicate "L□" or "B□" for the manifold port size (when installed in all stations.)

When installing it in part of the manifold stations, specify the elbow fitting assembly part number and the mounting station by means of the manifold specification sheet.

\* When mounting elbow fitting assembly on the edge of manifold station and a silencer on EXH port, select a silencer, AN203-KM8. A silencer (AN200-KM8) is interfered with fittings.



Downward



Upward

F kit  
P kit  
J kit  
G kit  
T kit  
L kit  
S kit  
M kit  
Sub-plate Single Unit  
Semi-standard  
Construction  
Exploded View of Manifold  
Manifold Optional Parts  
Safety Instructions  
Specific Product Precautions



# Series VQ1000

## VQ1000: Manifold Optional Parts

### DIN rail mounting bracket [-D/-D0/-D□] VVQ1000-57A

It is used for mounting a manifold on a DIN rail.  
\* When ordering this option incorporated with a manifold, suffix "D" to the end of the manifold part number.

1 set of DIN rail mounting bracket is used for 1 manifold (2 DIN rail mounting brackets).

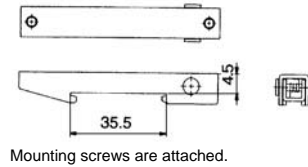


### Direct EXH outlet with built-in silencer [-S]

This is a type with an exhaust port at the top of the manifold end plate. The built-in silencer exhibits an excellent noise suppression effect. (Noise reduction: 30 dB)  
\* When ordering this option incorporated with a manifold, suffix "S" to the end of the manifold part number.

Note) A large quantity of drainage generated in the air source results in exhaust of air together with drainage.



● Refer to back page 5 for maintenance.





### Dual flow fitting assembly VVQ1000-52A-C<sub>8</sub>-N<sub>9</sub>

This is a fitting to multiply the flow rate by combining the outputs of 2 valve stations. It is used for driving a large bore cylinder. This is a one-touch fitting for a port size of  $\phi 8$  or  $\phi 5/16"$ .

\* The port size for the manifold part number is "CM".

Clearly indicate the dual flow fitting assembly part number and specify the mounting station by means of the manifold specifications.


\* In dual flow fitting assembly, a special clip which is combined in one-piece of 2 stations is attached as a holding clip.



### Silencer (For EXH port)

This silencer is to be inserted into the EXH port (one-touch fittings) of the common exhaust type.

\* When mounting elbow fitting assembly (VVQ1000-F-L□) on the edge of manifold station, select a silencer, AN203-KM8. A silencer (AN200-KM8) is interfered with fittings.

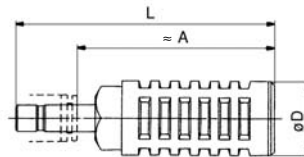

### Dimensions

Series	Applicable fitting size $\phi d$	Model	A	L	D	Effective area (mm <sup>2</sup> )	Noise reduction (dB)
VQ1000	8	AN200-KM8	59	78	22	20	30
		AN203-KM8	32	51	16	14	25*



### Regulator unit VVQ1000-AR-1

The regulator controls the SUP pressure in a manifold. Supply air from D-side SUP port is regulated. SUP port on U-side is plugged.

When a regulator unit is mounted, the SUP port on the U-side of the manifold will be plugged. A maximum of 3 units can be mounted on a manifold.

### Specifications

Maximum operating pressure (MPa)	0.8
Set pressure range (MPa)	0.05 to 0.7
Ambient and fluid temp. (°C)	5 to 50
Fluid	Air
Cracking pressure valve (MPa)	0.02
Structure	Relieving type

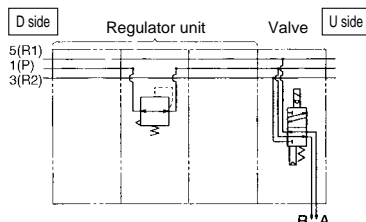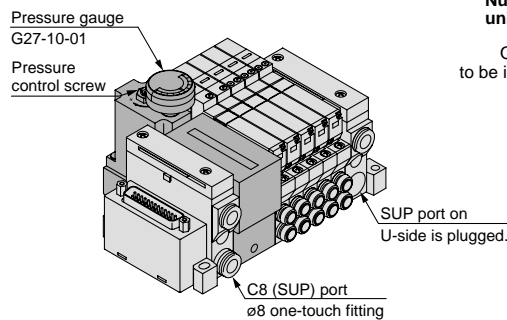



### • How to Order

Indicate an option symbol "G\*" for the manifold no. and be sure to specify the mounting position and number of stations by means of the manifold specification sheet. One unit is counted as one station and occupies a space for three stations, therefore, pay attention to the manifold size. The regulator valve unit, to which no wire is connected, valves can be mounted up to the standard max. number of stations of each kit.

### How to Order Manifold VV5Q11-14C6FUO-D-G 2


Number of manifold stations  
Number of mounted valves ... 12 sets  
+  
Number of regulator units ... 2 sets  
● With regulator unit

Others, option symbols: to be indicated alphabetically.




### Flow Characteristics

Conditions: Inlet pressure 0.7 MPa

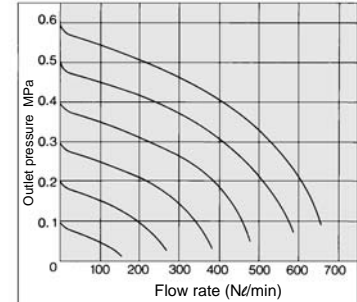

### Pressure Characteristics

Conditions (Initial setting) Inlet pressure 0.7 MPa, Outlet pressure 0.2 MPa

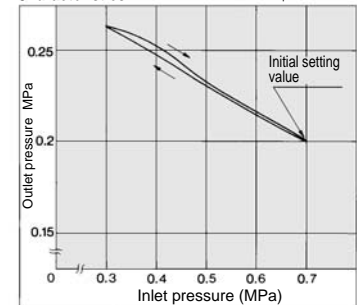

### ⚠ Caution

#### • Pressure setting

Check the inlet pressure and then turn the pressure control screw to set the outlet pressure. Turning the screw clockwise will increase the outlet pressure while turning it counterclockwise decrease the pressure. (Set the pressure by turning the screw in the increase direction.)

#### • Installation

Since some level of the actuator's operational frequency may lead to a sharp pressure change, pay attention to the pressure gauge durability.


**Double check block (Separated) for VQ1000**  
**VQ1000-FPG-□□-□**

It is used on the outlet side piping to keep the cylinder in the intermediate position for a long time. Combining the double check block with a built-in pilot type double check valve will enable the cylinder to stop in the middle or maintain its position for long periods of time.  
 The combination with a 2-position single/double solenoid valve will permit this block to be used for preventing the dropping at the cylinder stroke end when the SUP residual pressure is released.


**Specifications**

Max. operating pressure	0.8 MPa
Min. operating pressure	0.15 MPa
Ambient and fluid temp.	-5 to 50°C
Flow characteristics: C	0.60 dm <sup>3</sup> /(s·bar)
Max. operating frequency	180 c.p.m

Note) Based on JIS B 8375-1981  
 (Supply pressure: 0.5 MPa)

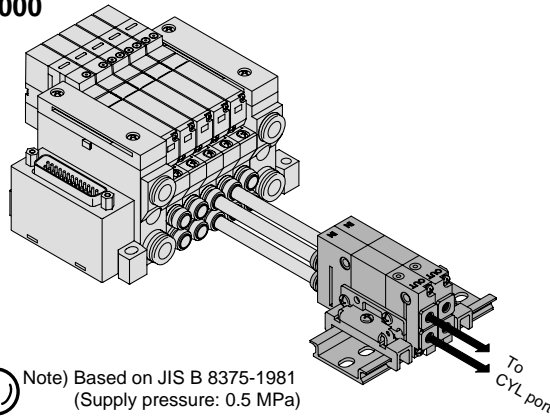


<Circuit diagram>

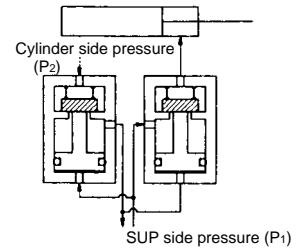


VVQ1000-FPG-02 1 set  
 \* VQ1000-FPG-C6M5-D 2 pcs.

**Dimensions**

**Single unit**

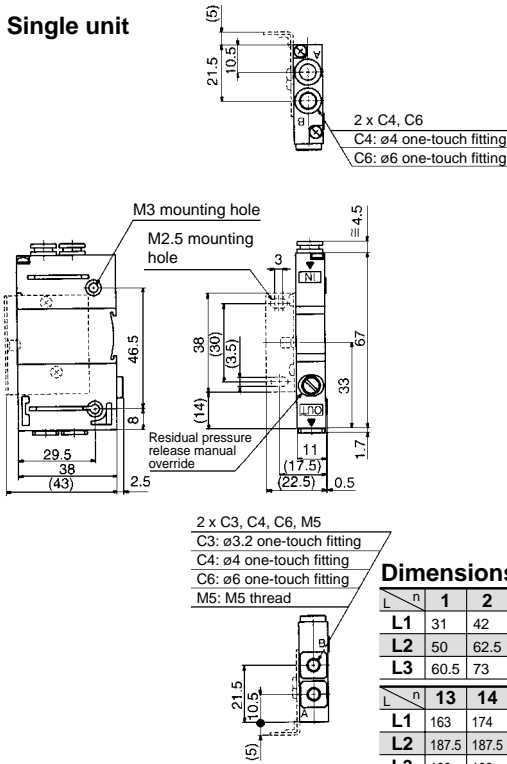

**Manifold**

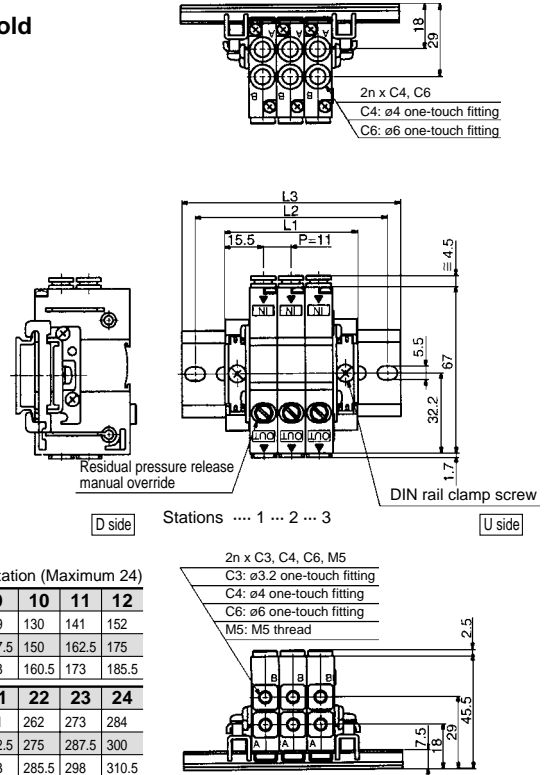

**Dimensions**

Formula L1 = 11n + 20 n: Station (Maximum 24)

L	n	1	2	3	4	5	6	7	8	9	10	11	12
L1		31	42	53	64	75	86	97	108	119	130	141	152
L2		60	62.5	75	87.5	100	112.5	125	137.5	150	162.5	175	
L3		60.5	73	85.5	98	110.5	123	135.5	148	160.5	173	185.5	

L	n	13	14	15	16	17	18	19	20	21	22	23	24
L1		163	174	185	196	207	218	229	240	251	262	273	284
L2		187.5	187.5	200	212.5	225	237.5	250	262.5	275	287.5	300	
L3		198	198	210.5	223	235.5	248	260.5	260.5	273	285.5	298	310.5

**How to Order**

**Double check block**  
**VQ1000-FPG-□□-□**

**IN side port size**

M5	M5 thread
C3	ø3.2 one-touch fitting
C4	ø4 one-touch fitting
C6	ø6 one-touch fitting
N3	ø5/32" one-touch fitting
N7	ø1/4" one-touch fitting

**OUT side port size**

M5	M5 thread
C3	ø3.2 one-touch fitting
C4	ø4 one-touch fitting
C6	ø6 one-touch fitting
N3	ø5/32" one-touch fitting
N7	ø1/4" one-touch fitting

**Option**

Nil	None
F	With bracket
D	DIN rail mounting (For manifold)
N	Name plate

Note) When two or more symbols are specified, indicate them alphabetically.  
 Example) -DN

**Manifold (DIN rail mounting)**

**VVQ1000-FPG-□□-□**

When ordering a double check block, order the DIN rail mounting [-D].

<Ordering example>

VVQ1000-FPG-06-6-station manifold  
 \*VQ1000-FPG-C4M5-D, 3 sets Double check block  
 \*VQ1000-FPG-C6M5-D, 3 sets

**Stations**


01	1 station
⋮	⋮
16	16 stations

**Bracket Assembly**

Part no.	Tightening torque
VQ1000-FPG-FB	0.22 to 0.25 N·m

**Caution**

- Air leakage from the pipe between the valve and cylinder or from the fittings will prevent the cylinder from stopping for long periods of time. Check the leakage using neutral household detergent, such as dish washing soap. Also check the cylinder's tube gasket, piston packing and rod packing for air leakage.
- Since one-touch fittings allow slight air leakage, screw piping (with M5 thread) is recommended when stopping the cylinder in the middle for long periods of time.
- Combining double check block with 3-position closed center or pressure center solenoid valve will not work.
- M5 fitting assembly is attached, not incorporated into the double check block. After screwing in the M5 fittings, mount the assembly on the double check block. (Tightening torque: 0.8 to 1.2 N·m)
- If the exhaust of the double check block is restricted too much, the cylinder may not operate properly and may not stop immediately.
- Set the cylinder load so that the cylinder pressure will be within two times that of the supply pressure.

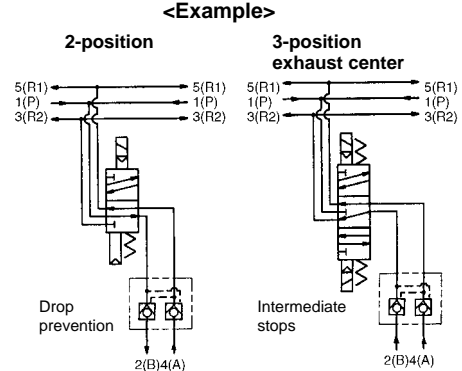


F kit  
 P kit  
 J kit  
 G kit  
 T kit  
 L kit  
 S kit  
 M kit  
 Sub-plate Single Unit  
 Semi-standard  
 Construction  
 Exploded View of Manifold  
 Manifold Optional Parts  
 Safety Instructions  
 Specific Product Precautions

# Series VQ1000

## VQ1000: Manifold Option/With Ejector Unit

An ejector unit can be mounted on the manifold base for a solenoid valve. Instead of mounting the valve and ejector unit separately, this option reduces piping, wiring and creates additional space savings.

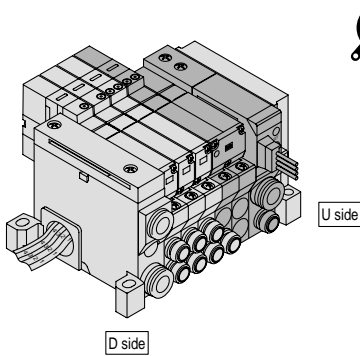

Note 1) SUP and EXH ports on the ejector unit manifold base are arranged on D-side alone. The end plate on the U-side is the same as that used in the L kit.

Note 2) Individual piping is provided for the supply and exhaust ports of the ejector unit.

Note 3) The manifold with an ejector unit is mounted from the U-side.

Note 4) One vacuum ejector unit corresponds to one station.

\* Specify the mounting station by means of the manifold specification sheet.

### Specifications

Ejector valve model	VVQ1000□-J□-□□1-A	VVQ1000□-J□-□□1-B
Nozzle diameter (mm)	0.7	1.0
Max. suction flow rate N (Nl/min)	11	20
Max. vacuum pressure (mmHg)	-630	
Max. operating pressure (MPa)	0.7 (High-pressure type 0.8)	
Standard supply pressure (MPa)	0.5	
Operating temperature (°C)	5 to 50	


### Maximum Number of Ejector Units

(Max. number of ejector units is subject to the number of valve stations.)

Max. number of ejector units	Max. number of mounted valves		
	F, P, T kit	S, G, J kit	L kit
1	11 (20)	7 (14)	7
2	10 (16)	6 (12)	6
3	9 (12)	5 (10)	5
4	8 (8)	4 (8)	—
5	4 (4)	3 (4)	—

Note) The max. number of mounted valves applies to double wiring. Parenthesized numbers apply to single wiring. Please contact SMC for conditions other than the above or mixed wiring.

## Dimensions

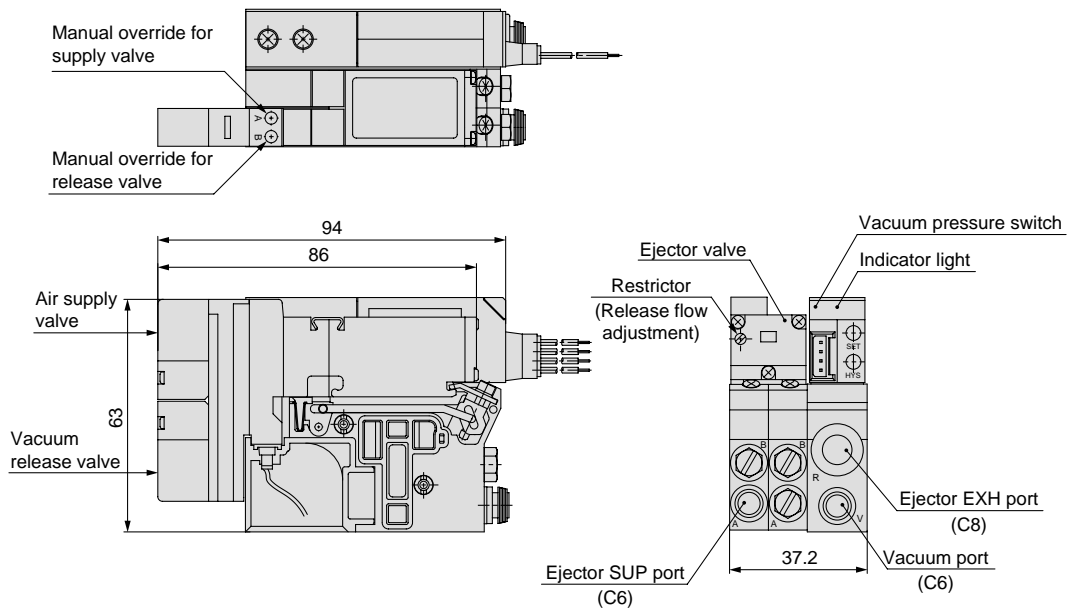

## How to Order

VV5Q11-05C6FUO-J P 1 S

Vacuum switch

Nil	None
P	With

Number of ejectors

1 to 5
--------

Others, option symbols: to be indicated alphabetically.

### Example)

VV5Q11-05C6FUO-JP1 ..... 1 set—Manifold part no.

\*VQ1100-51 ..... 2 sets—Valve part no. (Stations 1 to 2)


\*VQ1200-51 ..... 2 sets—Valve part no. (Stations 3 to 4)

\*VVQ1000-J1-51-A ..... 1 set—Ejector valve part no.

\*ZSE1-00-15CL ..... 1 set—Vacuum switch part no.

Note 1) Count one ejector unit as one manifold station.  
 Note 2) The ejector unit is mounted next to the U-side end plate.  
 Note 3) The U-side end plate is used exclusively for ejector units. (Without P and R port)  
 Note 4) The dimension of manifold with an ejector unit is different from the standard dimension. See the formula for calculating the dimensions for each kit.

### How to Order Ejector Valves



VVQ1000    - J 1 - 5 C 1 - A

#### Function

Symbol	Specifications	DC	AC
Nil	Standard	(0.4 W) ○	○ (Note 1)
B	High-speed response type	(0.95 W) ○	—
K	High-pressure type (0.8 MPa)	(0.95 W) ○	—
N	Negative common	○	—



Note 1) For power consumption of AC type, refer to page 16.  
Note 2) When two or more symbols are specified, indicate them alphabetically. Combination of [B] and [K] is not possible.

#### Specifications

Symbol	Nozzle diameter	Vacuum release valve
A	0.7	With
B	1.0	

#### Coil voltage

1	100 VAC (50/60 Hz)
2	200 VAC (50/60 Hz)
3	110 VAC (50/60 Hz)
4	220 VAC (50/60 Hz)
5	24 VDC
6	12 VDC


#### Manual override

Nil	Non-locking push type
B	Locking type (Tool required)
C	Locking type (Manual)
D	Slide locking type (Manual)

#### Manifold

1	Plug-in unit
---	--------------

### How to Order Vacuum Pressure Switches



ZSE1-00-    15    CL

#### Switch spec./Voltage (Solid state: 12 to 24 VDC)

14	1 setting, Without analog output, 3 revolution adjustment
15	1 setting, Without analog output, 200° adjustment
16	2 setting, Without analog output, 3 revolution adjustment
17	2 setting, Without analog output, 200° adjustment
18	1 setting, With analog output, 3 revolution adjustment
19	1 setting, With analog output, 200° adjustment

#### Wiring specifications

Nil	Grommet type, Lead wire length 0.6 m
L	Grommet type, Lead wire length 3 m
C	Connector type, Lead wire length 0.6 m
CL	Connector type, Lead wire length 3 m
CN	Without connector (Note)

Note) When ordering the switch with 5 m lead wire length, order separately the switch without connector and the connector. (Refer to the below.) Besides, refer to the Vacuum Equipment catalog CAT.100 for details.

#### How to Order Connectors

- Without lead wire (Connector 1 pc., Socket 4 pcs.) ..... ZS-20-A
- With lead wire ..... ZS-20-5A-50


#### Lead wire length (m)

Nil	0.6
30	3
50	5


### Flow/Exhaust Characteristics of Ejector Unit

(The flow characteristics are for the supply pressure of 0.5 MPa.)


#### Nozzle Diameter ø0.7 Exhaust Characteristics

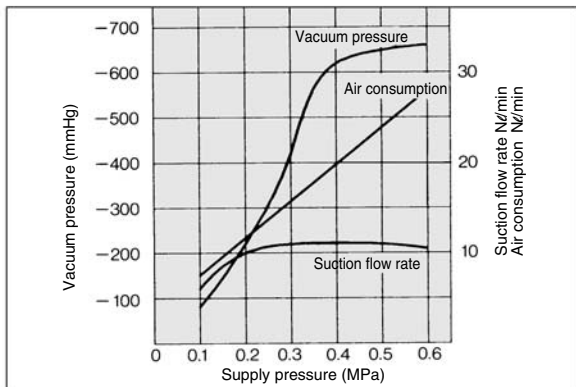


#### Flow Characteristics

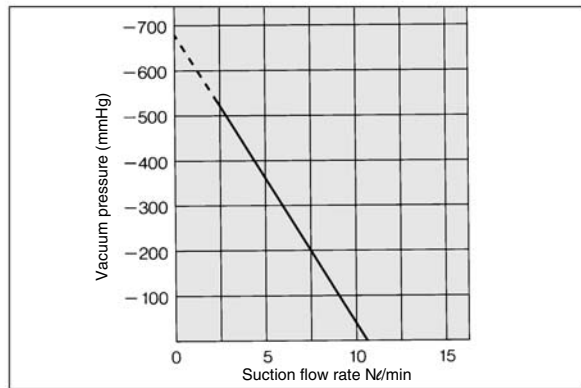

#### Nozzle Diameter ø1.0 Exhaust Characteristics

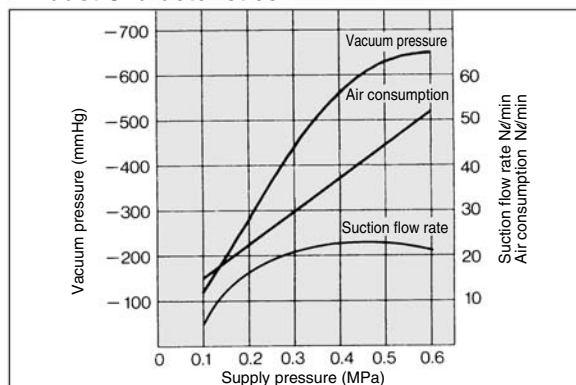

#### Flow Characteristics

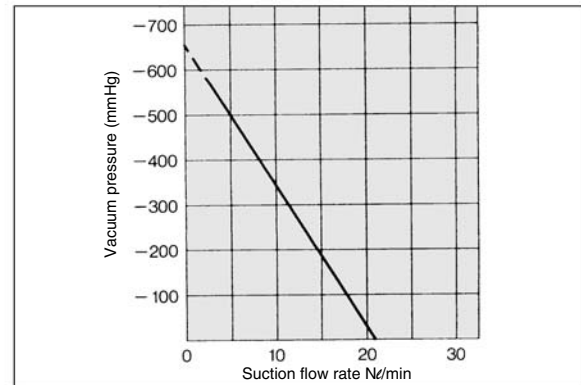

F kit  
 P kit  
 J kit  
 G kit  
 T kit  
 L kit  
 S kit  
 M kit  
 Sub-plate Single Unit  
 Semi-standard  
 Construction  
 Exploded View of Manifold  
 Manifold Optional Parts  
 Safety Instructions  
 Specific Product Precautions



# Series VQ2000

## VQ2000: Manifold Optional Parts

### Blanking plate assembly JIS symbol VVQ2000-10A-1



It is used by attaching on the manifold block for being prepared for removing a valve for maintenance reasons or planning to mount a spare valve, etc.





### Individual SUP spacer VVQ2000-P-1-C8-N9

When the same manifold is to be used for different pressures, individual SUP spacers are used as SUP ports for different pressures. (One station space is occupied.)

Block both sides of the station, for which the supply pressure from the individual SUP spacer is used, with SUP block plates. (Refer to the application example.)  
\* Specify the spacer mounting position and SUP block plate position by means of the manifold specification sheet. The block plate is used in one or two places for one set. (Two SUP block plates for blocking SUP station are attached to the individual SUP spacer.)

\* As a standard, electric wiring is connected to the position of the manifold station where the individual SUP spacer is mounted.

\* If wiring is not required for stations equipped with spacers, enter "X" in the special wiring specifications column in the manifold specification sheet.

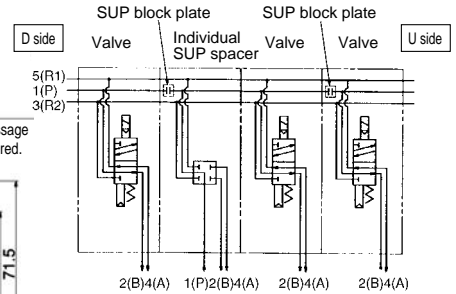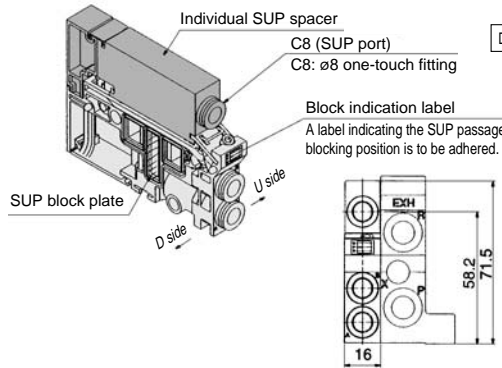

### Individual EXH spacer VVQ2000-R-1-C8-N9

When valve exhaust affects other stations due to the circuit configuration, this spacer is used for individual valve exhaust. (One station space is occupied.)



Block both sides of the individual valve EXH station. (Refer to the application example.)

\* Specify the mounting position, as well as the EXH block base or EXH block plate position by means of the manifold specification sheet.

The block plate is used in one or two places for one set. (Two EXH block plates for blocking EXH station are attached to the individual EXH spacer.)

\* As a standard, electric wiring is connected to the position of the manifold station where the individual EXH spacer is mounted.

\* If wiring is not required for stations equipped with spacers, enter "X" in the special wiring specifications column in the manifold specification sheet.

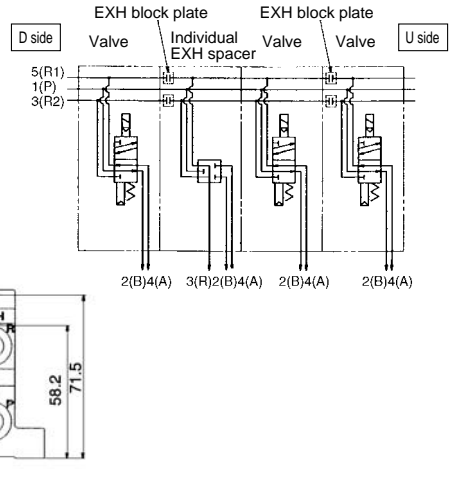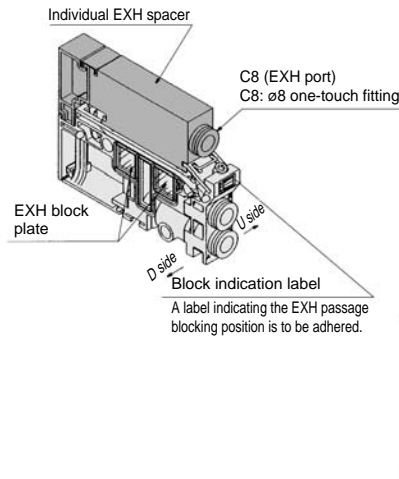

### SUP block plate VVQ2000-16A

When different pressures are supplied to a manifold, a SUP block plate is used to block the stations under different pressures.

\* Specify the mounting position by means of the manifold specification sheet.

#### <Block indication label>



Indication labels to confirm the blocking position are attached. (Each for SUP passage and SUP/EXH passage blocking positions)



SUP passage blocked



SUP/EXH passage blocked

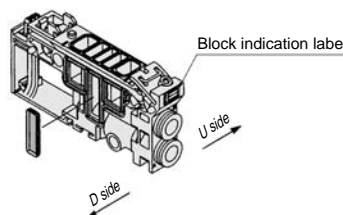

\* When ordering a block plate incorporated with a manifold, a block indication label is attached to the manifold.


### EXH block plate VVQ2000-19A

The EXH block plate is used between stations for which exhaust is desired to be divided when valve exhaust affects other stations configuration. It is also used in combination with an individual EXH spacer for individual exhaust.


\* Specify the mounting position by means of the manifold specification sheet.

#### <Block indication label>



Indication labels to confirm the blocking position are attached. (Each for EXH passage and SUP/EXH passage blocking positions)



EXH passage blocked



SUP/EXH passage blocked




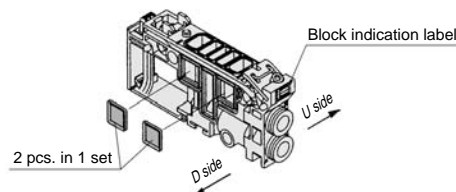


\* When ordering a block plate incorporated with a manifold, a block indication label is attached to the manifold.



**SUP stop valve spacer**  
VQ2000-24A-1

A SUP stop valve spacer is mounted on a manifold block, making it possible to individually shut off supply air to each valve.  
Enclosure: Dust-tight, Water-jet-proof (IP65) compliant

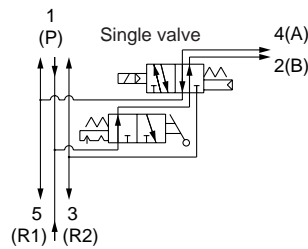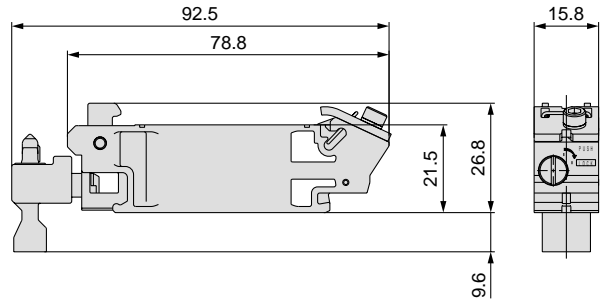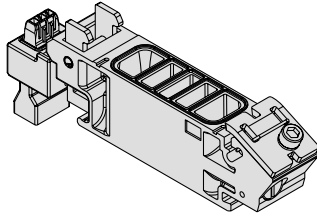


<Circuit diagram>  
(Example of a spacer with a built-in single valve)

**Back pressure check valve assembly [-B]**  
VQ2000-18A


It prevents cylinder malfunction caused by other valve exhaust entry. Insert it into R (EXH) port on the manifold side of a valve which is affected. It is effective when a single-acting cylinder is used or an exhaust center type solenoid valve is used.

\* When ordering assemblies incorporated with a manifold, add suffix "-B" to the end of the manifold part number.

Note) When a check valve for back pressure prevention is desired and is to be installed only in certain manifold stations, clearly indicate the part number and specify the mounting position by means of the manifold specification sheet.



2 pcs. in 1 set





(Precautions)

1. The back pressure check valve assembly is assembly parts with a check valve structure. However, since the valve has slight air leakage, take precautions for the exhaust air not to be restricted at the exhaust port.
2. When a back pressure check valve is mounted, the effective area of the valve will decrease by about 20%.

**Name plate [-N]**  
VQ2000-N-Station (1 to Max. stations)

It is a transparent resin plate for placing a label that indicates solenoid valve function, etc. Insert it into the groove on the side of the end plate and bend it as shown in the figure.



\* When ordering this option incorporated with a manifold, suffix "-N" to the end of the manifold part number.

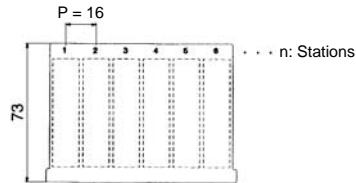

**Blanking plug (For one-touch fittings)**

**KQ2P-□**

It is inserted into an unused cylinder port and SUP/EXH ports. Purchasing order is available in units of 10 pieces.





**Dimensions**

Applicable fitting size ød	Model	A	L	D	Applicable fitting size ød	Model	A	L	D
4	KQ2P-04	16	32	6	5/32"	KQ2P-03	16	32	6
6	KQ2P-06	18	35	8	1/4"	KQ2P-07	18	35	8.5
8	KQ2P-08	20.5	39	10	5/16"	KQ2P-09	20.5	39	10
10	KQ2P-10	22	43	12	3/8"	KQ2P-11	22	43	11.5

**Port plug**  
VQ1000-58A

The plug is used to block the cylinder port.

\* When ordering a plug incorporated with a manifold, indicate "CM" for the port size of the manifold part number, as well as, the mounting position and number of stations and cylinder port mounting positions, A and B by means of the manifold specification sheet.



F kit  
P kit  
J kit  
G kit  
T kit  
L kit  
S kit  
M kit  
Sub-plate Single Unit  
Semi-standard  
Construction  
Exploded View of Manifold  
Manifold Optional Parts  
Safety Instructions  
Specific Product Precautions



# Series VQ2000

## VQ2000: Manifold Optional Parts

### DIN rail mounting bracket [-D/-D0/-D□] VVQ2000-57A

It is used for mounting a manifold on a DIN rail.  
\* When ordering this option incorporated with a manifold, suffix "-D" to the end of the manifold part number.

1 set of DIN rail mounting bracket is used for 1 manifold (2 DIN rail mounting brackets).



### Direct EXH outlet with built-in silencer [-S]


This is a type with an exhaust port atop the manifold end plate. The built-in silencer exhibits an excellent noise suppression effect. (Noise reduction: 30 dB)

\* When ordering this option incorporated with a manifold, suffix "-S" to the end of the manifold part number.




Note) A large quantity of drainage generated in the air source results in exhaust of air together with drainage.

● Refer to back page 5 for maintenance.



### Silencer (For EXH port)

This silencer is to be inserted into the EXH port (One-touch fittings).




### Dimensions

Series	Applicable fitting size $\phi d$	Model	A	L	D	Effective area (mm <sup>2</sup> ) (Cv factor)	Noise reduction (dB)
VQ2000	10	AN200-KM10	59.6	80.8	22	26 (1.4)	30

### Elbow fitting assembly VVQ2000-F-L(C4/C6/C8/N3/N7/N9)

It is used for piping that extends upward or downward from the manifold.  
When not installed in the manifold stations, specify the assembly part number and the mounting position by means of the manifold specification sheet.




### Dual flow fitting assembly VVQ2000-52A-<sup>C10</sup><sub>N11</sub>

This is a fitting to multiply the flow rate by combining the outputs of 2-valve stations. It is used for driving a large bore cylinder. This is a one-touch fitting for a port size of  $\phi 10$  or  $\phi 3/8$ ".



\* The port size for the manifold part number is "CM".  
Clearly indicate the dual flow fitting assembly part number and specify the mounting position by means of the manifold specifications.



## Manifold Option


### Double check block (Separated) for VQ2000 VQ2000-FPG-□□-□

It is mounted on the outlet side piping to keep the cylinder in the intermediate position for a long time. Combining the double check block with a 3-position exhaust center solenoid valve will enable the cylinder to stop in the middle or maintain its position for long periods of time.  
The combination with a 2-position single/double solenoid valve will prevent the dropping at the cylinder stroke end when the SUP residual pressure is released.


#### Specifications

Max. operating pressure	0.8 MPa
Min. operating pressure	0.15 MPa
Ambient and fluid temp.	-5 to 50°C
Flow characteristics: C	3.0 dm <sup>3</sup> /(s·bar)
Max. operating frequency	180 c.p.m

Note) Based on JIS B 8375-1981 (Supply pressure: 0.5 MPa)

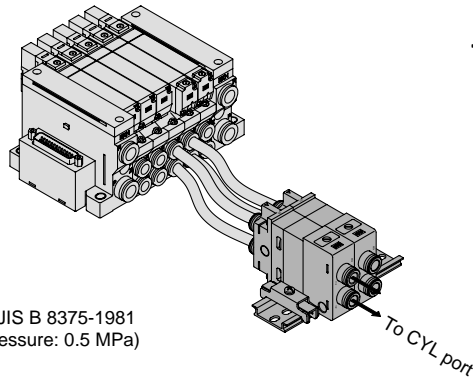


#### <Circuit diagram>




## Dimensions

### Single unit

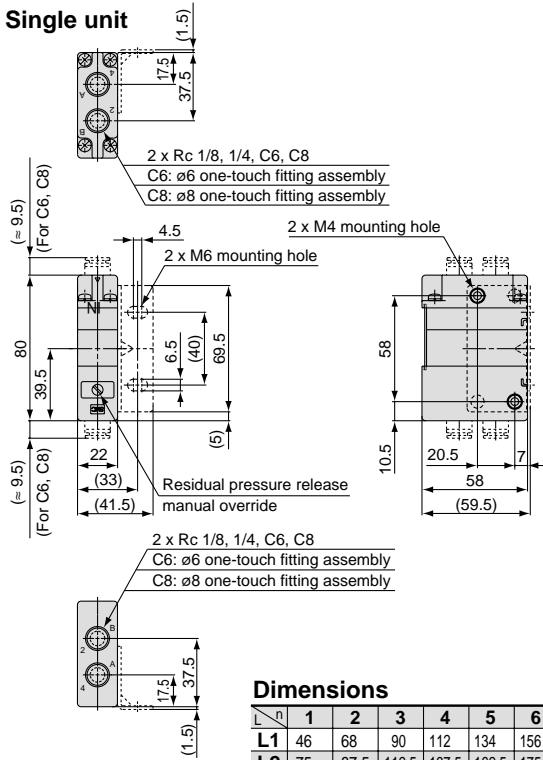

### Manifold

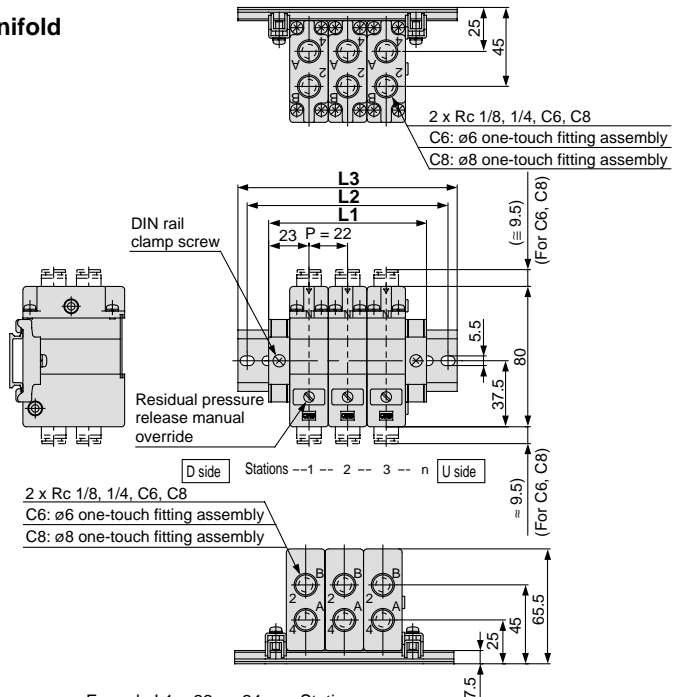

#### Dimensions

Formula L1 = 22n + 24 n: Station

L1	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16
L1	46	68	90	112	134	156	178	200	222	244	266	288	310	332	354	376
L2	75	87.5	112.5	137.5	162.5	175	200	225	250	262.5	287.5	312.5	337.5	362.5	375	400
L3	85.5	98	123	148	173	185.5	210.5	235.5	260.5	273	298	323	348	373	385.5	410.5

## How to Order

### Double check block

VQ2000-FPG-01 01 - F

#### IN side port size

01	Rc 1/8
02	Rc 1/4
C6	ø6 one-touch fitting
C8	ø8 one-touch fitting
N7	ø1/4" one-touch fitting
N9	ø5/16" one-touch fitting

#### OUT side port size

01	Rc 1/8
02	Rc 1/4
C6	ø6 one-touch fitting
C8	ø8 one-touch fitting
N7	ø1/4" one-touch fitting
N9	ø5/16" one-touch fitting

#### Option

Nil	None
D	DIN rail mounting (For manifold)
F	With bracket
N	Name plate

Note) When two or more symbols are specified, indicate them alphabetically.  
Example) -DN

### Manifold (DIN rail mounting)

VVQ2000-FPG-06

#### Stations

01	1 station
⋮	⋮
16	16 stations

When ordering a double check block, order the DIN rail mounting [-D].

#### <Ordering Example>

VVQ2000-FPG-06--6-station manifold

\*VQ2000-FPG-C6C6-D, 3 sets  
\*VQ2000-FPG-C8C8-D, 3 sets

Double check block

#### Bracket Assembly

Part no.	Tightening torque
VQ2000-FPG-FB	0.8 to 1.0 N·m

## Caution

- Air leakage from the pipe between the valve and cylinder or from the fittings will prevent the cylinder from stopping for long periods of time. Check the leakage using neutral household detergent, such as dish washing soap. Also check the cylinder's tube gasket, piston packing and rod packing for air leakage.
- Since one-touch fittings allow slight air leakage, screw piping is recommended when stopping the cylinder in the middle for long periods of time.
- Combining double check block with 3-position closed center or pressure center solenoid valve will not work.
- When fittings, etc. are being screwed to the double check block, tighten them with the torque below.

Connection threads	Proper tightening torque (N·m)
Rc 1/8	7 to 9
Rc 1/4	12 to 14

- If the exhaust of the double check block is restricted too much, the cylinder may not operate properly and may not stop intermediately.
- Set the cylinder load so that the cylinder pressure will be within two times that of the supply pressure.

F kit  
P kit  
J kit  
G kit  
T kit  
L kit  
S kit  
M kit  
Sub-plate Single Unit  
Semi-standard  
Construction  
Exploded View of Manifold  
Manifold Optional Parts  
Safety Instructions  
Specific Product Precautions

# Series VQ2000

## Manifold Option

### Double check block (Direct mounting)


VVQ2000-23A-<sup>B</sup><sub>C8</sub>

It is mounted directly on the manifold to keep the cylinder in the intermediate position for a long time. Combining the double check block with a built-in pilot type double check valve and a 3-position exhaust center solenoid valve will enable the cylinder to stop in the middle or maintain its position for long periods of time.


The combination with a 2-position single/double solenoid valve will permit this block to be used for preventing the dropping at the cylinder stroke end when the SUP residual pressure is released.

### Specifications

Max. operating pressure	0.7 MPa
Min. operating pressure	0.15 MPa
Ambient and fluid temperature	-5 to 50°C
Flow characteristics: C	1.8 dm <sup>3</sup> /(s·bar)
Max. operating frequency	180 c.p.m

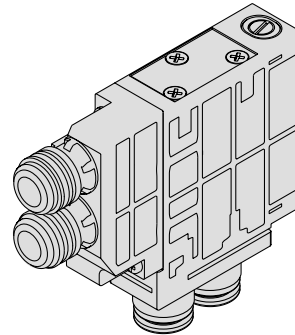


### <Check valve operation principle>

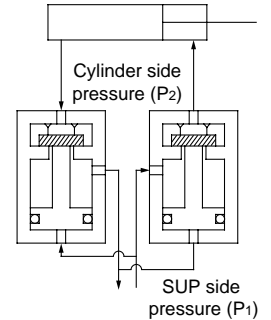


## Dimensions


### Single unit

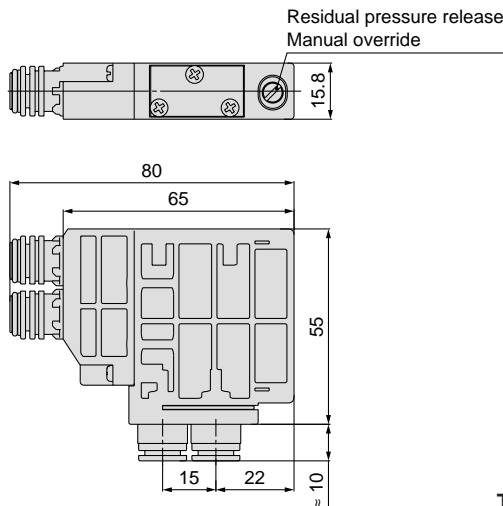

### When the manifold is mounted.



Top ported (VVQ2000-23A-C□)

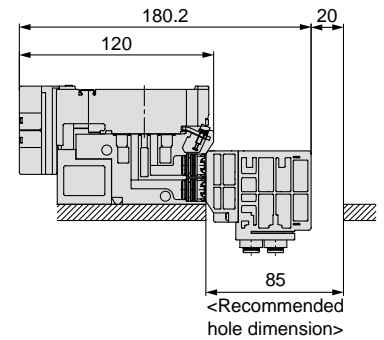

Bottom ported (VVQ2000-23A-B□)

2 x port on the OUT side

C6: With ø6 one-touch fitting (for top ported)

C8: With ø8 one-touch fitting (for top ported)

B6: With ø6 one-touch fitting (for bottom ported)

B8: With ø8 one-touch fitting (for bottom ported)


Residual pressure release  
Manual override

Color: red

### ⚠ Caution

- Air leakage from the pipe between the valve and cylinder or from the fittings will prevent the cylinder from stopping for long periods of time. Check the leakage using neutral household detergent, such as dish washing soap. Also check the cylinder's tube gasket, piston packing and rod packing for air leakage.
- Since zero air leakage is not guaranteed, it is sometimes not possible to hold a stop position for long periods of time.
- Combining double check block with 3-position closed center or pressure center solenoid valve will not work.
- Set the cylinder load so that the cylinder pressure will be within two times that of the supply pressure.
- If the exhaust of the double check block is restricted too much, the cylinder may not operate properly and may not stop intermediately.

### <Example>

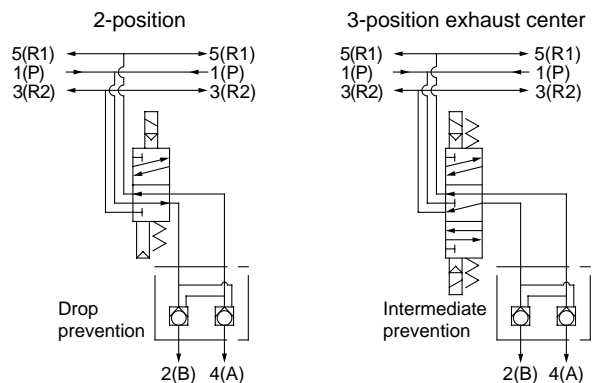





# Safety Instructions

These safety instructions are intended to prevent hazardous situations and/or equipment damage. These instructions indicate the level of potential hazard with the labels of “**Caution,**” “**Warning**” or “**Danger.**” They are all important notes for safety and must be followed in addition to International Standards (ISO/IEC), Japan Industrial Standards (JIS)\*1) and other safety regulations\*2).

\*1) ISO 4414: Pneumatic fluid power – General rules relating to systems.  
ISO 4413: Hydraulic fluid power – General rules relating to systems.  
IEC 60204-1: Safety of machinery – Electrical equipment of machines. (Part 1: General requirements)  
ISO 10218-1992: Manipulating industrial robots - Safety.  
JIS B 8370: General rules for pneumatic equipment.  
JIS B 8361: General rules for hydraulic equipment.  
JIS B 9960-1: Safety of machinery – Electrical equipment of machines. (Part 1: General requirements)  
JIS B 8433-1993: Manipulating industrial robots – Safety.  
etc.

\*2) Labor Safety and Sanitation Law, etc.

- |  |   |
|--|---|
|  | <b>Caution:</b> <b>Caution</b> indicates a hazard with a low level of risk which, if not avoided, could result in minor or moderate injury.   |
|  | <b>Warning:</b> <b>Warning</b> indicates a hazard with a medium level of risk which, if not avoided, could result in death or serious injury. |
|  | <b>Danger:</b> <b>Danger</b> indicates a hazard with a high level of risk which, if not avoided, will result in death or serious injury.      |

## Warning

### **1. The compatibility of the product is the responsibility of the person who designs the equipment or decides its specifications.**

Since the product specified here is used under various operating conditions, its compatibility with specific equipment must be decided by the person who designs the equipment or decides its specifications based on necessary analysis and test results. The expected performance and safety assurance of the equipment will be the responsibility of the person who has determined its compatibility with the product. This person should also continuously review all specifications of the product referring to its latest catalog information, with a view to giving due consideration to any possibility of equipment failure when configuring the equipment.

### **2. Only personnel with appropriate training should operate machinery and equipment.**

The product specified here may become unsafe if handled incorrectly. The assembly, operation and maintenance of machines or equipment including our products must be performed by an operator who is appropriately trained and experienced.

### **3. Do not service or attempt to remove product and machinery/equipment until safety is confirmed.**

1. The inspection and maintenance of machinery/equipment should only be performed after measures to prevent falling or runaway of the driven objects have been confirmed.
2. When the product is to be removed, confirm that the safety measures as mentioned above are implemented and the power from any appropriate source is cut, and read and understand the specific product precautions of all relevant products carefully.
3. Before machinery/equipment is restarted, take measures to prevent unexpected operation and malfunction.

### **4. Contact SMC beforehand and take special consideration of safety measures if the product is to be used in any of the following conditions.**

1. Conditions and environments outside of the given specifications, or use outdoors or in a place exposed to direct sunlight.
2. Installation on equipment in conjunction with atomic energy, railways, air navigation, space, shipping, vehicles, military, medical treatment, combustion and recreation, or equipment in contact with food and beverages, emergency stop circuits, clutch and brake circuits in press applications, safety equipment or other applications unsuitable for the standard specifications described in the product catalog.
3. An application which could have negative effects on people, property, or animals requiring special safety analysis.
4. Use in an interlock circuit, which requires the provision of double interlock for possible failure by using a mechanical protective function, and periodical checks to confirm proper operation.



# Safety Instructions

## ⚠ Caution

### 1. The product is provided for use in manufacturing industries.

The product herein described is basically provided for peaceful use in manufacturing industries.

If considering using the product in other industries, consult SMC beforehand and exchange specifications or a contract if necessary.

If anything is unclear, contact your nearest sales branch.

## Limited warranty and Disclaimer/Compliance Requirements

The product used is subject to the following “Limited warranty and Disclaimer” and “Compliance Requirements”.

Read and accept them before using the product.

### Limited warranty and Disclaimer

#### 1. The warranty period of the product is 1 year in service or 1.5 years after the product is delivered.\*3)

Also, the product may have specified durability, running distance or replacement parts. Please consult your nearest sales branch.

#### 2. For any failure or damage reported within the warranty period which is clearly our responsibility, a replacement product or necessary parts will be provided.

This limited warranty applies only to our product independently, and not to any other damage incurred due to the failure of the product.

#### 3. Prior to using SMC products, please read and understand the warranty terms and disclaimers noted in the specified catalog for the particular products.

##### \*3) Vacuum pads are excluded from this 1 year warranty.

A vacuum pad is a consumable part, so it is warranted for a year after it is delivered.

Also, even within the warranty period, the wear of a product due to the use of the vacuum pad or failure due to the deterioration of rubber material are not covered by the limited warranty.

### Compliance Requirements

When the product is exported, strictly follow the laws required by the Ministry of Economy, Trade and Industry (Foreign Exchange and Foreign Trade Control Law).

F kit

P kit

J kit

G kit

T kit

L kit

S kit

M kit

Sub-plate  
Single Unit

Semi-  
standard

Construction

Exploded  
View of  
Manifold

Manifold  
Optional Parts

Safety  
Instructions

Specific  
Product  
Precautions



# Series VQ1000/2000

## Specific Product Precautions 1


Be sure to read before handling.

Refer to back pages 1 and 2 for Safety Instructions and Handling Precautions for SMC Products (M-E03-3) for 3/4/5 Port Solenoid Valves Precautions.

### Light/Surge Voltage Suppressor

#### ⚠ Caution


The lighting positions are concentrated on one side for both single solenoid type and double solenoid type. In the double solenoid type, A side and B side energization are indicated by two colors which match the colors of the manual overrides.

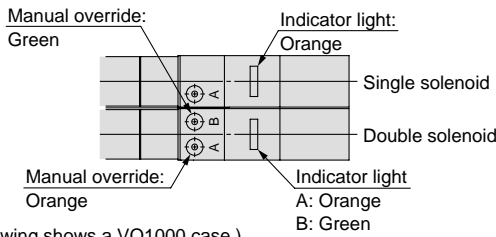


(Drawing shows a VQ1000 case.)

#### DC circuit diagram

##### Single solenoid



##### Double solenoid

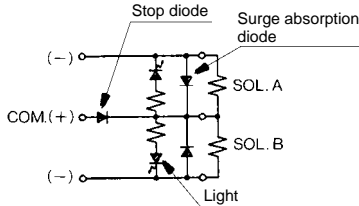

Note) A-side energization:  
A light (Orange) illuminates.  
B-side energization:  
B light (Green) illuminates.


With wrong wiring prevention (stop diode) mechanism  
With a surge absorption (surge absorption diode) mechanism

### Manual Override

#### ⚠ Warning


Without an electric signal for the solenoid valve the manual override is used for switching the main valve. Push type is standard. (Tool required) Locking type is semi-standard. (Tool required/Manual)

##### ■ Push type (Tool required)

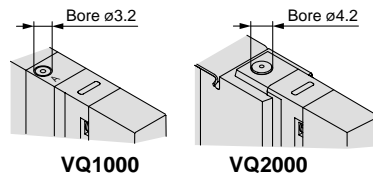


Push down on the manual override with a small screwdriver, etc. until it stops. Release the screwdriver and the manual override will return.

##### ■ Locking type (Tool required) <Semi-standard>

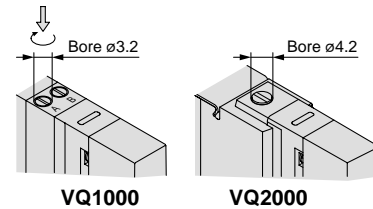

Push down on the manual override with a flat head screwdriver until it stops. Turn it clockwise by 90° to lock it. Turn it counterclockwise to release it.

##### ■ Locking type (Manual) <Semi-standard>

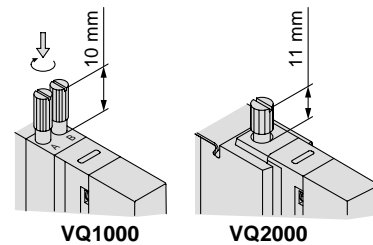

Push down on the manual override with a small flat head screwdriver or with your fingers until it stops. Turn it clockwise by 90° to lock it. Turn it counterclockwise to release it.

#### ⚠ Caution

Do not apply excessive torque when turning the locking type manual override. (0.1 N·m or less)





# Series VQ1000/2000 Specific Product Precautions 2


Be sure to read before handling.

Refer to back pages 1 and 2 for Safety Instructions and Handling Precautions for SMC Products (M-E03-3) for 3/4/5 Port Solenoid Valves Precautions.

## Manual Override

### Warning


■ Slide locking type (Manual) <Semi-standard>

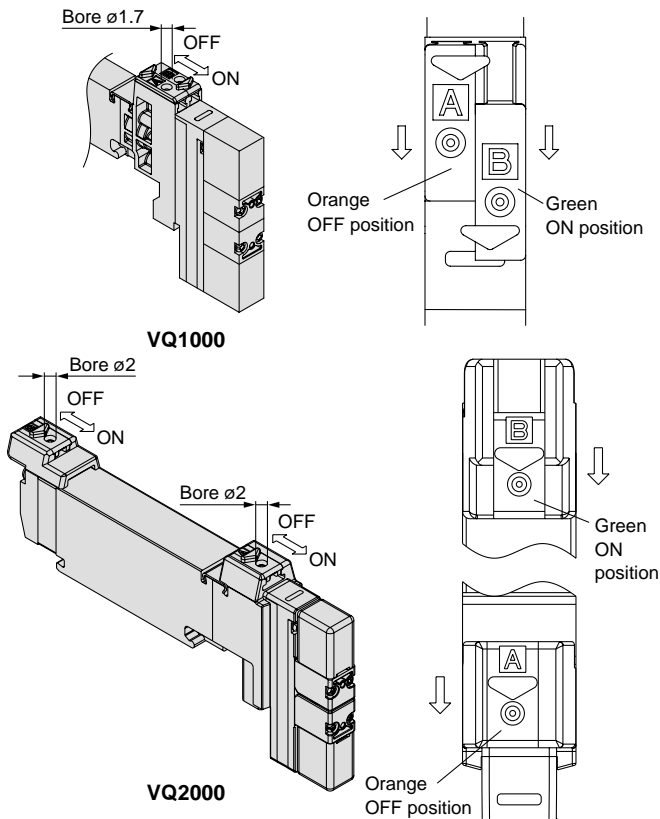

The manual override is locked by sliding it all the way to the pilot valve side (ON side) with a small flat head screwdriver or finger. Slide it to the fitting side (OFF side) to release it. In addition, it can also be used as a push type by using a screwdriver, etc., of  $\phi 1.7$  or less. ( $\phi 2$  or less for VQ2000).

## How to Mount/Remove Solenoid Valves

### Caution

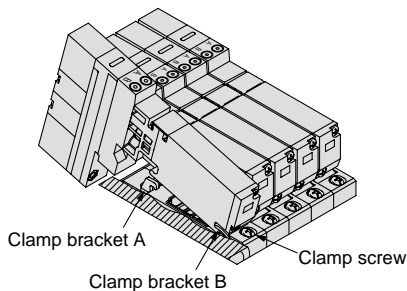

### Removing

1. Loosen the clamp screw until it turns freely. (The screw is captive.)
2. Lift the coil side of the valve body while pressing down slightly on the screw head and remove it from the clamp bracket B. When the screw head cannot be pressed easily, gently press the area near the manual override of the valve.

## How to Mount/Remove Solenoid Valves

### Caution

#### Mounting

1. Press down on the clamp screw. Clamp bracket A opens. Diagonally insert the hook on the valve end plate side into clamp B.
2. Press the valve body downward. (When the screw is released, it will be locked by clamp bracket A.)
3. Tighten the clamp screw. (Proper tightening torque: VQ1000, 0.25 to 0.35 N·m; VQ2000, 0.5 to 0.7 N·m.)

#### Caution


Dust on the sealing surface of the gasket or solenoid valve can cause air leakage.

## Replacement of Cylinder Port Fittings

### Caution

The cylinder port fittings are a cassette for easy replacement. The fittings are blocked by a clip. Take out the clip with a flat head screwdriver, etc., then replace the fittings.

For mounting, insert the fitting assembly until it strikes against the inside wall and then insert the clip to the specified position.

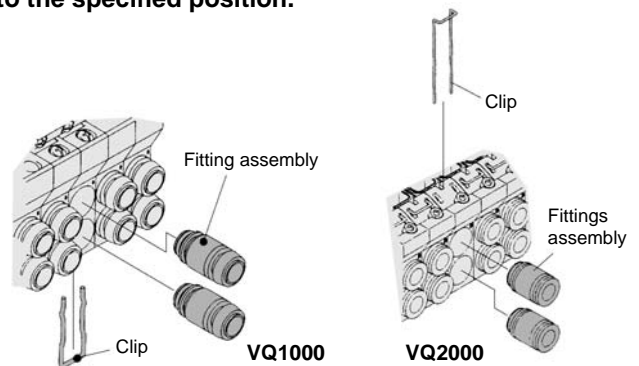

Applicable tubing O.D.	Fitting assembly part no.	
	VQ1000	VQ2000
Applicable tubing $\phi 3.2$	VVQ1000-50A-C3	—
Applicable tubing $\phi 4$	VVQ1000-50A-C4	VVQ1000-51A-C4
Applicable tubing $\phi 6$	VVQ1000-50A-C6	VVQ1000-51A-C6
Applicable tubing $\phi 8$	—	VVQ1000-51A-C8
M5	VVQ1000-50A-M5	—
Applicable tubing $\phi 1/8$ "	VVQ1000-50A-N1	—
Applicable tubing $\phi 5/32$ "	VVQ1000-50A-N3	VVQ1000-51A-N3
Applicable tubing $\phi 1/4$ "	VVQ1000-50A-N7	VVQ1000-51A-N7
Applicable tubing $\phi 5/16$ "	—	VVQ1000-51A-N9

\* Refer to "Manifold Optional Parts" on pages 66, 67, 73 for other types of fittings.

#### Caution

1. Use caution that O-rings must be free from scratches and dust. Otherwise, air leakage may result.
2. After screwing in the fittings, mount the M5 fitting assembly on the manifold base. (Tightening torque: 0.8 to 1.2 N·m)
3. Purchasing order is available in units of 10 pieces.



# Series VQ1000/2000

## Specific Product Precautions 3

Be sure to read before handling.


Refer to back pages 1 and 2 for Safety Instructions and Handling Precautions for SMC Products (M-E03-3) for 3/4/5 Port Solenoid Valves Precautions.

### How to Mount/Remove DIN Rail

#### ⚠ Caution


##### Removing

1. Loosen the clamp screw on side (a) of the end plate on both sides.
2. Lift side (a) of the manifold base and slide the end plate in the direction of (2) shown in the figure to remove.

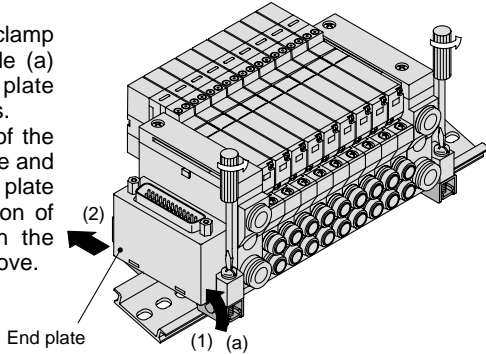

##### Mounting

1. Hook side (b) of the manifold base on the DIN rail.
2. Press down side (a) and mount the end plate on the DIN rail. Tighten the clamp screw on side (a) of the end plate. The proper tightening torque for screws is 0.4 to 0.6 N·m.

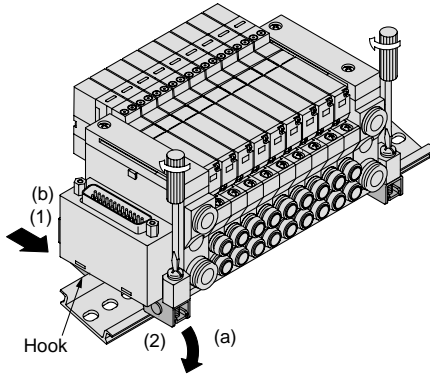

### IP65 Enclosure

#### ⚠ Caution

Wiring connection for models conforming to IP65 should also have enclosures equivalent to or of stricter than IP65.

### Built-in Silencer Element

#### ⚠ Caution


A filter element is incorporated in the end plate on both sides of the manifold base. A dirty and choked element may reduce cylinder speed or cause malfunction. Clean or replace the dirty element.

##### Element Part No.

Type	Element part no.	
	VQ1000	VQ2000
Built-in silencer, direct exhaust	VVQ1000-82A-1	VVQ2000-82A-1

The minimum order quantity is 10 pcs.

Remove the cover from the top of the end plate and remove the old element with a flat head screwdriver, etc.

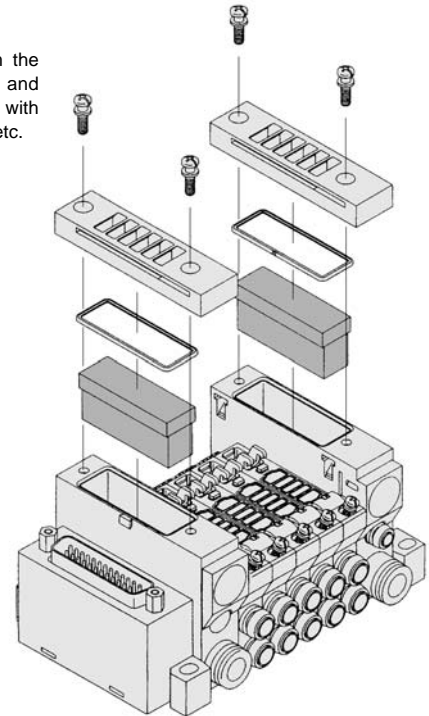


### How to Calculate Flow Rate

Refer to Best Pneumatics No. ① for obtaining the flow rate.



# SMC'S GLOBAL MANUFACTURING, DISTRIBUTION AND SERVICE NETWORK

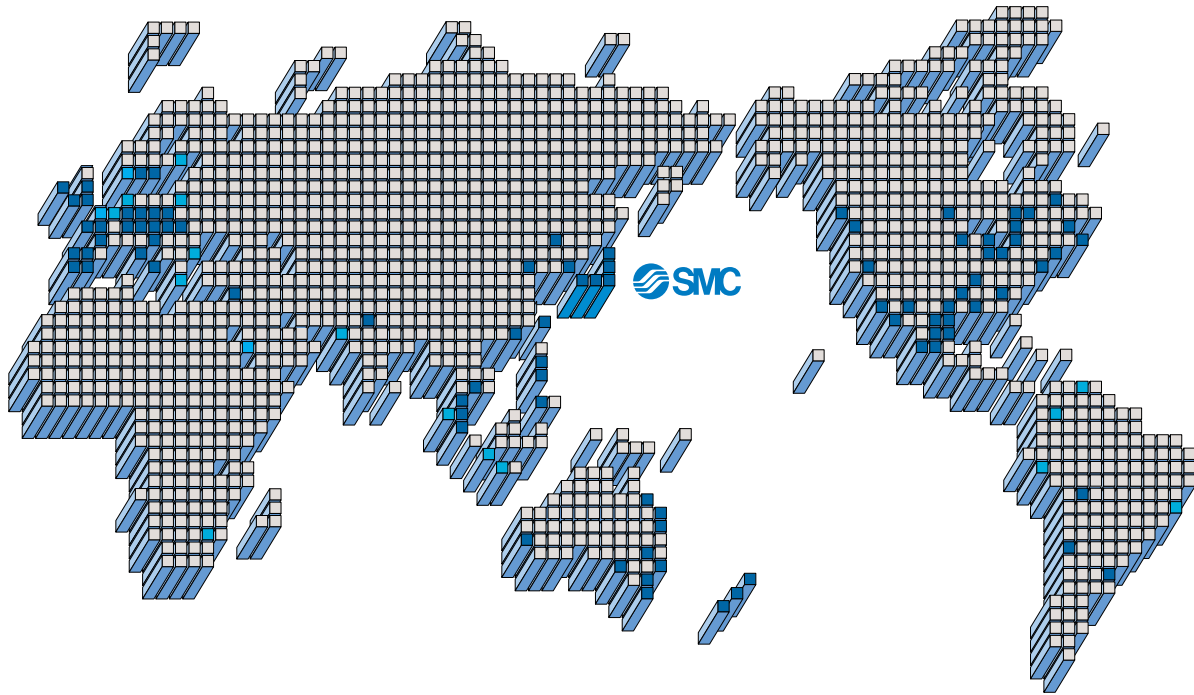

## EUROPE

### AUSTRIA

SMC Pneumatik GmbH (Austria)

### BELGIUM

SMC Pneumatics N.V./S.A.

### BULGARIA

SMC Industrial Automation Bulgaria Eood

### CROATIA

SMC Industrijska Automatika d.o.o.

### CZECH REPUBLIC

SMC Industrial Automation CZ s.r.o.

### DENMARK

SMC Pneumatik A/S

### ESTONIA

SMC Pneumatics Estonia OÜ

### FINLAND

SMC Pneumatics Finland Oy

### FRANCE

SMC Pneumatique SA

### GERMANY

SMC Pneumatik GmbH

### GREECE

SMC Hellas E.P.E.

### HUNGARY

SMC Hungary Ipari Automatizálási Kft.

### IRELAND

SMC Pneumatics (Ireland) Ltd.

### ITALY

SMC Italia S.p.A.

### LATVIA

SMC Pnuematics Latvia SIA

### LITHUANIA

UAB "SMC Pneumatics"

### NETHERLANDS

SMC Pneumatics B.V.

### NORWAY

SMC Pneumatics Norway AS

### POLAND

SMC Industrial Automation Polska Sp.z.o.o.

### ROMANIA

SMC Romania S.r.l.

### RUSSIA

SMC Pneumatik LLC

### SLOVAKIA

SMC Priemyselná Automatizácia Spol s.r.o.

### SLOVENIA

SMC Industrijska Avtomatika d.o.o.

### SPAIN/PORTUGAL

SMC España S.A.

### SWEDEN

SMC Pneumatics Sweden AB

### SWITZERLAND

SMC Pneumatik AG

### U.K.

SMC Pneumatics (U.K.) Ltd.

## ASIA

### CHINA

SMC (China) Co., Ltd.

### HONG KONG

SMC Pneumatics (Hong Kong) Ltd.

### INDIA

SMC Pneumatics (India) Pvt. Ltd.

### MALAYSIA

SMC Pneumatics (S.E.A.) Sdn. Bhd.

### PHILIPPINES

Shoketsu SMC Corporation

### SINGAPORE

SMC Pneumatics (S.E.A.) Pte. Ltd.

### SOUTH KOREA

SMC Pneumatics Korea Co., Ltd.

### TAIWAN

SMC Pneumatics (Taiwan) Co., Ltd.

### THAILAND

SMC (Thailand) Ltd.

## NORTH AMERICA

### CANADA

SMC Pneumatics (Canada) Ltd.

### MEXICO

SMC Corporation (Mexico), S.A. de C.V.

### U.S.A.

SMC Corporation of America

## SOUTH AMERICA

### ARGENTINA

SMC Argentina S.A.

### BOLIVIA

SMC Pneumatics Bolivia S.r.l.

### BRAZIL

SMC Pneumáticos do Brasil Ltda

### CHILE

SMC Pneumatics (Chile) S.A.

### VENEZUELA

SMC Neumatica Venezuela S.A.

## OCEANIA

### AUSTRALIA

SMC Pneumatics (Australia) Pty. Ltd.

### NEW ZEALAND

SMC Pneumatics (N.Z.) Ltd.



### Safety Instructions

Be sure to read "Handling Precautions for SMC Products" (M-E03-3) before using.

## SMC Corporation

Akihabara UDX 15F,  
4-14-1, Sotokanda, Chiyoda-ku, Tokyo 101-0021, JAPAN

Phone: 03-5207-8249 Fax: 03-5298-5362

URL <http://www.smcworld.com>

© 2009 SMC Corporation All Rights Reserved

Specifications are subject to change without prior notice  
and any obligation on the part of the manufacturer.

D-DN

1st printing NP printing NP 16400DN Printed in Japan.

This catalog is printed on recycled paper with concern for the global environment.