

# Pilot Operated 2-Port Solenoid Valve/ Zero Pressure Differential Operation

New



For Steam

Compact  
and  
Lightweight

Enclosure: IP65

Low-noise  
construction


Operation noise is reduced due to  
**full wave rectifier type  
solenoid** and special valve  
construction.

Internal leakage of

**1.0 cm<sup>3</sup>/min**

or less is achieved by using  
**special FKM seal material.**

Reliability is improved due to a piston main  
valve and a rubber seal made of special FKM.

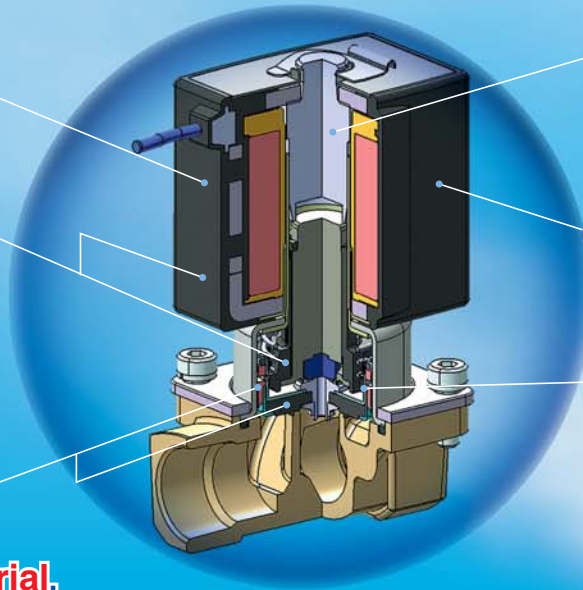

Improved corrosion  
resistance

Use of special magnetic material

Flame resistance  
conforms to  
**UL94V-0.**

Flame resistant mold coil material

Zero pressure  
differential

Weight

**490 g**

(VXS2230)

85.5 mm

40 mm

50 mm

\* Dimensions of the VXS2230 [3/8 (10A)]

New

**VX S**

Series **VXS22/23**

**SMC**


CAT.ES70-38A

# Solenoid valves for various fluids used in a wide variety of


Pilot operated 2-port solenoid valve for steam / Zero pressure differential operation

For Steam


New Series VXS22/23

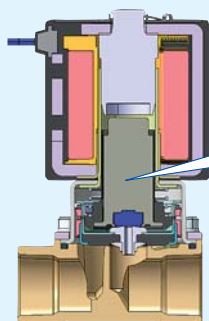

Normally closed operation

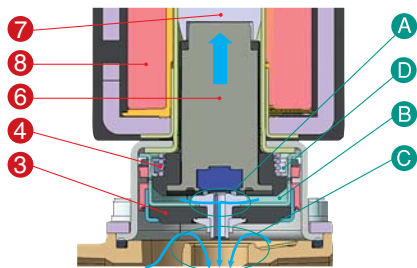

Normally open operation

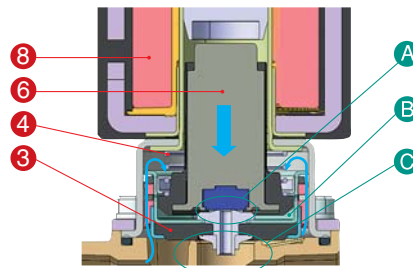

### Working principles

#### <Valve opened – when there is pressure>

When the coil **8** is energized, the armature assembly **6** is attracted into the core of the tube assembly **7** and the pilot valve **A** is opened.

When the pilot valve is opened and the pressure inside the pilot chamber **B** decreases, resulting in the pressure difference from the inlet pressure. Then the piston assembly **3** is lifted and the main valve **C** is opened.

#### <Valve opened – when there is no pressure or under low minute pressure>

Armature assembly **6** interacts with piston assembly **3** at location **D**. The piston assembly is pulled upward when the armature assembly is attracted to open main valve **C**.

### Working principles

#### <Valve closed>

When the coil **8** is de-energized, the armature assembly **6** returns by the reacting force of the return spring **4**.

When the pressure inside the pilot chamber **B** increases, the pressure difference from the inlet pressure is lost and the main valve **C** is closed.

### Normally Closed (N.C.)

Solenoid valve (Port size)		Orifice symbol (diameter)				Material		
Model	VXS22	VXS23	3 (10 mmø)	4 (15 mmø)	5 (20 mmø)	6 (25 mmø)	Body	Seal
Port symbol (Port size)	02 (1/4)	—	●	—	—	—	C37, Stainless steel	FKM
	03 (3/8)	—	●	—	—	—		
	04 (1/2)	—	—	●	—	—		
	—	06 (3/4)	—	—	●	—		
	—	10 (1)	—	—	—	●		




## Applications


For various industries which use steam



Steam cooker

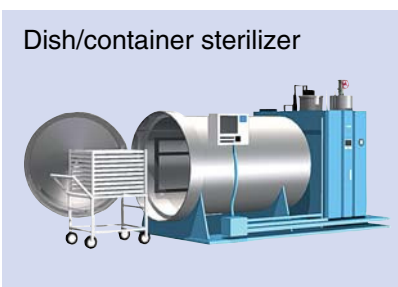

Dish/container sterilizer

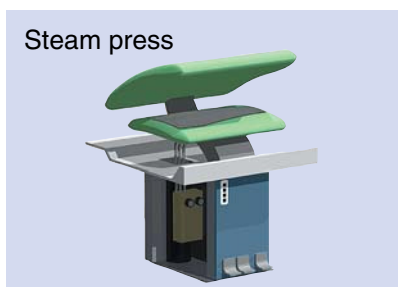

Steam press



Steam dryer



Boiler



Steam heater

# applications — **New VX Series variations**

**Pilot operated 2-port  
Zero pressure differential operation**

For Air, Water, Oil

**New VXZ22/23**



Valve type	Port size	Orifice dia. mmØ
N.C./N.O.	1/4 to 1	10 to 25

**Direct operated 2-port**

**New VX21/22/23**

For Air, Vacuum, Water, Steam, Oil



Valve type	Port size	Orifice dia. mmØ
N.C./N.O.	1/8 to 1/2	2 to 10

**Pilot operated 2-port**

**New VXD21/22/23**

For Water, Oil, Air



Valve type	Port size	Orifice dia. mmØ
N.C./N.O.	1/4 to 1 32A to 50A	10 to 50

**Direct operated 3-port**

**New VX31/32/33**

For Air, Vacuum, Water, Steam, Oil



Valve type	Port size	Orifice dia. mmØ
N.C./N.O. COM.	1/8 to 3/8	1.5 to 4

**Pilot operated 2-port**

**VXP21/22/23**

For Steam (Air, Water, Oil)



Valve type	Port size	Orifice dia. mmØ
N.C./N.O.	1 1/4 to 2 32A to 50A	35 to 50

**Water hammer relief,  
Pilot operated 2-port**

**VXR21/22/23**

For Water, Oil



Valve type	Port size	Orifice dia. mmØ
N.C./N.O.	1/2 to 2	20 to 50

**Pilot operated 2-port for  
high pressure**

**VXH22**

For Air, Water, Oil



Valve type	Port size	Orifice dia. mmØ
N.C.	1/4 to 1/2	10

**2-port for dust collector  
(Solenoid type/Air operated type)**

**VXF21/22, VXFA21/22**

For Air



Valve type	Port size	Orifice dia. mmØ
N.C.	3/4 to 1 1/2	20 to 40

The **new VX series**, with its improved construction, replaces our previous VX range.

# Pilot Operated 2-Port Solenoid Valve for Steam Zero Pressure Differential Operation

## Series **VXS22/23**

**For Steam**



### ■ Valve

Normally closed (N.C.)

### ■ Solenoid Coil

Coil: Class H

### ■ Rated Voltage

100 VAC, 200 VAC, 110 VAC,  
220 VAC, 240 VAC, 230 VAC, 48 VAC

### ■ Material

Body — C37, Stainless steel  
Seal — FKM



### ■ Electrical Entry

- Grommet
- Conduit
- Conduit terminal


Model		VXS2230	VXS2240	VXS2350	VXS2360
Orifice dia.	10 mmø	●	—	—	—
	15 mmø	—	●	—	—
	20 mmø	—	—	●	—
	25 mmø	—	—	—	●
Port size (Nominal size)		1/4 (8A) 3/8 (10A)	1/2 (15A)	3/4 (20A)	1 (25A)

The VXZ series is recommended when air, water or oil is fluid medium.

## Pilot Operated 2-Port Solenoid Valve Zero Pressure Differential Operation

**For Air, Water, Oil**

### Series **VXZ22/23**

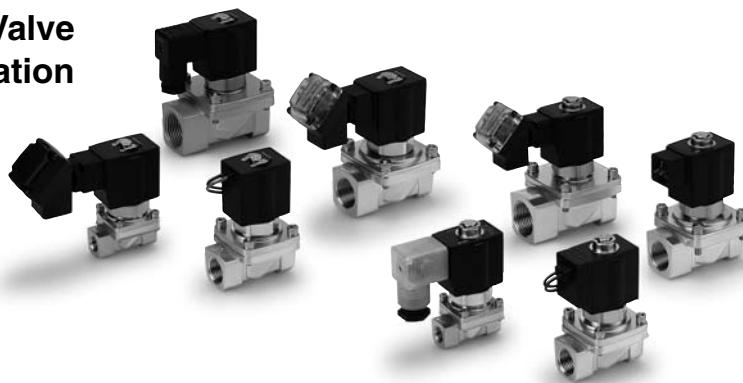

### Normally Closed (N.C.) / Normally Open (N.O.)

Solenoid valve (Port size)		Orifice symbol (diameter)				Material		
Model	VXZ22	VXZ23	3 (10 mmø)	4 (15 mmø)	5 (20 mmø)	6 (25 mmø)	Body	Seal
Port symbol (Port size)	02 (1/4)	—	●	—	—	—	C37, Stainless steel	NBR FKM EPDM
	03 (3/8)	—	●	—	—	—		
	04 (1/2)	—	—	●	—	—		
	—	06 (3/4)	—	—	●	—		
	—	10 (1)	—	—	—	●		



CAT.ES70-31

# Common Specifications

## Standard Specifications

Valve specifications	Valve construction	Pilot operated 2-port piston type/Zero pressure differential operation
	Withstand pressure (MPa) (Water pressure)	3.0
	Body material	C37, Stainless steel
	Seal material	FKM
	Enclosure	Dusttight, Water-jet-proof (IP65)
	Environment	Location without corrosive or explosive gases
Coil specifications	Rated voltage	100 VAC, 200 VAC, 110 VAC, 220 VAC, 230 VAC, 240 VAC, 48 VAC
	Allowable voltage range	±10% of rated voltage
	Allowable leakage voltage	10% or less of rated voltage
	Coil insulation type	Class H (Full wave rectifier type)

Specifications

For Steam

Construction

Dimensions

## Solenoid Coil Specifications

### AC Specification (Class H coil, Full wave rectifier type)

Model	Apparent power (VA) <sup>Note 2)</sup>	Temperature rise (°C) <sup>Note 1)</sup>
VXS22	18	120
VXS23	20	120

Note 1) The value at ambient temperature of 20°C and when the rated voltage is applied.

Note 2) There is no difference in the frequency and the inrush and energized apparent power, since a rectifying circuit is used.

Apparent power when the solenoid temperature is 20°C.

## Applicable Fluid Check List / All Options

VXS2   0  S  -   -    R1 -

• Option symbol

Fluid and application	Option symbol	Seal material	Body material	Guide ring and piston ring material	Coil insulation type
Steam (1 MPa or less)	S	FKM	C37	PPS	H
	Q		Stainless steel		

\* Use the VXZ series for air, water and oil when a fluid other than steam is used. (Refer to page 1 for detail.)

# Series VXS22/23


## For Steam

(1 MPa, 183°C or less)

### Model/Valve Specifications

N.C.

Passage symbol



#### Normally Closed (N.C.)


Port size (Nominal size)	Orifice diameter (mmø)	Model	Min. operating pressure differential (MPa)	Max. operating pressure differential (MPa)	Flow-rate characteristics		Max. system pressure (MPa)	Weight (g)	
					Av x 10 <sup>-6</sup> m <sup>2</sup>	Conversion Cv			
1/4 (8A)	10	VXS2230-02	0	1.0	58	2.4	1.0	490	
3/8 (10A)		VXS2230-03			67	2.8			
1/2 (15A)	15	VXS2240-04			130	5.3		660	
3/4 (20A)	20	VXS2350-06			220	9.2			1200
1 (25A)	25	VXS2360-10			290	12.0			

Note) Weight of grommet type. Add 10 g for conduit type, 60 g for conduit terminal type respectively.

• Refer to "Glossary of Terms" on page 12 for details on the maximum operating pressure differential and the maximum system pressure.

### Ambient and Fluid Temperature

Power supply	Fluid temperature (°C)	Ambient temperature (°C)
	Solenoid valve option symbol	
	S, Q	
AC, Class H coil	Steam, 183 or less	-10 to 60

 Note) Dew point temperature: -10°C or less

### Valve Leakage Rate

#### Internal Leakage

Seal material	Leakage rate (Air)
FKM	1.0 cm <sup>3</sup> /min or less

Refer to page 9 for selection.

**How to Order**

**AC, Class H coil  
(Full wave rectifier type)**

**VXS 22 3 0 S [ ] - 02 [ ] - 1 G R1 - [ ]**

**Model**  
Refer to the below table (1) for availability.

**Orifice diameter**  
Refer to the below table (1) for availability.

**Valve/Body configuration**  
0 N.C./Single unit

**Solenoid valve option**

Symbol	Seal material	Body material	Coil insulation type
S	FKM	C37	H
Q		Stainless steel	

**Option**

Nil	—
Z	Oil-free spec.

**Port size**  
Refer to the below table (1) for availability.

**Thread type**


Nil	Rc
T	NPTF
F	G
N	NPT

**Rated voltage**

1	100 VAC 50/60 Hz	7	240 VAC 50/60 Hz
2	200 VAC 50/60 Hz	8	48 VAC 50/60 Hz
3	110 VAC 50/60 Hz	J	230 VAC 50/60 Hz
4	220 VAC 50/60 Hz		

\* Refer to the below table (2) for availability.  
Refer to page 7 for ordering coil only.

**Full wave rectifier type**



\* Bracket is not removable.

Specifications  
For Steam  
Construction  
Dimensions

**Electrical entry**

<b>G: Grommet</b>	<b>C: Conduit</b>	<b>T: With conduit terminal TL: With conduit terminal and light</b>

\* Refer to the table (2) for the available combinations between electrical option (L) and rated voltage.  
\* Surge voltage suppressor is integrated as standard into the full wave rectifier type.

**Table (1) Model – Orifice Diameter – Port Size  
Normally Closed (N.C.)**

Solenoid valve (Port size)		Orifice symbol (diameter)				
Model	VXS22	VXS23	3 (10 mmø)	4 (15 mmø)	5 (20 mmø)	6 (25 mmø)
Port symbol (Port size)	02 (1/4)	—	●	—	—	—
	03 (3/8)	—	●	—	—	—
	04 (1/2)	—	—	●	—	—
	—	06 (3/4)	—	—	●	—
	—	10 (1)	—	—	—	●

**Table (2) Rated Voltage – Electrical Option**

Specifications	Rated voltage		L <sup>Note)</sup>
	Voltage symbol	Voltage	With light
AC	1	100 V	●
	2	200 V	●
	3	110 V	●
	4	220 V	●
	7	240 V	—
	8	48 V	—
	J	230 V	—

Note) Light is available only for conduit terminal type.


# Series VXS22/23

For Steam

## Construction

Normally closed (N.C.)

Body material: C37, Stainless steel

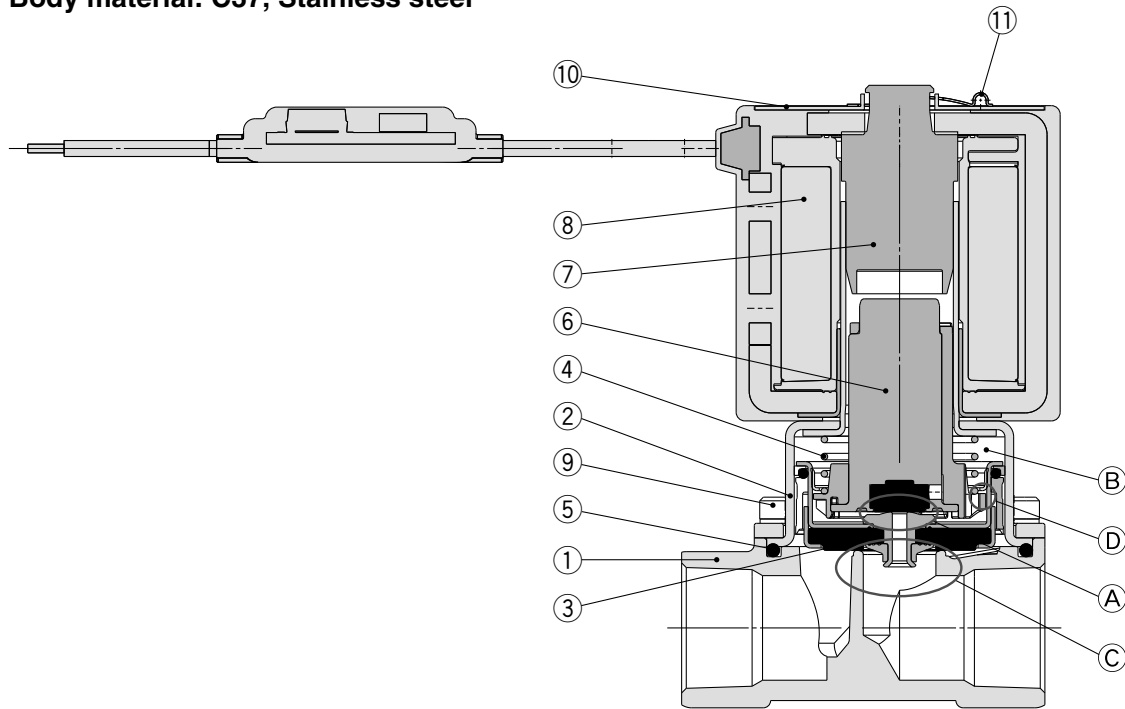

## Working principles

<Valve opened – when there is pressure>

When the coil (8) is energized, the armature assembly (6) is attracted into the core of the tube assembly (7) and the pilot valve (A) is opened.

When the pilot valve is opened and the pressure inside the pilot chamber (B) decreases, resulting in the pressure difference from the inlet pressure. Then, the piston assembly (3) is lifted and the main valve (C) is opened.

<Valve opened – when there is no pressure or under low minute pressure>

Armature assembly (6) interacts with piston assembly (3) at location (D). The piston assembly is pulled upward when the armature assembly is attracted to open the main valve (C).

<Valve closed>

When the coil (8) is de-energized, the armature assembly (6) returns by the reacting force of the return spring (4) and the pilot valve (A) is closed.

When the pilot valve is closed, the pressure inside the pilot chamber (B) increases, resulting that the pressure difference from the inlet pressure is lost and the main valve (C) is closed.

## Component Parts

No.	Description	Material	
		Body material C37 specifications	Body material stainless steel specifications
1	Body	C37	Stainless steel
2	Bonnet	Stainless steel	
3	Piston assembly	PPS, Stainless steel (PTFE, FKM)	
4	Return spring	Stainless steel	
5	O-ring	FKM	
6	Armature assembly	Stainless steel, PPS	
7	Tube assembly	Stainless steel	
8	Solenoid coil	—	
9	Hexagon socket head bolt	Stainless steel	
10	Name plate	AL	
11	Clip	SK	

The materials in parentheses are the seal materials.





**Dimensions/Body Material: C37, Stainless Steel**


VXS22□0/VXS23□0

Grommet: G

Conduit: C

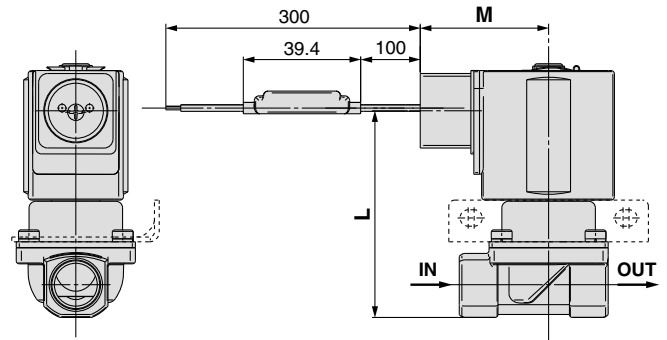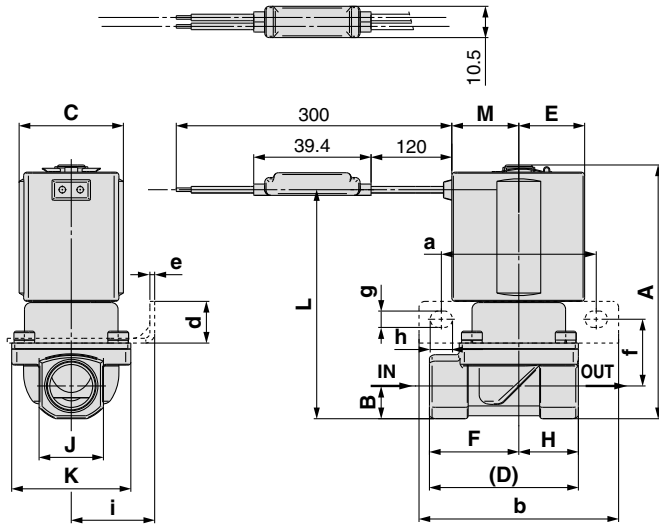

Conduit terminal: T

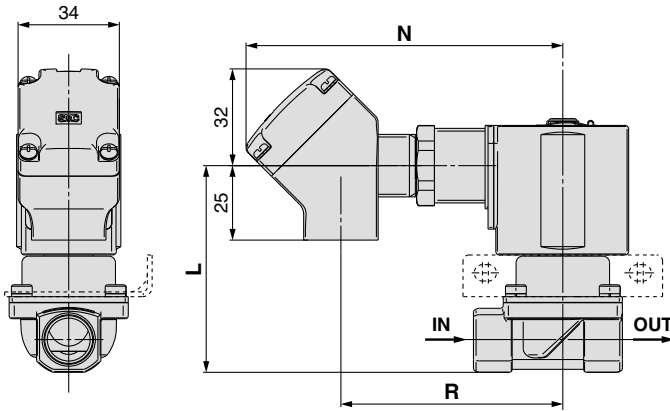

(mm)

Model	Port size P	A	B	C	D	E	F	H	J	K	Electrical entry						
											Grommet		Conduit		Conduit terminal		
											L	M	L	M	L	N	R
VXS2230	1/4, 3/8	85.5	11	35	50	22.5	30	20	22	40	77	22.5	71	43	71	106.5	74.5
VXS2240	1/2	92.5	14	35	63	22.5	37	26	29.5	52	84	22.5	78	43	78	106.5	74.5
VXS2350	3/4	109	18	40	80	25	47.5	32.5	36	65	100.5	25.5	93	46	93	109	77
VXS2360	1	115	21	40	90	25	55	35	40.5	70	106.5	25.5	99	46	99	109	77

(mm)

Model	Port size P	a	b	d	e	f	g	h	i	Weight (g)
VXS2230	1/4, 3/8	52	67	14	1.6	22.5	5.5	7.5	28	490
VXS2240	1/2	60	75	17	2.3	28.5	6.5	8.5	35	660
VXS2350	3/4	68	87	22	2.6	37	6.5	9	43	1200
VXS2360	1	73	92	22	2.6	40	6.5	9	45	1340

# Series VXS22/23

For Steam

## Replacement Parts

### ● Solenoid coil assembly part number

AC, Class H coil (DIN terminal is not available.)

VX02 **2**N-**1**G-R-H

Series ●


2	VXS22□□
3	VXS23□□

● Coil insulation type

Symbol	Type
H	Class H

● With full wave rectifier

● Electrical entry

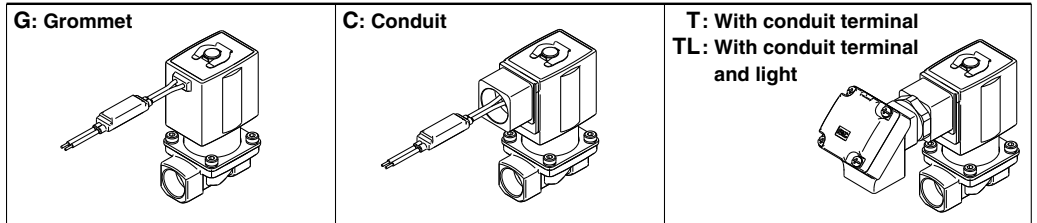

\* Refer to the table (1) for the available combinations between electrical option (L) and rated voltage.  
\* The rectifier and the surge voltage suppressor are integrated as standard.

● Rated voltage <sup>Note)</sup>

Symbol	Voltage	Frequency
1	100 VAC	50/60 Hz
2	200 VAC	50/60 Hz
3	110 VAC	50/60 Hz
4	220 VAC	50/60 Hz
7	240 VAC	50/60 Hz
8	48 VAC	50/60 Hz
J	230 VAC	50/60 Hz

Note) Refer to the table (1) for the available combinations.

**Table (1) Rated Voltage – Electrical Option**

Specifications	Rated voltage		Class H
	Voltage symbol	Voltage	L <sup>Note)</sup> With light
AC	1	100 V	●
	2	200 V	●
	3	110 V	●
	4	220 V	●
	7	240 V	—
	8	48 V	—
	J	230 V	—

Note) Light is available only for conduit terminal type.

● Name plate part number


**AZ-T-** Valve model

↑ Enter by referring to  
"How to Order" (Single Unit).

● Clip part number

For VXS22: **VX022N-10**

For VXS23: **VX023N-10**

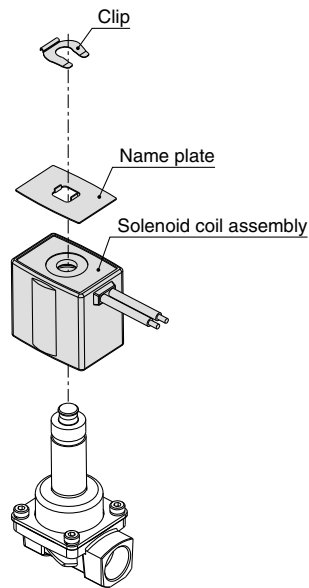

Specifications

For Steam

Construction

Dimensions

# Solenoid Valve

## Flow-rate Characteristics

(How to indicate flow-rate characteristics)

### 1. Indication of Flow-rate Characteristics

The flow-rate characteristics in equipment such as a solenoid valve, etc. are indicated in their specifications shown in Table (1).


Table (1) Indication of Flow-rate Characteristics

Corresponding equipment	Indication by international standard	Other indications	Conformed standards
Process fluid control equipment	$A_v$	—	IEC60534-2-3: 1997 JIS B 2005: 1995
	—	$C_v$	Equipment: JIS B 8471, 8472, 8473
Pneumatic equipment	$C, b$	—	ISO 6358: 1989 JIS B 8390: 2000
	—	$S$	JIS B 8390: 2000 Equipment: JIS B 8373, 8374, 8375, 8379, 8381
		$C_v$	ANSI/(NFPA)T3.21.3: 1990

### 2. Flow-rate Characteristics

Note) Use this chart as a guide. In the case of finding an accurate flow rate, refer to pages 9 to 11.

#### For Saturated Steam

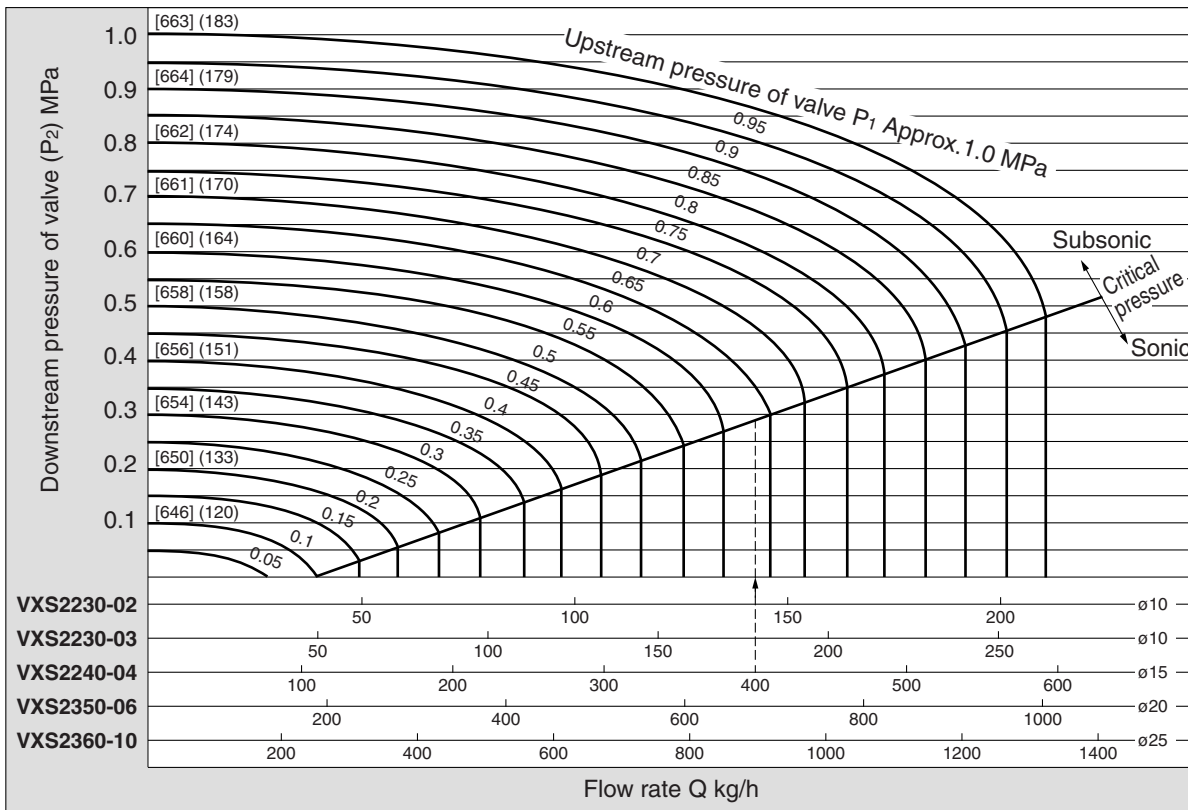

Figures inside [ ] indicate the saturated steam holding heat (kcal/kg). Figures inside ( ) indicate the saturation temperature (°C).

#### How to read the chart

The sonic range pressure to generate a flow rate of 400 kg/h is  $P_1$  Approx. 0.64 MPa for ø15 orifice (VXS224□-04). The holding heat slightly differs depending on the pressure  $P_1$ , but at 400 kg/h it is approx. 25900 kcal/h.

# Solenoid Valve Flow-rate Characteristics

## 3. Process Fluid Control Equipment

(1) Conformed standard

**IEC60534-2-3: 1997: Industrial process control valves. Part 2: Flow capacity, Section Three-Test procedures**

**JIS B 2005: 1995: Test method for the flow coefficient of a valve**

**Equipment standards: JIS B 8471: Solenoid valve for water**

**JIS B 8472: Solenoid valve for steam**

**JIS B 8473: Solenoid valve for fuel oil**

(2) Definition of flow-rate characteristics

**$Av$  factor:** Value of the clean water flow rate represented by  $m^3/s$  which runs through a valve (equipment for test) when the pressure differential is 1 Pa. It is calculated using the following formula.

$$Av = Q \sqrt{\frac{\rho}{\Delta P}} \dots\dots\dots (1)$$

$Av$  : Flow coefficient [ $m^2$ ]

$Q$  : Flow rate [ $m^3/s$ ]

$\Delta P$  : Pressure differential [Pa]

$\rho$  : Density of fluid [ $kg/m^3$ ]

(3) Formula of flow rate

It is described by the practical units. Also, the flow-rate characteristics are shown in Chart (1).

For saturated steam:

$$\text{Critical pressure} = \frac{P_1 - 0.1}{2}$$

When

$$P_2 > \frac{P_1 - 0.1}{2}, \text{ subsonic flow}$$

$$Q = 8.3 \times 10^6 Av \sqrt{\Delta P (P_2 + 0.1)} \dots\dots\dots (2)$$

When

$$P_2 < \frac{P_1 - 0.1}{2}, \text{ sonic flow}$$

$$Q = 8.3 \times 10^6 Av \sqrt{\frac{(P_1 - 0.1)^2}{4} + 0.1 \times P_1} \dots\dots\dots (3)$$

$Q$  : Flow rate [ $\ell/min$ ]

$Av$  : Flow coefficient [ $m^2$ ]

$\Delta P$  : Pressure differential [MPa]

$P_1$  : Upstream pressure [MPa]:  $\Delta P = P_1 - P_2$

$P_2$  : Downstream pressure [MPa]

Conversion of flow coefficient:

$$Av = 28 \times 10^{-6} Kv = 24 \times 10^{-6} Cv \dots\dots\dots (4)$$

Here,

**$Kv$  factor** : Value of the clean water flow rate represented by  $m^3/h$  which runs through a valve at 5 to 40°C, when the pressure differential is 1 bar.

**$Cv$  factor (Reference values):** Figures representing the flow rate of clean water by US gal/min which runs through a valve at 60°F, when the pressure differential is 1 lbf/in<sup>2</sup> (psi).

Value is different from  $Kv$  and  $Cv$  factors for pneumatic purpose due to different test method.

# Solenoid Valve Flow-rate Characteristics

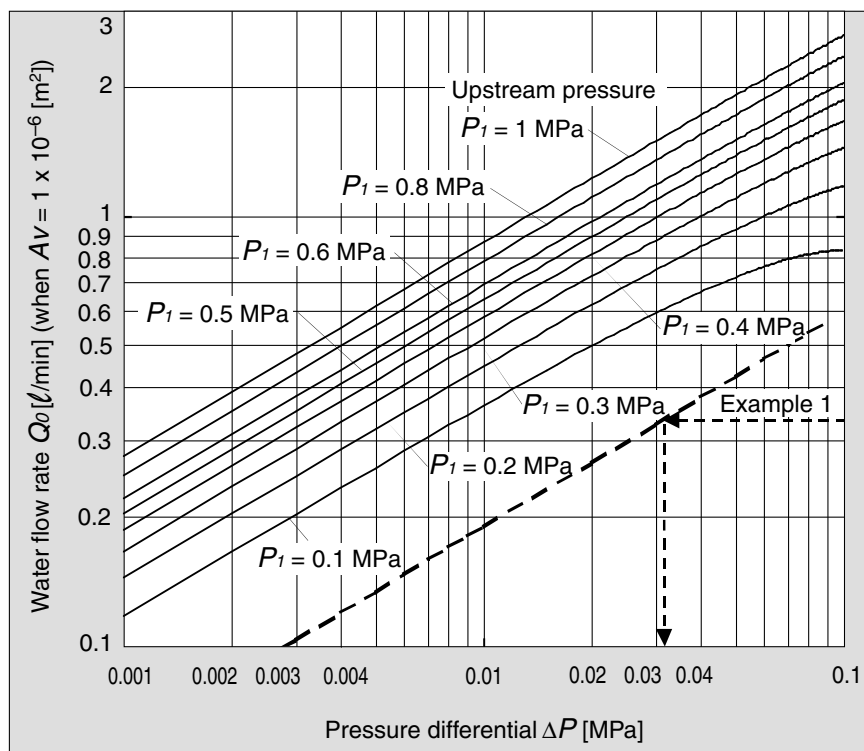


Chart (1) Flow-rate characteristics

Example 1)

Find the pressure differential when water 15 [l/min] runs through a solenoid valve with an  $Av = 45 \times 10^{-6} [m^2]$ . Since  $Q_o = 15/45 = 0.33 [l/min]$ , according to Chart (1), if reading  $\Delta P$  when  $Q_o$  is 0.33, it will be 0.031 [MPa].

(4) Test method

Attach a test equipment with the test circuit shown in Fig. (2). Next, pour water at 5 to 40°C, then measure the flow rate with a pressure differential of 0.075 MPa. However, the pressure differential needs to be set with a large enough difference so that the Reynolds number does not go below a range of  $4 \times 10^4$ .

By substituting the measurement results for formula (1) to figure out  $Av$ .


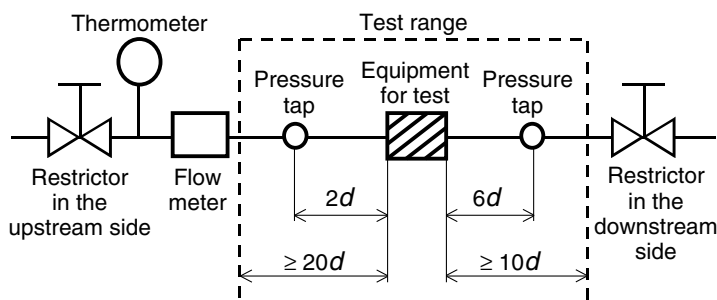


Fig. (2) Test circuit based on IEC60534-2-3, JIS B 2005

## Vapor Dome (Water)

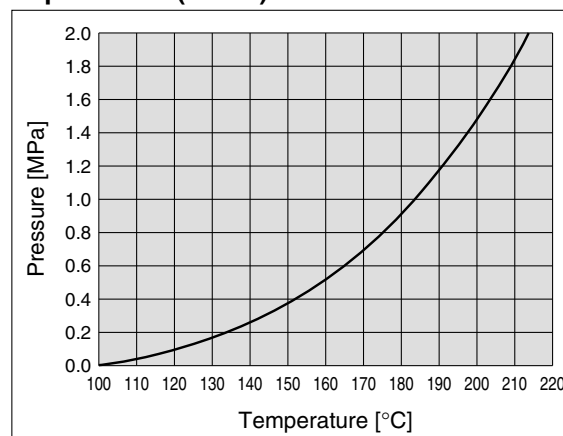

The chart above is calculated using the Antoine equation.

# Glossary of Terms

## Pressure Terminology

### 1. Maximum operating pressure differential

The maximum pressure differential (the difference between the inlet and outlet pressure) which is allowed for operation, with the valve closed or open. When the outlet pressure is 0 MPa, this becomes the maximum operating pressure.

### 2. Minimum operating pressure differential

The minimum pressure differential (the difference between the inlet pressure and outlet pressure) required to keep the main valve stably operated.

### 3. Maximum system pressure

The maximum pressure that can be applied inside the pipelines. (Line pressure) [The pressure differential of the solenoid valve portion must be less than the maximum operating pressure differential.]

### 4. Proof pressure

The pressure in which the valve must be withstood without a drop in performance after holding for 1 minute under prescribed pressure (static pressure) and returning to the operating pressure range. [Value under the prescribed conditions]

## Electrical Terminology

### 1. Apparent power (VA)

Volt-ampere is the product of voltage (V) and current (A). Power consumption (W): For AC,  $W = V \cdot A \cdot \cos\theta$ . For DC,  $W = V \cdot A$ . Note)  $\cos\theta$  shows power factor.  $\cos\theta = 0.6$

### 2. Surge voltage

A high voltage which is momentarily generated by shutting off the power in the shut-off area.

### 3. Enclosure

A degree of protection defined in the "JIS C 0920: Waterproof test of electric machinery/appliance and the degree of protection against the intrusion of solid foreign objects".

IP65: Dusttight, Water-jet-proof

"Water-jet-proof" means that no water intrudes inside an equipment that could hinder from operating normally by means of applying water for 3 minutes in the prescribed manner. Take appropriate protection measures, since a device is not usable in an environment where a droplet of water is splashed.

## Others

### 1. Material

NBR: Nitrile rubber

FKM: Fluoro rubber – Product name: Viton®, Dai-el®, etc.

EPDM: Ethylene propylene rubber

### 2. Oil-free treatment

The degreasing and washing of wetted parts.

### 3. Passage symbol

In the JIS symbol (㊦) IN and OUT are in a blocked condition (㊦), but actually in the case of reverse pressure (OUT>IN), there is a limit to the blocking.




(◇) is used to indicate that blocking of reverse pressure is not possible.



# Safety Instructions

These safety instructions are intended to prevent hazardous situations and/or equipment damage. These instructions indicate the level of potential hazard with the labels of “**Caution,**” “**Warning**” or “**Danger.**” They are all important notes for safety and must be followed in addition to International Standards (ISO/IEC)\*1), and other safety regulations.

\*1) ISO 4414: Pneumatic fluid power – General rules relating to systems.  
ISO 4413: Hydraulic fluid power – General rules relating to systems.  
IEC 60204-1: Safety of machinery – Electrical equipment of machines. (Part 1: General requirements)  
ISO 10218-1: Manipulating industrial robots - Safety.  
etc.

-  **Caution:** **Caution** indicates a hazard with a low level of risk which, if not avoided, could result in minor or moderate injury.
-  **Warning:** **Warning** indicates a hazard with a medium level of risk which, if not avoided, could result in death or serious injury.
-  **Danger :** **Danger** indicates a hazard with a high level of risk which, if not avoided, will result in death or serious injury.

## Warning

### **1. The compatibility of the product is the responsibility of the person who designs the equipment or decides its specifications.**

Since the product specified here is used under various operating conditions, its compatibility with specific equipment must be decided by the person who designs the equipment or decides its specifications based on necessary analysis and test results. The expected performance and safety assurance of the equipment will be the responsibility of the person who has determined its compatibility with the product. This person should also continuously review all specifications of the product referring to its latest catalog information, with a view to giving due consideration to any possibility of equipment failure when configuring the equipment.

### **2. Only personnel with appropriate training should operate machinery and equipment.**

The product specified here may become unsafe if handled incorrectly. The assembly, operation and maintenance of machines or equipment including our products must be performed by an operator who is appropriately trained and experienced.

### **3. Do not service or attempt to remove product and machinery/equipment until safety is confirmed.**

1. The inspection and maintenance of machinery/equipment should only be performed after measures to prevent falling or runaway of the driven objects have been confirmed.
2. When the product is to be removed, confirm that the safety measures as mentioned above are implemented and the power from any appropriate source is cut, and read and understand the specific product precautions of all relevant products carefully.
3. Before machinery/equipment is restarted, take measures to prevent unexpected operation and malfunction.

### **4. Contact SMC beforehand and take special consideration of safety measures if the product is to be used in any of the following conditions.**

1. Conditions and environments outside of the given specifications, or use outdoors or in a place exposed to direct sunlight.
2. Installation on equipment in conjunction with atomic energy, railways, air navigation, space, shipping, vehicles, military, medical treatment, combustion and recreation, or equipment in contact with food and beverages, emergency stop circuits, clutch and brake circuits in press applications, safety equipment or other applications unsuitable for the standard specifications described in the product catalog.
3. An application which could have negative effects on people, property, or animals requiring special safety analysis.
4. Use in an interlock circuit, which requires the provision of double interlock for possible failure by using a mechanical protective function, and periodical checks to confirm proper operation.





# Safety Instructions

## ⚠ Caution

### 1. The product is provided for use in manufacturing industries.

The product herein described is basically provided for peaceful use in manufacturing industries.

If considering using the product in other industries, consult SMC beforehand and exchange specifications or a contract if necessary.

If anything is unclear, contact your nearest sales branch.

## Limited warranty and Disclaimer/Compliance Requirements

The product used is subject to the following “Limited warranty and Disclaimer” and “Compliance Requirements”. Read and accept them before using the product.

### Limited warranty and Disclaimer

1. The warranty period of the product is 1 year in service or 1.5 years after the product is delivered.\*2)

Also, the product may have specified durability, running distance or replacement parts. Please consult your nearest sales branch.

2. For any failure or damage reported within the warranty period which is clearly our responsibility, a replacement product or necessary parts will be provided.

This limited warranty applies only to our product independently, and not to any other damage incurred due to the failure of the product.

3. Prior to using SMC products, please read and understand the warranty terms and disclaimers noted in the specified catalog for the particular products.

**\*2) Vacuum pads are excluded from this 1 year warranty.**

A vacuum pad is a consumable part, so it is warranted for a year after it is delivered.

Also, even within the warranty period, the wear of a product due to the use of the vacuum pad or failure due to the deterioration of rubber material are not covered by the limited warranty.

### Compliance Requirements

1. The use of SMC products with production equipment for the manufacture of weapons of mass destruction (WMD) or any other weapon is strictly prohibited.

2. The exports of SMC products or technology from one country to another are governed by the relevant security laws and regulations of the countries involved in the transaction. Prior to the shipment of a SMC product to another country, assure that all local rules governing that export are known and followed.



## Series VXS

# Specific Product Precautions 1

Be sure to read before handling.

Refer to back pages 1 and 2 for Safety Instructions, "Handling Precautions for SMC Products" (M-E03-3) for 2 Port Solenoid Valves for Fluid Control Precautions.

### Operating Environment

#### Warning

1. Do not use the valves in an atmosphere having corrosive gases, chemicals, sea water, water, water steam, or where there is direct contact with any of these.
2. Do not use in explosive atmospheres.
3. Do not use in locations subject to vibration or impact.
4. Do not use in locations where radiated heat will be received from nearby heat sources.
5. Employ suitable protective measures in locations where there is contact with water droplets, oil or welding spatter, etc.

### Lubrication

#### Caution

1. Do not apply lubricant to the solenoid valve.  
Scale and sludge are generated by the reaction of oil and steam, and cause destruction and malfunction.  
Do not apply lubricant to the solenoid valve.

### Maintenance

#### Warning

1. Removing the product  
The valve will reach a high temperature when used with high temperature fluids. Confirm that the valve temperature has dropped sufficiently before performing work. If touched inadvertently, there is a danger of being burned.
  1. Shut off the fluid supply and release the fluid pressure in the system.
  2. Shut off the power supply.
  3. Dismount the product.
2. Low frequency operation  
Switch valves at least once every 30 days to prevent malfunction. Also, in order to use it under the optimum state, conduct a regular inspection once a half year.

### Maintenance

#### Caution

1. Lubrication  
Do not apply lubricant to the solenoid valve.  
Scale and sludge are generated by the reaction of oil and steam, and cause destruction and malfunction.
2. Storage  
In case of long term storage after use with heated water, thoroughly remove all moisture to prevent rust and deterioration of rubber materials, etc.
3. Depending on the water quality, the brass body may corrode due to dezincification, causing internal leakage.  
Inspect the product once every six months. If any problem is found, replace it with a product with a stainless steel body.

### Operating Precautions

#### Warning

1. Valves will reach high temperatures from high temperature fluids. Use caution, as there is a danger of being burned if a valve is touched directly.
2. Arrange piping so that condensate will not accumulate in the solenoid valve.  
Install the piping to the solenoid valve higher than peripheral piping. Be sure to avoid installing the piping to the solenoid valve at the lowest part of the piping layout. If condensate accumulates in the solenoid valve or peripheral piping, the steam entering the piping will cause steam hammer. This will lead to destruction and malfunction of the solenoid valve and piping. If steam hammer causes problems, install by-pass piping to thoroughly discharge condensate from the piping. Apply steam to the device afterwards to start operation.

#### Caution

1. The valve of the pilot-operated 2-port solenoid valve may be opened momentarily and result in fluid leakage when pressure is applied to the valve suddenly (if the pump or supply valve starts, for example) while the valve is closed. Please be cautious of this.



## Series VXS

# Specific Product Precautions 2

Be sure to read before handling.

Refer to back pages 1 and 2 for Safety Instructions, “Handling Precautions for SMC Products” (M-E03-3) for 2 Port Solenoid Valves for Fluid Control Precautions.

### Design

#### Warning

- 1. Cannot be used as an emergency shutoff valve, etc.**

The valves presented in this catalog are not designed for safety applications such as an emergency shutoff valve. If the valves are used in this type of system, other reliable safety assurance measures should also be adopted.
- 2. Extended periods of continuous energization**

The solenoid coil will generate heat when continuously energized. Avoid using in a tightly shut container. Install it in a well-ventilated area. Furthermore, do not touch it while it is being energized or right after it is energized.
- 3. This solenoid valve cannot be used for explosion proof applications.**
- 4. Maintenance space**

The installation should allow sufficient space for maintenance activities.
- 5. Actuator drive**

When an actuator, such as a cylinder, is to be driven using a valve, take appropriate measures to prevent potential danger caused by actuator operation.
- 6. Pressure (including vacuum) holding**

It is not usable for an application such as holding the pressure (including vacuum) inside of a pressure vessel because air leakage is entailed in a valve.
- 7. When the conduit type is used as equivalent to an IP65 enclosure, install a wiring conduit, etc.**
- 8. When an impact, such as steam hammer, etc., caused by the rapid pressure fluctuation is applied, the solenoid valve may be damaged. Give an attention to it.**

### Selection

#### Warning

- 1. Confirm the specifications.**

Give careful consideration to the operating conditions such as the application, fluid and environment, and use within the operating ranges specified in this catalog.
- 2. Fluid**
  - 1. Type of fluid**

This product is applicable only for steam of 183°C/1 MPa or less.
  - 2. Flammable oil, gas**

Do not use with these fluids, as they can cause destruction or malfunction.
  - 3. Corrosive gas**

Cannot be used since it will lead to cracks by stress corrosion or result in other incidents.
  - 4. Use an oil-free specification when any oily particle must not enter the passage.**
  - 5. Applicable fluid on the list may not be used depending on the operating condition. Give adequate confirmation, and then determine a model, just because the compatibility list shows the general case.**
- 3. Steam quality**

The use of a steam which contains foreign matter can cause problems such as malfunction and seal failure by promoting wear of the valve seat and armature, and by sticking to the sliding parts of the armature, etc. Install a suitable filter (strainer) immediately upstream from the valve. As a general rule, use 80 to 100 mesh.

When used to supply water to boilers, substances such as calcium and magnesium which generate hard scale and sludge are included. Since this scale and sludge can cause the valve to malfunction, install water softening equipment, and a filter (strainer) directly upstream from the valve to remove these substances.

Do not use steam which includes chemicals, synthetic oils containing organic solvents, salt or corrosive gases, etc., as it can cause destruction or malfunction.
- 4. Ambient environment**

Use within the operable ambient temperature range. Confirm the compatibility between the product's composition materials and the ambient atmosphere. Be sure that the fluid used does not touch the external surface of the product.



# Series VXS

## Specific Product Precautions 3

Be sure to read before handling.


Refer to back pages 1 and 2 for Safety Instructions, "Handling Precautions for SMC Products" (M-E03-3) for 2 Port Solenoid Valves for Fluid Control Precautions.

### Selection

#### Caution

##### 1. Leakage voltage

Particularly when using a resistor in parallel with a switching element and using a C-R element (surge voltage suppressor) to protect the switching element, take note that leakage current will flow through the resistor, C-R element, etc., creating a possible danger that the valve may not turn off.

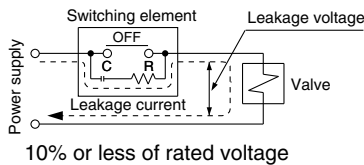

##### 2. Low temperature operation

1. The valve can be used in an ambient temperature of between  $-10$  to  $-20^{\circ}\text{C}$ . However, take measures to prevent freezing or solidification of impurities, etc.
2. When using valves for water application in cold climates, take appropriate countermeasures to prevent the water from freezing in tubing by draining the water, etc. When warming by a heater, etc., be careful not to expose the coil portion to a heater. Installation of a dryer, heat retaining of the body is recommended to prevent a freezing condition in which the dew point temperature is high and the ambient temperature is low, and the high flow runs.

### Mounting

#### Warning

##### 1. If air leakage increases or equipment does not operate properly, stop operation.

After mounting is completed, confirm that it has been done correctly by performing a suitable function test.

##### 2. Do not apply external force to the coil section.

When tightening is performed, apply a wrench or other tool to the outside of the piping connection parts.

##### 3. Be sure not to position the coil downwards.

When mounting a valve with its coil positioned downwards, foreign objects in the fluid will adhere to the iron core leading to a malfunction.

##### 4. Do not warm the coil assembly with a heat insulator, etc.

Use tape, heaters, etc., for freeze prevention on the piping and body only. They can cause the coil to burn out.

##### 5. Secure with brackets, except in the case of steel piping and copper fittings.

##### 6. Avoid sources of vibration, or adjust the arm from the body to the minimum length so that resonance will not occur.

##### 7. Painting and coating

Warnings or specifications printed or labeled on the product should not be erased, removed or covered up.

### Piping

#### Caution

##### 1. Preparation before piping


Before piping is connected, it should be thoroughly blown out with air (flushing) or washed to remove chips, cutting oil and other debris from inside the pipe.

Install piping so that it does not apply pulling, pressing, bending or other forces on the valve body.

##### 2. Wrapping of pipe tape

When connecting pipes, fittings, etc., be sure that chips from the pipe threads and sealing material do not enter the valve.

Furthermore, when pipe tape is used, leave 1.5 to 2 thread ridges exposed at the end of the threads.



##### 3. If an excessive amount of thread sealant such as seal tape or liquid thread sealant is used during piping, it will get inside the product and lead to malfunction.

##### 4. Always tighten threads with the proper tightening torque.

When attaching fittings to valves, tighten with the proper tightening torque shown below.

#### Tightening Torque for Piping

Connection thread	Proper tightening torque N·m
Rc1/4	12 to 14
Rc3/8	22 to 24
Rc1/2	28 to 30
Rc3/4	28 to 30
Rc1	36 to 38

##### 5. Connection of piping to products

When connecting piping to a product, refer to its instruction manual to avoid mistakes regarding the supply port, etc.

##### 6. Steam generated in a boiler contains a large amount of drainage. Be sure to operate it with a drain trap installed.

##### 7. Arrange piping so that condensate will not accumulate in the solenoid valve.

Install the piping to the solenoid valve higher than peripheral piping. Be sure to avoid installing the piping to the solenoid valve at a lower part of the piping layout. If condensate accumulates in the solenoid valve or peripheral piping, the steam entering the piping will cause steam hammer. This will lead to destruction and malfunction of the solenoid valve and piping. If steam hammer causes problems, install by-pass piping to thoroughly discharge condensate from the piping. Apply steam to the device afterwards to start operation.

##### 8. If the effective area of piping on the fluid supply side is restricted, the operating time may become unstable due to differential pressure fluctuation when the valve is closed.

##### 9. For the convenience of maintenance and repair, install a by-pass circuit and use a union for piping.

##### 10. To control the fluid in the tank, connect the piping a little higher than the bottom of the tank.



# Series VXS Specific Product Precautions 4

Be sure to read before handling.

Refer to back pages 1 and 2 for Safety Instructions, "Handling Precautions for SMC Products" (M-E03-3) for 2 Port Solenoid Valves for Fluid Control Precautions.

## Wiring

### ⚠ Caution

- As a rule, use electrical wire with a cross sectional area of 0.5 to 1.25 mm<sup>2</sup> for wiring. Furthermore, do not allow excessive force to be applied to the lines.
- Use electrical circuits which do not generate chattering in their contacts.
- Use voltage which is within  $\pm 10\%$  of the rated voltage. The voltage drop is the value in the lead wire section connecting the coil.


## Electrical Circuits

### ⚠ Caution

[AC, Class H coil (Full wave rectifier type) circuit]


\* The standard product is equipped with surge voltage suppressor.

Grommet, Conduit, Conduit terminal



Without electrical option

Conduit terminal with light

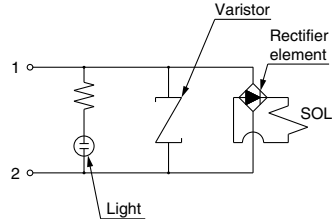

With light


## Electrical Connections

### ⚠ Caution

Grommet

Class H coil: AWG18 Insulator O.D. 2.2 mm

For the replacement of the solenoid coil, cut the lead wire within this range.

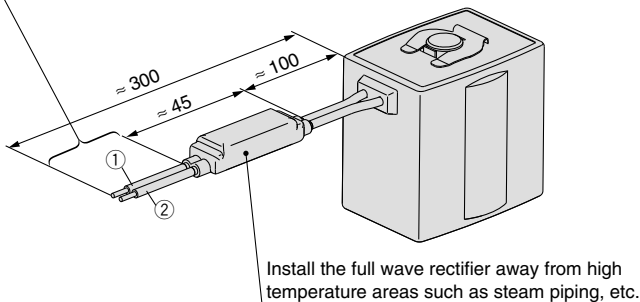

Rated voltage	Lead wire color	
	①	②
100 VAC	Blue	Blue
200 VAC	Red	Red
Other AC	Gray	Gray

\* There is no polarity.


## Electrical Connections

### ⚠ Caution

Conduit

When used as an IP65 equivalent, use seal (part no. VCW20-15-6) to install the wiring conduit. Also, use the tightening torque below for the conduit.

Class H coil: AWG18 Insulator O.D. 2.2 mm

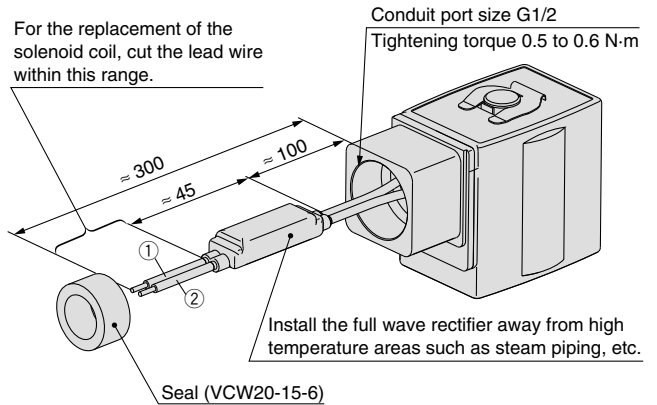

Rated voltage	Lead wire color	
	①	②
100 VAC	Blue	Blue
200 VAC	Red	Red
Other AC	Gray	Gray

\* There is no polarity.


Description	Part no.
Seal	VCW20-15-6

Note) Please order separately.

Conduit terminal


In the case of the conduit terminal, make connections according to the marks shown below.

- Use the tightening torques below for each section.
- Properly seal the terminal connection (G1/2) with the special wiring conduit, etc.

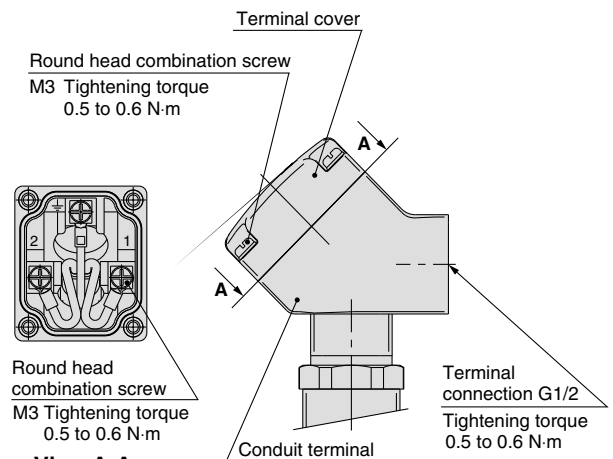

View A-A  
(Internal connection diagram)

# SMC'S GLOBAL MANUFACTURING, DISTRIBUTION AND SERVICE NETWORK

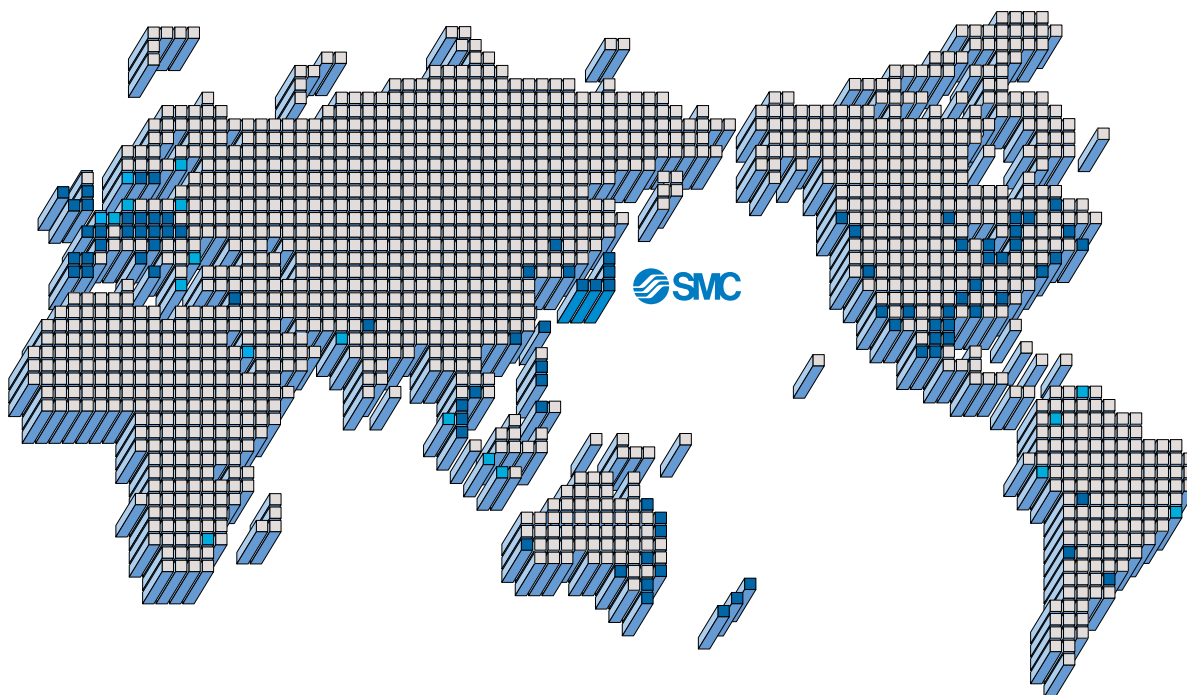

## EUROPE

### AUSTRIA

SMC Pneumatik GmbH (Austria)

### BELGIUM

SMC Pneumatics N.V./S.A.

### BULGARIA

SMC Industrial Automation Bulgaria Eood

### CROATIA

SMC Industrijska Automatika d.o.o.

### CZECH REPUBLIC

SMC Industrial Automation CZ s.r.o.

### DENMARK

SMC Pneumatik A/S

### ESTONIA

SMC Pneumatics Estonia OÜ

### FINLAND

SMC Pneumatics Finland Oy

### FRANCE

SMC Pneumatique SA

### GERMANY

SMC Pneumatik GmbH

### GREECE

SMC Hellas E.P.E.

### HUNGARY

SMC Hungary Ipari Automatizálási Kft.

### IRELAND

SMC Pneumatics (Ireland) Ltd.

### ITALY

SMC Italia S.p.A.

### LATVIA

SMC Pnuematics Latvia SIA

### LITHUANIA

UAB "SMC Pneumatics"

### NETHERLANDS

SMC Pneumatics B.V.

### NORWAY

SMC Pneumatics Norway AS

### POLAND

SMC Industrial Automation Polska Sp.z.o.o.

### ROMANIA

SMC Romania S.r.l.

### RUSSIA

SMC Pneumatik LLC

### SLOVAKIA

SMC Priemyselná Automatizácia Spol s.r.o.

### SLOVENIA

SMC Industrijska Avtomatika d.o.o.

### SPAIN/PORTUGAL

SMC España S.A.

### SWEDEN

SMC Pneumatics Sweden AB

### SWITZERLAND

SMC Pneumatik AG

### U.K.

SMC Pneumatics (U.K.) Ltd.

## ASIA

### CHINA

SMC (China) Co., Ltd.

### HONG KONG

SMC Pneumatics (Hong Kong) Ltd.

### INDIA

SMC Pneumatics (India) Pvt. Ltd.

### MALAYSIA

SMC Pneumatics (S.E.A.) Sdn. Bhd.

### PHILIPPINES

Shoketsu SMC Corporation

### SINGAPORE

SMC Pneumatics (S.E.A.) Pte. Ltd.

### SOUTH KOREA

SMC Pneumatics Korea Co., Ltd.

### TAIWAN

SMC Pneumatics (Taiwan) Co., Ltd.

### THAILAND

SMC (Thailand) Ltd.

## NORTH AMERICA

### CANADA

SMC Pneumatics (Canada) Ltd.

### MEXICO

SMC Corporation (Mexico), S.A. de C.V.

### U.S.A.

SMC Corporation of America

## SOUTH AMERICA

### ARGENTINA

SMC Argentina S.A.

### BOLIVIA

SMC Pneumatics Bolivia S.r.l.

### BRAZIL

SMC Pneumáticos do Brasil Ltda

### CHILE

SMC Pneumatics (Chile) S.A.

### VENEZUELA

SMC Neumatica Venezuela S.A.

## OCEANIA

### AUSTRALIA

SMC Pneumatics (Australia) Pty. Ltd.

### NEW ZEALAND

SMC Pneumatics (N.Z.) Ltd.



### Safety Instructions

Be sure to read "Handling Precautions for SMC Products" (M-E03-3) before using.

## SMC Corporation

Akihabara UDX 15F,  
4-14-1, Sotokanda, Chiyoda-ku, Tokyo 101-0021, JAPAN  
Phone: 03-5207-8249 Fax: 03-5298-5362  
URL <http://www.smcworld.com>  
© 2009 SMC Corporation All Rights Reserved

Specifications are subject to change without prior notice  
and any obligation on the part of the manufacturer.

D-DN

1st printing NT printing NT 12200SZ Printed in Japan.

This catalog is printed on recycled paper with concern for the global environment.

# Zero Differential Pressure Type Pilot Operated 2 Port Solenoid Valve

For Steam



New



Enclosure IP65



Steam

\* Can be used with heated water.

Long service life


**3 million cycles**\*1

\*1 Based on SMC's test condition

Improved air filtration

Double guide rings

- Stable sliding performance
- Improved scraper performance reduces the entry of foreign objects.

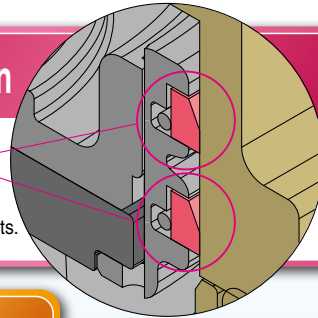

Reduced apparent power

**12 VA**\*2 ← 18 VA

**15 VA**\*3 ← 20 VA

\*2 VXS23/24 ← Existing model VXS22  
\*3 VXS25/26 ← Existing model VXS23

Reduced coil temperature rise

**100°C**\*4 ← 120°C


\*4 VXS23 to 26 ← Existing model VXS22/23

24 VDC added



Electrical entry

Grommet/DIN terminal  
Conduit terminal/Conduit

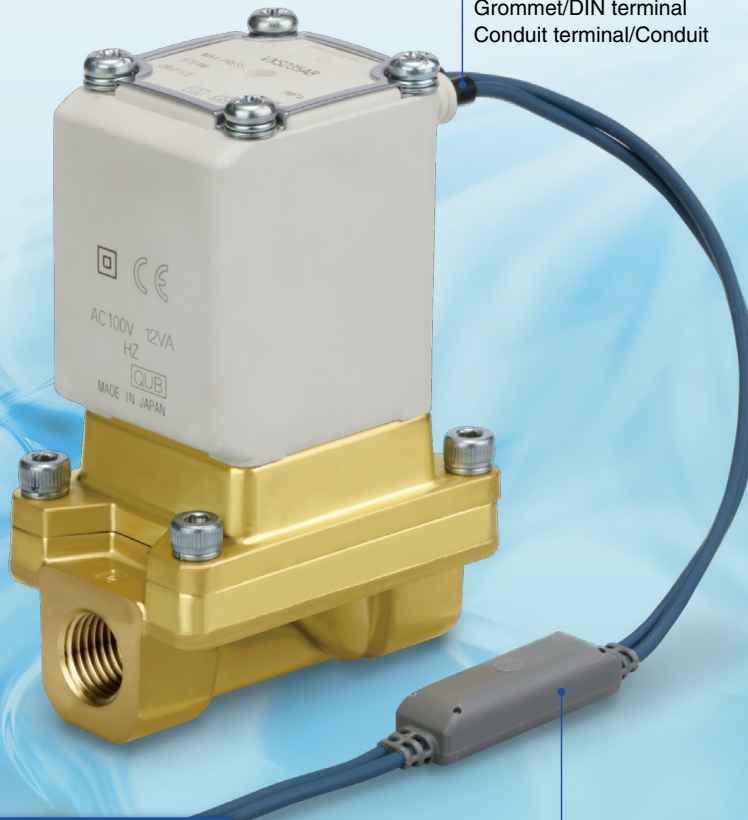


DIN terminal added



Body material

C37, Stainless steel

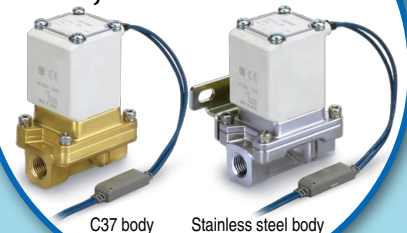

C37 body    Stainless steel body

High sealing performance

Internal leakage (Air)

**1.0 cm<sup>3</sup>/min or less**

Full-wave rectifier standardized

- Improved durability
- Reduced buzz noise
- Low-noise construction

Series **VXS**



CAT.ES70-52A

# Zero Differential Pressure Type Pilot Operated 2 Port Solenoid Valve *Series VXS*



**Enclosure**  
IP65

**Flame resistance**  
UL94V-0 conformed

Flame resistant mold coil material

**24 VDC,**  
DIN terminal  
standardized


**Rubber seal**  
(special FKM) with high  
sealing performance

**Internal leakage (Air)**  
**1.0 cm<sup>3</sup>/min** or less

Reliability is improved due to a piston main valve and a rubber seal made of special FKM.

## Double guide rings

- Stable sliding performance
- Improved scraper performance reduces the entry of foreign objects.

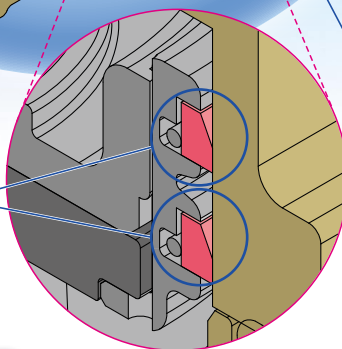

## Clearance

Reduced power consumption

**12 VA**\*1 ← 18 VA

**15 VA**\*2 ← 20 VA

\*1 VXS23/24 ← Existing model VXS22

\*2 VXS25/26 ← Existing model VXS23

Reduced coil temperature rise

**100°C**\*3 ← 120°C

\*3 VXS23 to 26 ← Existing model VXS22/23

Improved armature durability

Low-noise construction

Noise reduction and low impact due to bumper

By providing a bumper and clearance, we reduced the collision sound of the core when ON (when the valve is open).

**Body material**  
C37, Stainless steel

## Built-in full-wave rectifier type (AC specification)

### Improved durability


Service life is extended by the special construction. (compared with current shading coil)

### Reduced buzz noise

Rectified to DC by the full-wave rectifier, resulting in a buzz noise reduction.

### Low-noise construction

Specially constructed to reduce the metal noise during operation.

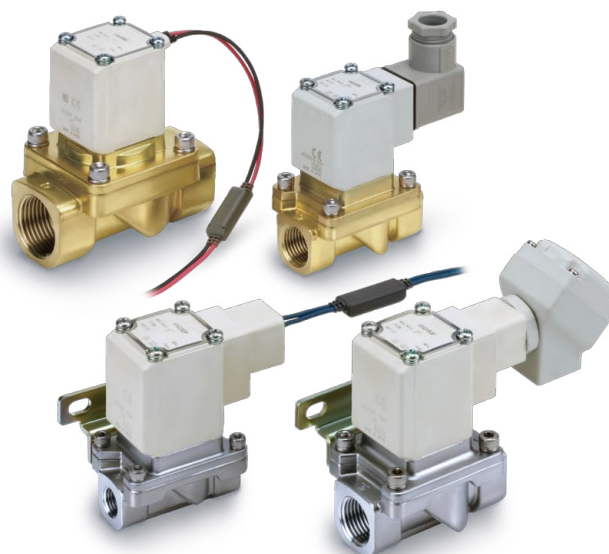

Model	Size	Orifice diameter (mmø)	Port size	Body material	Fluid
VXS23	10A	10	1/4, 3/8	C37	
				Stainless steel	
VXS24	15A	15	1/2	C37	
				Stainless steel	
VXS25	20A	20	3/4	C37	
				Stainless steel	
VXS26	25A	25	1	C37	
				Stainless steel	

Features 1






# Variations


## Series

### Direct Operated

#### Series VX



#### Compact Series VDW

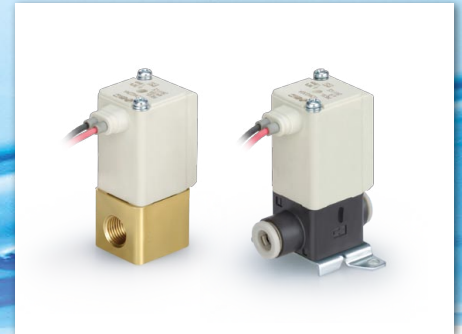

Valve type	Port size	Orifice diameter (mmø)
N.C./N.O.	1/8, 1/4, 3/8, 1/2, ø6, ø8, ø10, ø12	2, 3, 4, 5, 7, 8, 10

Valve type	Port size				Orifice diameter (mmø)
	Common SUP type		Individual SUP type		
N.C./N.O.	IN	OUT	IN	OUT	2, 3, 4, 5, 7
	3/8	1/8 1/4	1/8 1/4	3/8	

Valve type	Port size	Orifice diameter (mmø)
N.C.	M5, 1/8, ø3.2, ø4, ø6	1, 1.6, 2.3, 3.2



### Pilot Operated

#### Series VXD



#### Zero differential pressure

#### Series VXZ

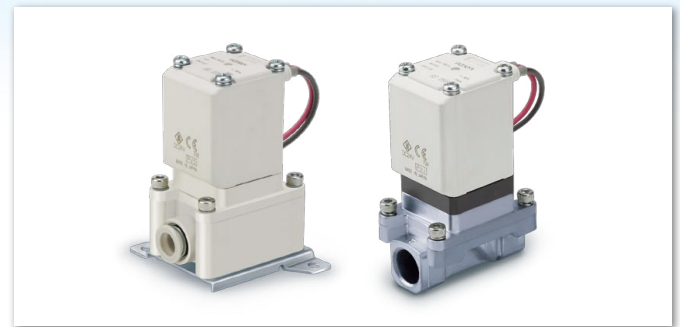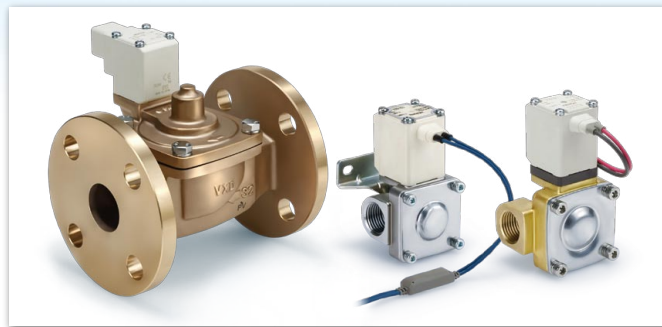

Valve type	Port size	Orifice diameter (mmø)
N.C./N.O.	1/4, 3/8, 1/2, 1, 32A, 40A, 50A, ø10, ø3/8", ø12	10, 15, 20, 25, 35, 40, 50

Valve type	Port size	Orifice diameter (mmø)
N.C./N.O.	1/4, 3/8, 1/2, 3/4, 1, ø10, ø12, ø3/8"	10, 15, 20, 25

### Fluid/Orifice Diameter

Series	Applicable fluid	Orifice diameter (mmø)				
		1	5	10	20	50
<b>Direct Operated</b> <b>Series VX*</b> * For single unit						
<b>Series VDW</b>						
<b>Pilot Operated</b> <b>Series VXD</b>						
<b>Series VXZ</b>						

# Series VXS

## Common Specifications/Selection Steps

### Standard Specifications

Valve specifications	Valve construction		Zero differential pressure type pilot operated piston type
	Withstand pressure (with water pressure)		2.0 MPa
	Body material		C37 (Brass), Stainless steel
	Seal material		FKM
	Enclosure		Dust-tight, Water-jet-proof type (IP65)
	Environment		Location without corrosive or explosive gases
Coil specifications	Rated voltage	AC	100 VAC, 200 VAC, 110 VAC, 230 VAC, (220 VAC, 240 VAC, 48 VAC, 24 VAC) (Note)
		DC	24 VDC
	Allowable voltage fluctuation		±10% of rated voltage
	Allowable leakage voltage	AC (Built-in full-wave rectifier type)	5% or less of rated voltage
		DC	2% or less of rated voltage
Coil insulation type		Class H	

Note) Voltage in ( ) indicates special voltage. (Refer to page 5.)

⚠ Be sure to read “Specific Product Precautions” before handling.

⚠ When pressure differential is less than 0.01 MPa, operation may become unstable. Please contact SMC in case of low flow operation. (Refer to page 7.)

### Solenoid Coil Specifications

#### Normally Closed (N.C.)

##### DC Specification

Model	Power consumption (W) (Note 1)	Temperature rise (°C) (Note 2)
VXS23/24	12	100
VXS25/26	15	100

Note 1) The value at ambient temperature of 20°C and when the rated voltage is applied. (Variation: ±10%)

Note 2) The value at ambient temperature of 20°C and when the rated voltage is applied. The value depends on the ambient environment. This is for reference.


##### AC Specification (Built-in Full-wave Rectifier Type)

Model	Apparent power (VA) (Note 1) 2)	Temperature rise (°C) (Note 3)
VXS23/24	12	100
VXS25/26	15	100

Note 1) The value at ambient temperature of 20°C and when the rated voltage is applied. (Variation: ±10%)

Note 2) There is no difference in the frequency and the inrush and energized apparent power, since a rectifying circuit is used in the AC (Built-in full-wave rectifier type).

Note 3) The value at ambient temperature of 20°C and when the rated voltage is applied. The value depends on the ambient environment. This is for reference.

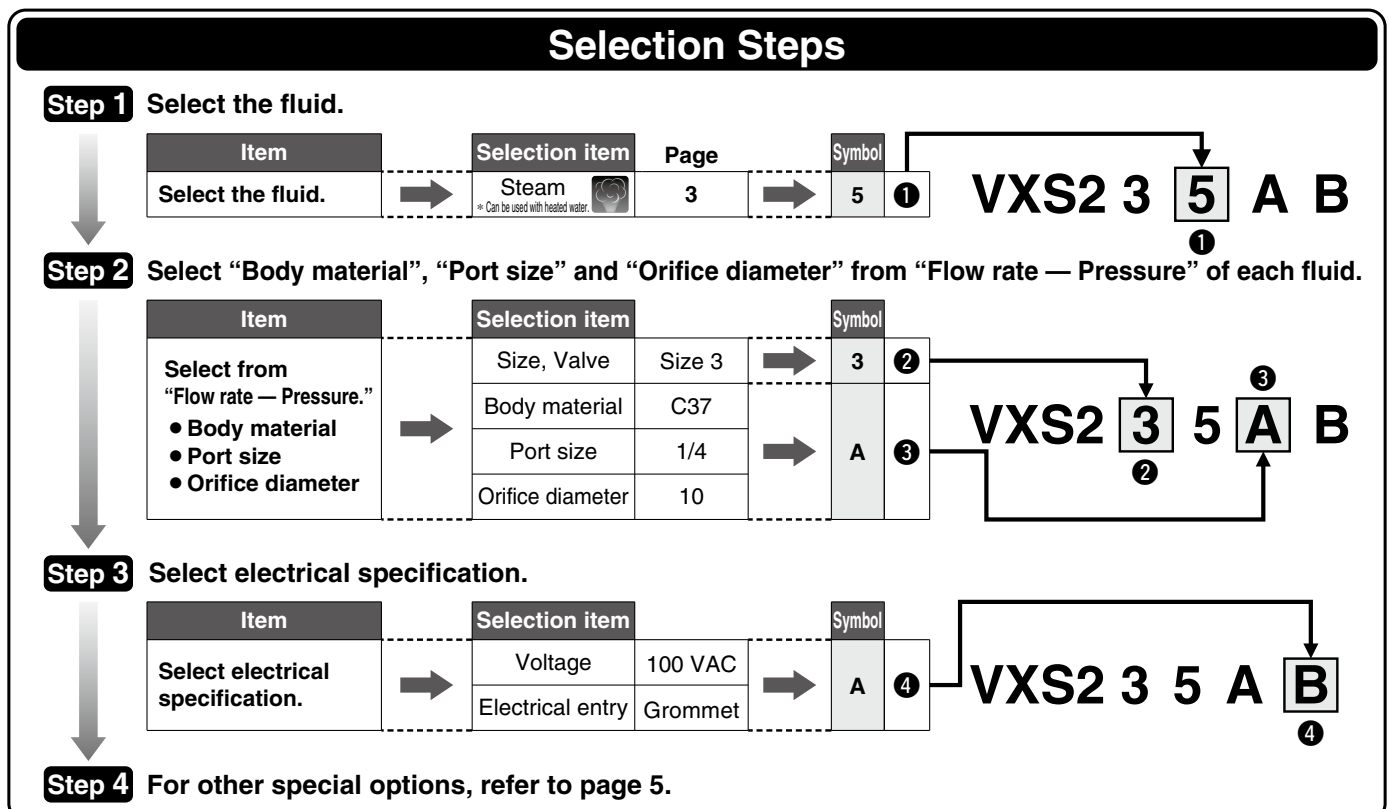



**For Steam**

\* Can be used with heated water.


Specifications

For Steam


## Model/Valve Specifications

**N.C.**

### Symbol



When the valve is closed, flow is blocked from port 1 to port 2. However, if the pressure in port 2 is higher than port 1, the valve will not be able to block the fluid and it will flow from port 2 to port 1.

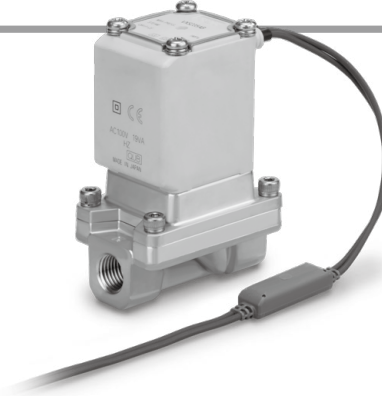

### Normally Closed (N.C.)

Body material	Size	Port size (Nominal diameter)	Orifice diameter (mmø)	Model	Min. operating pressure differential Note 1) (MPa)	Max. operating pressure differential (MPa)		Flow-rate characteristics		Max. system pressure (MPa)	Weight Note 2) (g)	
						AC	DC	Av x 10 <sup>-6</sup> m <sup>2</sup>	Cv			
C37, Stainless steel	3	1/4 (8A)	10	VXS235	0	1.0		58	2.4	1.0	600	
		3/8 (10A)						67	2.8			
	4	1/2 (15A)	15	VXS245				130	5.3		720	
	5	3/4 (20A)	20	VXS255				220	9.2			1100
	6	1 (25A)	25	VXS265				290	12.0			1300

Note 1) The operation of the valve may be unstable due to the capacity of the pressure supply source such as pumps and boilers or the pressure loss by the orifice of piping. Please contact SMC to check if the required valve size can be used in the application. Please contact SMC for the compatibility of the circuit flow and valve size. (Refer to page 7.)

Note 2) Weight of grommet type. Add 10 g for conduit, 30 g for DIN terminal, and 60 g for conduit terminal type respectively.

• Refer to "Glossary of Terms" on page 10 for details on the maximum operating pressure differential.

Options

Construction

## Fluid and Ambient Temperature

Fluid	Temperature (°C)	Ambient temperature (°C)
Steam	183 or less	-20 to 60
Heated water	99 or less	

Note) With no freezing

## Valve Leakage Rate

### Internal Leakage

Fluid	Seal material	Leakage rate
Steam	FKM	1 cm <sup>3</sup> /min or less
Heated water		0.1 cm <sup>3</sup> /min or less


### External Leakage

Fluid	Seal material	Leakage rate
Steam	FKM	1 cm <sup>3</sup> /min or less
Heated water		0.1 cm <sup>3</sup> /min or less

Note) Leakage is the value at ambient temperature 20°C.

Dimensions

# Series VXS



## How to Order



VXS2 **3** **5** **A** **B**

Fluid

**5** For Steam

### Common Specifications






Seal material	FKM
Coil insulation type	Class H
Thread type	Rc

#### • Size/Valve type

Symbol	Size	Valve type	Symbol	Body material	Port size	Orifice diameter
<b>3</b>	10A	N.C.	<b>A</b>	C37	1/4	10
			<b>B</b>		3/8	
			<b>C</b>	Stainless steel	1/4	
			<b>D</b>		3/8	
<b>4</b>	15A	N.C.	<b>F</b>	C37	1/2	15
			<b>G</b>	Stainless steel		
<b>5</b>	20A	N.C.	<b>H</b>	C37	3/4	20
			<b>J</b>	Stainless steel		
<b>6</b>	25A	N.C.	<b>K</b>	C37	1	25
			<b>L</b>	Stainless steel		

#### • Body material/Port size/Orifice diameter

#### • Voltage/Electrical entry

Symbol	Voltage	Electrical entry
<b>A</b>	24 VDC	Grommet 
<b>B</b>	100 VAC	Grommet (With surge voltage suppressor) 
<b>C</b>	110 VAC	
<b>D</b>	200 VAC	
<b>E</b>	230 VAC	
<b>G</b>	24 VDC	DIN terminal (With surge voltage suppressor Note 1) 2) 
<b>H</b>	100 VAC	
<b>J</b>	110 VAC	
<b>K</b>	200 VAC	
<b>L</b>	230 VAC	
<b>N</b>	100 VAC	Conduit terminal (With surge voltage suppressor) 
<b>P</b>	110 VAC	
<b>Q</b>	200 VAC	
<b>R</b>	230 VAC	
<b>T</b>	100 VAC	Conduit (With surge voltage suppressor) 
<b>U</b>	110 VAC	
<b>V</b>	200 VAC	
<b>W</b>	230 VAC	
<b>Z</b>	Other voltages	

Note 1) Coil for DIN terminal H type with AC voltage does not have full-wave rectifier. Full-wave rectifier is built in the DIN connector. Refer to page 9 to order it as an accessory.

Note 2) DIN connector insulation class is Class "B".

Note 3) Faston terminal is not available.

#### For other special options, refer to page 5.

Special voltage	24 VAC
	48 VAC
	220 VAC
	240 VAC
DIN terminal with light	
Conduit terminal with light	
Without DIN connector	
Oil-free	
G thread	
NPT thread	
With bracket	
Special electrical entry direction	

# Series VXS

## Other Special Options

### Electrical options (Special voltage, With light)

VXS2 3 5 A Z 1A

Enter standard product number.

Electrical option

Special voltage/Electrical entry/Electrical option

Specification	Symbol	Voltage	Electrical entry
Special voltage	1A	48 VAC	Grommet (With surge voltage suppressor)
	1B	220 VAC	
	1C	240 VAC	
	1U	24 VAC	
	1F	48 VAC	DIN terminal (With surge voltage suppressor)
	1G	220 VAC	
	1H	240 VAC	
	1V	24 VAC	
	1K	48 VAC	Conduit terminal (With surge voltage suppressor)
	1L	220 VAC	
	1M	240 VAC	
	1W	24 VAC	
	1P	48 VAC	Conduit (With surge voltage suppressor)
1Q	220 VAC		
1R	240 VAC		
1Y	24 VAC		

With light	2A	24 VDC	DIN terminal (With surge voltage suppressor)
	2B	100 VAC	
	2C	110 VAC	
	2D	200 VAC	
	2E	230 VAC	
	2F	48 VAC	
	2G	220 VAC	
	2H	240 VAC	
	2V	24 VAC	Conduit terminal (With surge voltage suppressor)
	2L	100 VAC	
	2M	110 VAC	
	2N	200 VAC	
	2P	230 VAC	
	2Q	48 VAC	
	2R	220 VAC	
	2S	240 VAC	
2W	24 VAC		

### Other options (Oil-free, Port thread)

VXS2 3 5 A A Z

Enter standard product number.

Other option

Oil-free/Port thread

Symbol	Oil-free	Port thread
Nil	—	Rc
A	—	G
B	—	NPT
D	○	G
E	○	NPT
Z	○	Rc

Specifications

For Steam

Options

Construction

Dimensions

\* Enter symbols in the order below when ordering a combination of electrical option, other option, etc.

Example) VXS2 3 5 A Z 1A Z XB A

Electrical option

Special electrical entry direction


Other option

With bracket

## Installation options (Mounting option/Special electrical entry direction)

The following shows combinations that can be selected using installation options.

**Combinations**

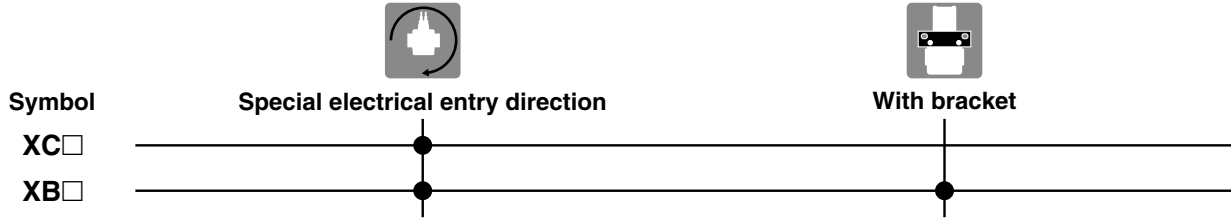

### Special Electrical Entry Direction

VXS2     XC A

Enter standard product number.

Symbol	Rotation angle
A	90° 
B	180° 
C	270° 

\*1 Available for the VXS23 to 26.  
\*2 Bracket is packed in the same container as the main body.

### With Bracket/ Special Electrical Entry Direction


VXS2     XB A

Enter standard product number.

Symbol	Rotation angle
Nil	Standard 
A	90° 
B	180° 
C	270° 

\*1 Available for the VXS23 to 26.  
\*2 Bracket is packed in the same container as the main body.

### How to mount a bracket

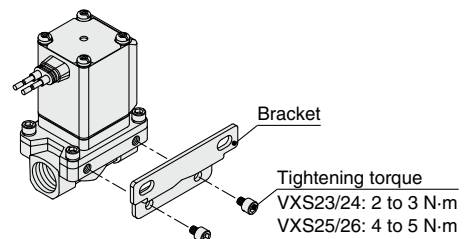

\* Enter symbols in the order below when ordering a combination of electrical option, other option, etc.

Example) VXS2 3 5 A Z 1A Z XB A


Electrical option ●  
Other option ●  
Special electrical entry direction ●  
With bracket ●

## Construction/Normally Closed (N.C.)

Body material: C37, Stainless steel

### Component Parts


No.	Description	Material
1	Solenoid coil	Cu + Fe + Resin
2	Coil cover	Stainless steel
3	Tube assembly	Stainless steel
4	Return spring	Stainless steel
5	Armature/Piston assembly	Stainless steel, FKM
6	Stopper	FKM
7	Bonnet	C37, Stainless steel
8	Body	C37, Stainless steel
9	O-ring	FKM

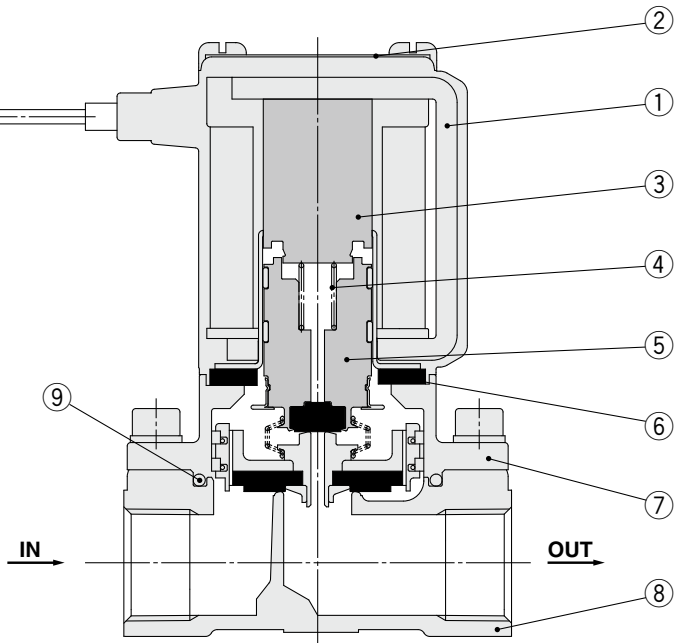

## Working Principle


### De-energized

The fluid enters from the IN goes through the supply orifice to fill the pressure action chamber. Main valve is closed by the pressure in the pressure action chamber and the reaction force of the return spring.

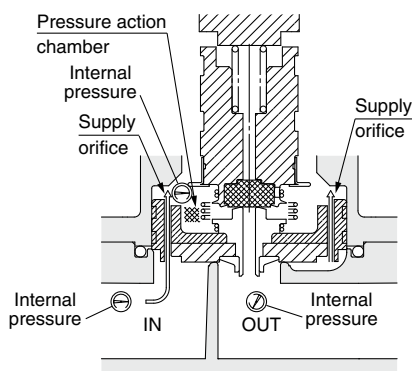


### Right after energized (Pilot valve open)

When the coil is energized, the armature is attracted causing the pilot orifice to opening. The fluid filling the pressure action chamber flows to the OUT side through the pilot orifice.

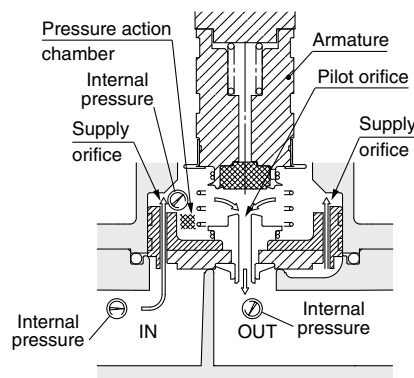

### Energized (Main valve side)

The pressure in the pressure action chamber decreases by discharging fluid through the pilot orifice. Because the force which pushes down the valve is reduced by the discharge of the fluid, the force that pushes up the main valve overcomes the push down force and opens the main valve. The main valve opens by the lift spring reaction force even if pressure on the IN side is 0 MPa or very low pressure.

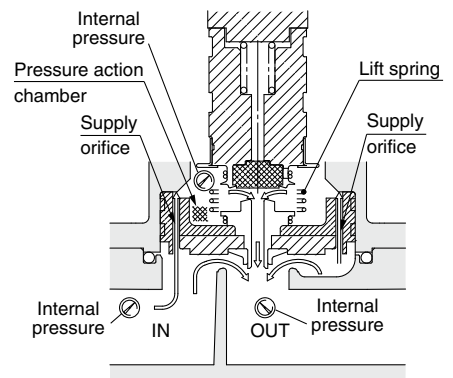

## ⚠ Warning


Unstable flow may occur with the product under the following conditions: • low flow from the pump or boiler, etc. • use of several elbows or tees in the circuit, or • thin nozzles installed at the end of the piping etc. This can cause valve opening/closing failure, or oscillation, and cause a valve malfunction. If products are used with vacuum, then the vacuum level can be unstable due to these conditions. Please contact SMC to check if the valve can be used in the application by providing the relevant fluid circuit.

# Series VXS




## Dimensions/Body Material: C37, Stainless Steel


### Grommet

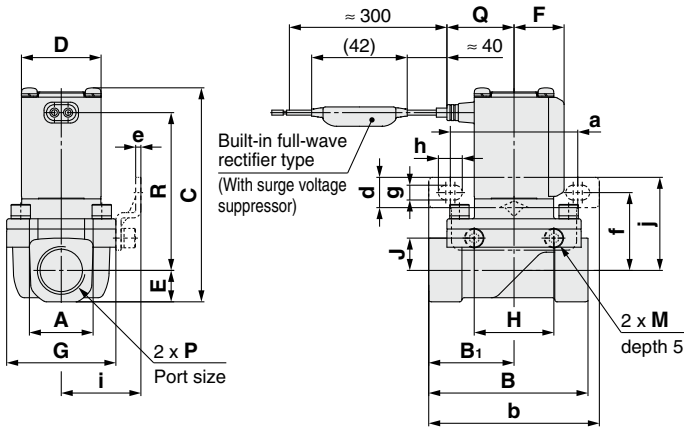



### Conduit terminal

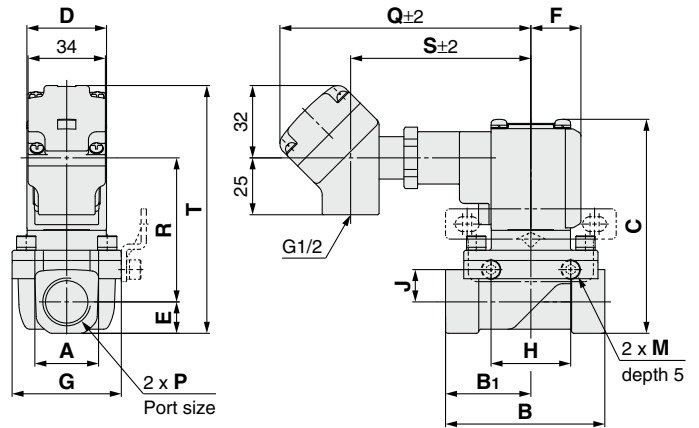

### Conduit

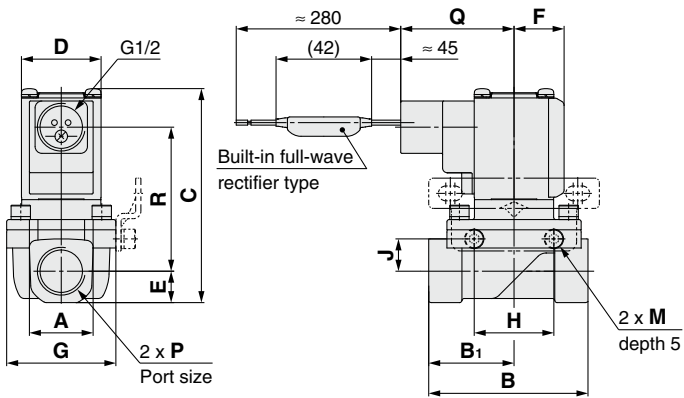

### DIN terminal

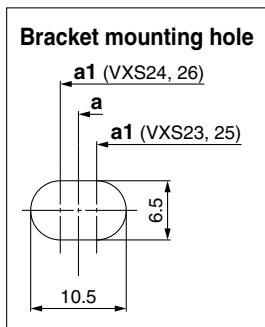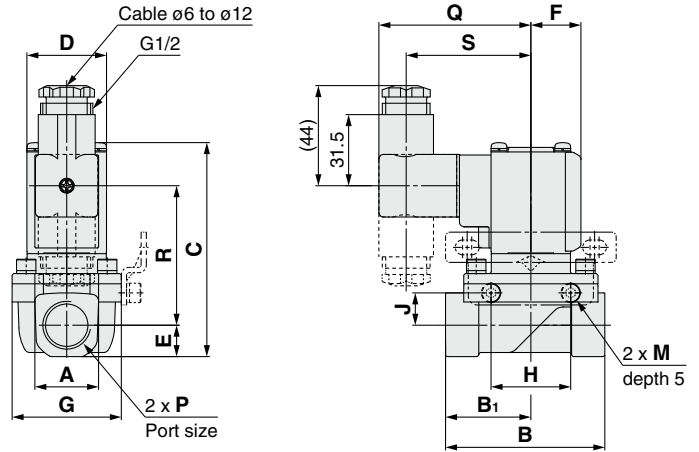

### Dimensions


Model	Port size P	A	B	B <sub>1</sub>	C	D	E	F	G	H	J	M	Bracket mounting (mm)								
													a	b	d	e	f	g	h	i	j
VXS23	1/4, 3/8	21	57	28.5	87.5	35	10.5	22	40	35	10	M5	56	75	13.5	2.3	30	6.5	10.5	31	37
VXS24	1/2	28	70	37.5	94	35	14	22	48	35	14	M5	56	75		2.3	34	6.5	10.5	35	41
VXS25	3/4	33.5	71	38.5	105.5	40	17	24.5	62	33	15.2	M6	70.5	92		2.3	39	6.5	10.5	43	46
VXS26	1	42	95	49.5	111.5	40	20	24.5	66	37	17.2	M6	70.5	92		2.3	41	6.5	10.5	45	48

Model	Port size P	Electrical entry										
		Grommet		DIN terminal			Conduit terminal			Conduit		
		Q	R	Q	R	S	Q	R	S	T	Q	R
VXS23	1/4, 3/8	29.5	66	67	58	55	110.5	60	79.5	102.5	50	60
VXS24	1/2	29.5	69.5	67	61.5	55	110.5	63.5	79.5	109	50	63.5
VXS25	3/4	32	78	69.5	70	57.5	113	72	82	120.5	52.5	72
VXS26	1	32	81	69.5	72.5	57.5	113	74.5	82	126.5	52.5	74.5



## Replacement Parts

### • DIN Connector Part No.



#### <Coil Insulation Type/Class H>

Electrical option	Rated voltage	Connector part no.
None	24 VDC	<b>GDM2A-G-S5</b>
	100 VAC	<b>GDM2A-R</b>
	110 VAC	
	200 VAC	
	220 VAC	
	230 VAC	
	240 VAC	
	24 VAC	
	48 VAC	
With light	24 VDC	<b>GDM2A-G-Z5</b>
	100 VAC	<b>GDM2A-R-L1</b>
	110 VAC	<b>GDM2A-R-L1</b>
	200 VAC	<b>GDM2A-R-L2</b>
	220 VAC	<b>GDM2A-R-L2</b>
	230 VAC	<b>GDM2A-R-L2</b>
	240 VAC	<b>GDM2A-R-L2</b>
	24 VAC	<b>GDM2A-R-L5</b>
	48 VAC	<b>GDM2A-R-L5</b>

### • Gasket Part No. for DIN Connector

**VCW20-1-29-1-F**

### • Gasket Assembly Part No.

**VXZ 3 0S-14A-1**

<b>3</b>	VXS <sub>2<sup>3</sup>/<sub>4</sub>5</sub> □
<b>5</b>	VXS <sub>2<sup>5</sup>/<sub>8</sub>5</sub> □

\* 2 mounting screws are shipped together with the bracket assembly.

Specifications

For Steam

Options

Construction

Dimensions

## Pressure Terminology

### 1. Maximum operating pressure differential

The maximum pressure differential (the difference between the inlet and outlet pressure) which is allowed for operation. When the outlet pressure is 0 MPa, this becomes the maximum operating pressure.

### 2. Minimum operating pressure differential

The minimum pressure differential (the difference between the inlet pressure and outlet pressure) required to keep the main valve fully open.

### 3. Maximum system pressure

The maximum pressure that can be applied inside the pipelines (line pressure).

[The pressure differential of the solenoid valve portion must be less than the maximum operating pressure differential.]

### 4. Withstand pressure

The pressure in which the valve must be withstood without a drop in performance after holding for one minute under prescribed pressure (static pressure) and returning to the operating pressure range. [value under the prescribed conditions]

## Electrical Terminology

### 1. Apparent power (VA)

Volt-ampere is the product of voltage (V) and current (A).

Power consumption (W): For AC,  $W = V \cdot A \cdot \cos\theta$ . For DC,  $W = V \cdot A$ .

Note)  $\cos\theta$  shows power factor.  $\cos\theta \approx 0.9$


### 2. Surge voltage

A high voltage which is momentarily generated by shutting off the power in the shut-off area.

### 3. Degree of protection

A degree defined in the "JIS C 0920: Waterproof test of electric machinery/appliance and the degree of protection against the intrusion of solid foreign objects."

Verify the degree of protection for each product.

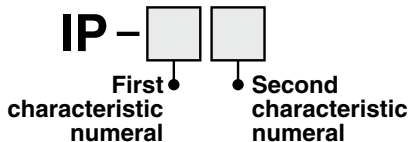

#### ● First Characteristics: Degrees of protection against solid foreign objects

0	Non-protected
1	Protected against solid foreign objects of 50 mmø and greater
2	Protected against solid foreign objects of 12 mmø and greater
3	Protected against solid foreign objects of 2.5 mmø and greater
4	Protected against solid foreign objects of 1.0 mmø and greater
5	Dust-protected
6	Dust-tight

## Electrical Terminology

### ● Second Characteristics: Degrees of protection against water

0	Non-protected	—
1	Protected against vertically falling water drops	Drip-proof type 1
2	Protected against vertically falling water drops when enclosure tilted up to 15°	Drip-proof type 2
3	Protected against rainfall when enclosure tilted up to 60°	Rain-proof type
4	Protected against splashing water	Splash-proof type
5	Protected against water jets	Water-jet-proof type
6	Protected against powerful water jets	Powerful water-jet-proof type
7	Protected against the effects of temporary immersion in water	Immersion type
8	Protected against the effects of continuous immersion in water	Submersible type

#### Example) IP65: Dust-tight, Water-jet-proof type

**"Water-jet-proof type"** means that no water intrudes inside an equipment that could hinder from operating normally by means of applying water for 3 minutes in the prescribed manner. Take appropriate protection measures, since a device is not usable in an environment where a droplet of water is splashed constantly.

## Others

### 1. Material

FKM: Fluororubber

### 2. Oil-free treatment

The degreasing and washing of wetted parts

### 3. Symbol

When the valve is closed, flow is blocked from port 1 to port 2. However, if the pressure in port 2 is higher than port 1, the valve will not be able to block the fluid and it will flow from port 2 to port 1.

# Solenoid Valve Flow-rate Characteristics

## (How to indicate flow-rate characteristics)

### 1. Indication of flow-rate characteristics

The flow-rate characteristics in equipment such as a solenoid valve etc., are indicated in their specifications as shown in Table (1).

Table (1) Indication of Flow-rate Characteristics

Corresponding equipment	Indication by international standard	Other indications	Conformed standard
Process fluid control equipment	<i>Av</i>	—	IEC60534-2-3: 1997 JIS B 2005: 1995 Equipment: JIS B 8471, 8472, 8473
	—	<i>Cv</i>	
Pneumatic equipment	<i>C, b</i>	—	ISO 6358: 1989 JIS B 8390: 2000
	—	<i>S</i>	JIS B 8390: 2000 Equipment: JIS B 8373, 8374, 8375, 8379, 8381
		<i>Cv</i>	ANSI/(NFPA) T3.21.3: 1990

### 2. Process fluid control equipment

(1) Conformed standard

**IEC60534-2-3: 1997: Industrial-process control valves. Part 2: Flow capacity, Section Three-Test procedures**

**JIS B 2005: 1995: Test method for the flow coefficient of a valve**

**Equipment standards: JIS B 8471: Solenoid valve for water**

**JIS B 8472: Solenoid valve for steam**

**JIS B 8473: Solenoid valve for fuel oil**

(2) Definition of flow-rate characteristics

**Av** factor: Value of the clean water flow rate represented by m<sup>3</sup>/s which runs through a valve (equipment for test) when the pressure differential is 1 Pa. It is calculated using the following formula.

$$Av = Q \sqrt{\frac{\rho}{\Delta P}} \dots\dots\dots (1)$$

**Av** : Flow coefficient [m<sup>2</sup>]

**Q** : Flow rate [m<sup>3</sup>/s]

**ΔP** : Pressure differential [Pa]

**ρ** : Fluid density [kg/m<sup>3</sup>]

(3) Formula of flow rate

It is described by the practical units. Also, the flow-rate characteristics are shown in Graph (1).

In the case of liquid:

$$Q = 1.9 \times 10^6 Av \sqrt{\frac{\Delta P}{G}} \dots\dots\dots (2)$$

**Q** : Flow rate [L/min]

**Av** : Flow coefficient [m<sup>2</sup>]

**ΔP** : Pressure differential [MPa]

**G** : Relative density [water = 1]

In the case of saturated steam:

$$Q = 8.3 \times 10^6 Av \sqrt{\Delta P (P_2 + 0.1)} \dots\dots\dots (3)$$

**Q** : Flow rate [kg/h]

**Av** : Flow coefficient [m<sup>2</sup>]

**ΔP** : Pressure differential [MPa]

**P<sub>1</sub>** : Upstream pressure [MPa] : **ΔP = P<sub>1</sub> - P<sub>2</sub>**

**P<sub>2</sub>** : Downstream pressure [MPa]


Conversion of flow coefficient:

$$Av = 28 \times 10^{-6} Kv = 24 \times 10^{-6} Cv \dots\dots\dots (4)$$

Here, **Kv** factor : Value of the clean water flow rate represented by m<sup>3</sup>/h which runs through a valve at 5 to 40°C, when the pressure differential is 1 bar.

**Cv** factor (Reference values): Figures representing the flow rate of clean water by US gal/min which runs through a valve at 60°F, when the pressure differential is 1 lbf/in<sup>2</sup> (psi).

Value is different from **Kv** and **Cv** factors for pneumatic purpose due to different test method.

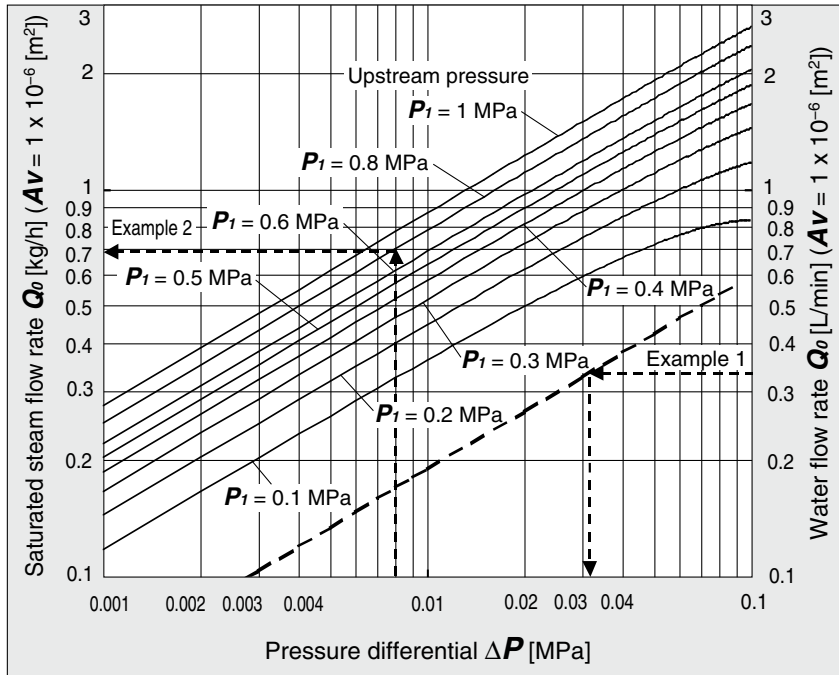

**Graph (1) Flow-rate characteristics**

Example 1)

Obtain the pressure differential when water 15 [L/min] runs through a solenoid valve with an  $Av = 45 \times 10^{-6} [m^2]$ . Since  $Q_0 = 15/45 = 0.33 [L/min]$ , according to Graph (1), if reading  $\Delta P$  when  $Q_0$  is 0.33, it will be 0.031 [MPa].


Example 2)

Obtain the saturated steam flow rate when  $P_1 = 0.8 [MPa]$ ,  $\Delta P = 0.008 [MPa]$  with a solenoid valve with an  $Av = 1.5 \times 10^{-6} [m^2]$ . According to Graph (1), if reading  $Q_0$  when  $P_1$  is 0.8 and  $\Delta P$  is 0.008, it is 0.7 [kg/h]. Therefore, the flow rate  $Q = 0.7 \times 1.5 = 1.05 [kg/h]$ .

(4) Test method


Attach a test equipment with the test circuit shown in Fig. (2). Next, pour water at 5 to 40°C, then measure the flow rate with a pressure differential of 0.075 MPa. However, the pressure differential needs to be set with a large enough difference so that the Reynolds number does not go below a range of  $4 \times 10^4$ .

By substituting the measurement results for formula (1) to figure out **Av**.

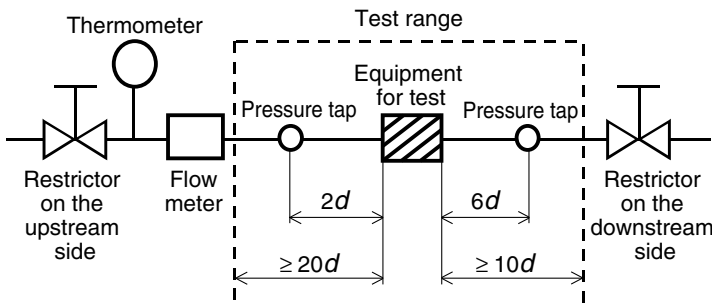

**Fig. (2) Test circuit based on IEC60534-2-3, JIS B 2005**

**Vapor Dome (Water)**

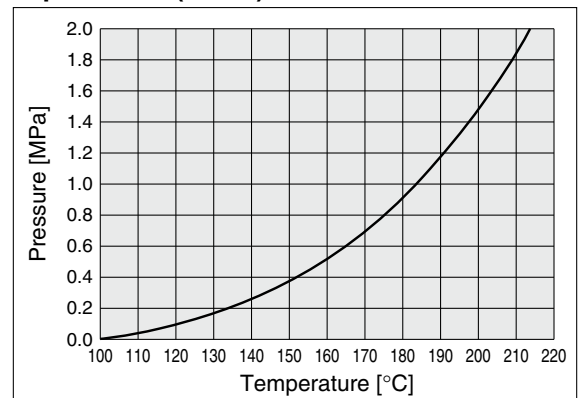


The above chart is calculated using the Antoine equation.

# Series VXS

# Flow-rate Characteristics

Note) Use this graph as a guide. In the case of obtaining an accurate flow rate, refer to pages 11 and 12.


## For Saturated Steam

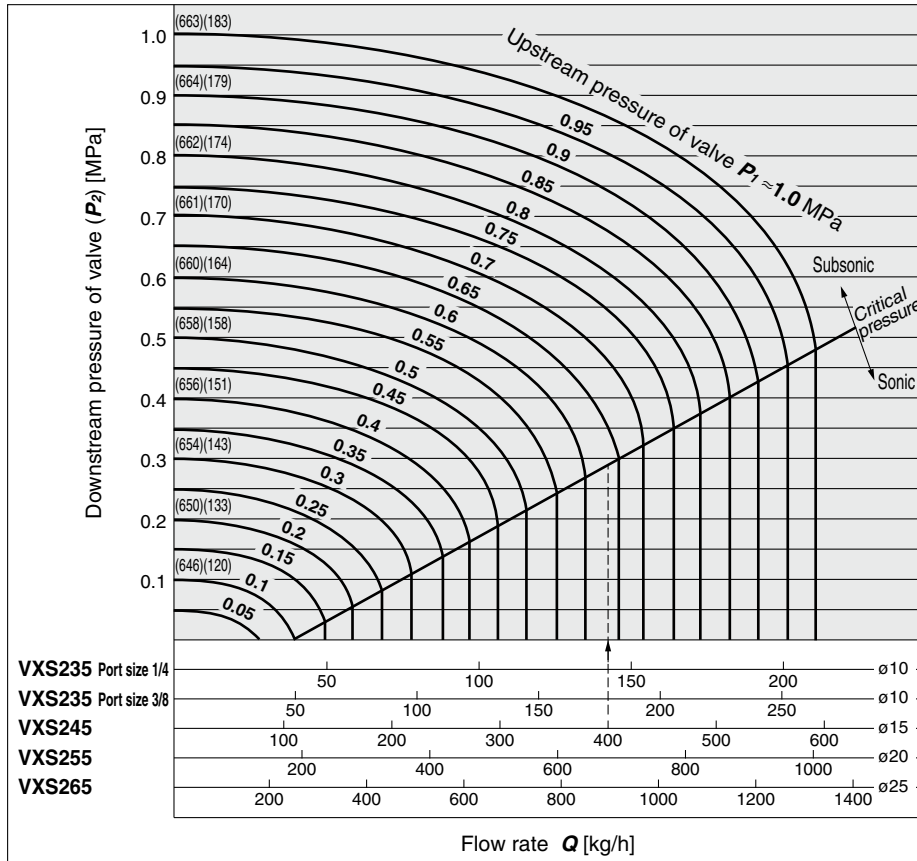

### How to read the graph

The sonic range pressure to generate a flow rate of 400 kg/h is as follows.  
 For a  $\phi 15$  orifice (VXS224□-04),  
 $P_1 \approx 0.64$  MPa  
 The holding heat slightly differs depending on the pressure  $P_1$ , but at 400 kg/h it is approx. 25900 kcal/h.

## For Water

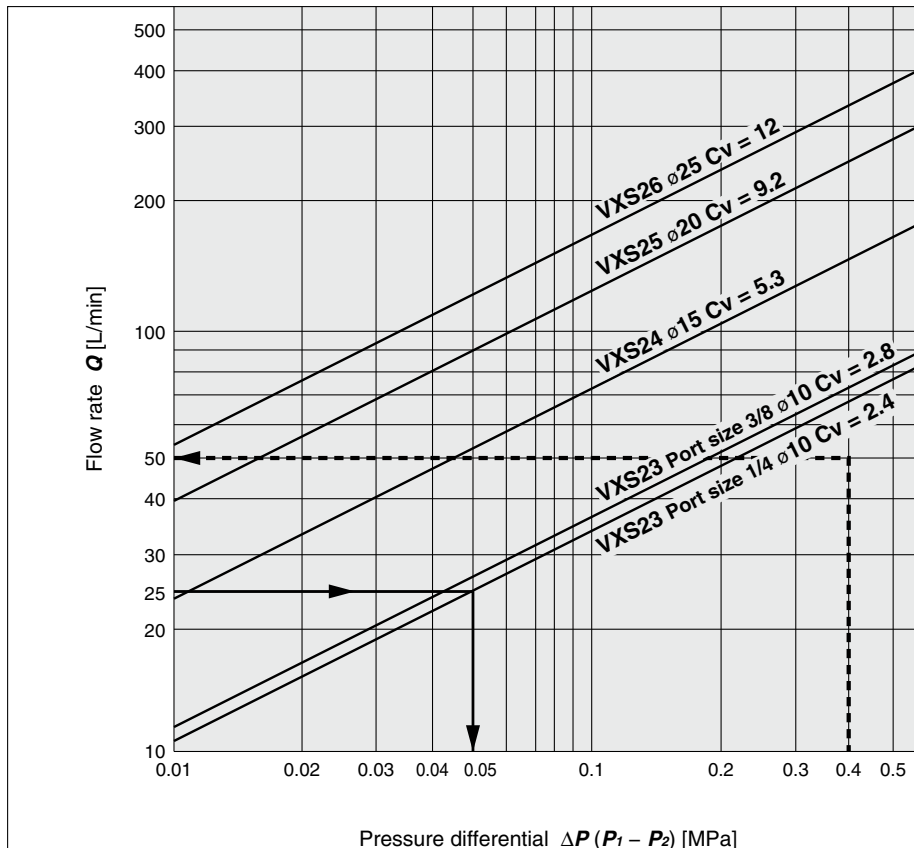

### How to read the graph

The pressure differential to generate a flow rate of 25 L/min water is as follows.  
 For a  $\phi 10$  orifice (VXS23/Port size 1/4),  
 $\Delta P \approx 0.05$  MPa  
 The optimum size for a pressure differential of  $\Delta P \approx 0.2$  MPa and a flow of 50 L/min will be the VXS23 ( $\phi 10$  orifice, port size 3/8).



# Series VXS

## Specific Product Precautions 1

Be sure to read before handling. Refer to back cover for Safety Instructions, "Handling Precautions for SMC Products" (M-E03-3) and the Operation Manual for 2 Port Solenoid Valves for Fluid Control Precautions. Please download it via our website, <http://www.smcworld.com>

### Design

#### Warning

- 1. Cannot be used as an emergency shutoff valve etc.**

The valves presented in this catalog are not designed for safety applications such as an emergency shutoff valve. If the valves are used in this type of system, other reliable safety assurance measures should also be adopted.
- 2. Extended periods of continuous energization**

The solenoid coil will generate heat when continuously energized. Avoid using in a tightly shut container. Install it in a well ventilated area. Furthermore, do not touch it while it is being energized or right after it is energized.
- 3. Liquid rings**

In cases with a flowing liquid, provide a bypass valve in the system to prevent the liquid from entering the liquid seal circuit.
- 4. Pressure holding**

It is not usable for an application such as holding the pressure inside of a pressure vessel because air leakage is entailed in a valve.
- 5. When the conduit type is used as equivalent to an IP65 enclosure, install a wiring conduit etc.**
- 6. When an impact, such as steam hammer etc., caused by the rapid pressure fluctuation is applied, the solenoid valve may be damaged. Give an attention to it.**

### Selection

#### Warning

- 1. Usage with low flow**

Unstable flow may occur with the product under the following conditions: • low flow from the pump or boiler, etc. • use of several elbows or tees in the circuit, or • thin nozzles installed at the end of the piping etc. This can cause valve opening/closing failure, or oscillation, and cause a valve malfunction.

Check the pressure differential and flow to select the appropriate size of the valve referring to the Flow-rate Characteristics on page 13. Ensure that pressure differential does not become lower than 0.01 MPa during ON (N.C.: Valve open).
- 2. Fluid**
  - 1) Corrosive gas**

Cannot be used since it will lead to cracks by stress corrosion or result in other incidents.
  - 2) When a brass body is used, then depending on water quality, corrosion and internal leakage may occur. If such abnormalities occur, exchange the product for a stainless steel body.**
  - 3) Use an oil-free specification when any oily particle must not enter the passage.**

### Selection

#### Warning

- 3. Air quality**

**<Steam, Water>**

The use of a fluid that contains foreign objects can cause problems such as malfunction and seal failure by promoting wear of the valve seat and armature, and by sticking to the sliding parts of the armature etc. Install a suitable filter (strainer) immediately upstream from the valve. As a general rule, use 100 mesh.

As a standard, the mesh count for the strainer is 100 mesh. However, the size and shape of foreign objects that occur depends on the operating environment. Check the fluid status and choose an appropriate mesh count.

The supply water to a boiler includes materials that create a hard sediment or sludge such as calcium and magnesium.

Sediment and sludge from steam can cause the valve to not operate properly. Install a water softening device, which removes these materials. Do not use operation steam which contains chemicals, synthetic oils containing organic solvents, salts or corrosive gases, etc., as these can cause damage or deterioration.

Since the special FKM used for this product improves the alkali-resistance when compared to the general FKM, it can be used for the steam, into which the boiler compound is charged.

However, the resistance to other chemicals, such as organic solvent is the same as the general FKM. So, use this product after checking the resistance to the components included in the boiler compound.
- 4. Ambient environment**

Use within the operable ambient temperature range. Check the compatibility between the product's composition materials and the ambient atmosphere. Be certain that the fluid used does not touch the external surface of the product.
- 5. Low temperature operation**
  - 1) The valve can be used in an ambient temperature of between -20 to -10°C. However, take measures to prevent freezing or solidification of impurities, etc.**
  - 2) When using valves for water application in cold climates, take appropriate countermeasures to prevent the water from freezing in tubing after cutting the water supply from the pump, by draining the water etc. When warming by a heater etc., be careful not to expose the coil portion to a heater.**

Installation of a dryer, heat retaining of the body is recommended to prevent a freezing condition in which the dew point temperature is high and the ambient temperature is low, and the high flow runs.



# Series VXS Specific Product Precautions 2


Be sure to read before handling. Refer to back cover for Safety Instructions, "Handling Precautions for SMC Products" (M-E03-3) and the Operation Manual for 2 Port Solenoid Valves for Fluid Control Precautions. Please download it via our website, <http://www.smcworld.com>

## Selection

### ⚠ Caution

#### 1. Leakage voltage

Particularly when using a resistor in parallel with a switching element and using a C-R element (surge voltage suppressor) to protect the switching element, take note that leakage current will flow through the resistor, C-R element, etc., creating a possible danger that the valve may not turn off.

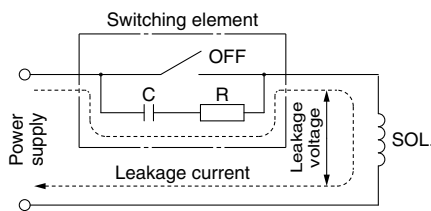

AC coil: 5% or less of rated voltage  
DC coil: 2% or less of rated voltage

## Mounting

### ⚠ Warning

#### 1. If air leakage increases or equipment does not operate properly, stop operation.

After mounting is completed, confirm that it has been done correctly by performing a suitable function test.

#### 2. Do not apply external force to the coil section.

When tightening is performed, apply a wrench or other tool to the outside of the piping connection parts.

#### 3. Mount a valve with its coil position upward, not downward.

When mounting a valve with its coil positioned downward, foreign objects in the fluid will adhere to the iron core leading to a malfunction. Especially for strict leakage control, the coil must be positioned upward.

#### 4. Do not warm the coil assembly with a heat insulator etc.

Use tape, heaters, etc., for freeze prevention on the piping and body only. They can cause the coil to burn out.

#### 5. Secure with brackets, except in the case of steel piping and copper fittings.

#### 6. Avoid sources of vibration, or adjust the arm from the body to the minimum length so that resonance will not occur.

#### 7. Painting and coating

Warnings or specifications printed or labeled on the product should not be erased, removed or covered up.

## Piping

### ⚠ Caution

#### 1. Preparation before piping

Before piping is connected, it should be thoroughly blown out with air (flushing) or washed to remove chips, cutting oil and other debris from inside the pipe. Avoid pulling, compressing, or bending the valve body when piping.

#### 2. Avoid connecting ground lines to piping, as this may cause electric corrosion of the system.

#### 3. Always tighten threads with the proper tightening torque.

Refer to the tightening torque in the table below for connecting steel piping. Lower tightening torque will lead into fluid leakage. For mounting the fittings, refer to the specified torque.

#### Tightening Torque for Piping


Connection thread	Proper tightening torque (N·m)
Rc1/8	3 to 5
Rc1/4	8 to 12
Rc3/8	15 to 20
Rc1/2	20 to 25
Rc3/4	
Rc1	36 to 38

#### 4. Connection of piping to products

When connecting piping to a product, avoid mistakes regarding the supply port etc.

#### 5. Wrapping of sealant tape

When connecting pipes, fittings, etc., be sure that chips from the pipe threads and sealing material do not enter the valve. Furthermore, when sealant tape is used, leave 1.5 to 2 thread ridges exposed at the end of the threads.

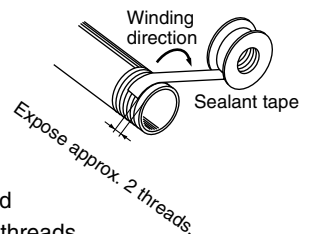

#### 6. If an excessive amount of thread sealant such as sealant tape or liquid thread sealant is used during piping, it will get inside the product and lead to malfunction.

#### 7. Steam generated in a boiler contains a large amount of drainage. Be sure to operate it with a drain trap installed.

#### 8. Arrange piping so that condensate will not accumulate in the solenoid valve.

Install the piping to the solenoid valve higher than peripheral piping. Be sure to avoid installing the piping to the solenoid valve at the lowest part of the piping layout. If condensate accumulates in the solenoid valve or peripheral piping, the steam entering the piping will cause steam hammer. This will lead to destruction and malfunction of the solenoid valve and piping. If steam hammer causes problems, install bypass piping to thoroughly discharge condensate from the piping. Apply steam to the device afterward to start operation.



## Series VXS

# Specific Product Precautions 3

Be sure to read before handling. Refer to back cover for Safety Instructions, "Handling Precautions for SMC Products" (M-E03-3) and the Operation Manual for 2 Port Solenoid Valves for Fluid Control Precautions. Please download it via our website, <http://www.smcworld.com>

### Piping

#### Caution

9. If the effective area of piping on the fluid supply side is restricted, the operating time may become unstable due to differential pressure fluctuation when the valve is closed.
10. For the convenience of maintenance and repair, install a bypass circuit and use a union for piping.
11. To control the fluid in the tank, connect the piping a little higher than the bottom of the tank.

### Wiring

#### Caution

1. As a rule, use electrical wire with a cross sectional area of 0.5 to 1.25 mm<sup>2</sup> for wiring. Furthermore, do not allow excessive force to be applied to the lines.
2. Use electrical circuits which do not generate chattering in their contacts.
3. Use voltage which is within  $\pm 10\%$  of the rated voltage. In cases with a DC power supply where importance is placed on responsiveness, stay within  $\pm 5\%$  of the rated value. The voltage drop is the value in the lead wire section connecting the coil.
4. When a surge from the solenoid affects the electrical circuitry, install a surge voltage suppressor etc., in parallel with the solenoid. Or, adopt an option that comes with the surge voltage protection circuit. (However, a surge voltage occurs even if the surge voltage protection circuit is used. For details, please consult with SMC.)
5. Do not apply AC voltage to AC type unless it is built in full-wave rectifier, or the coil will be damaged.

### Operating Environment

#### Warning

1. Do not use in an atmosphere having corrosive gases, chemicals, sea water, water, water vapor, or where there is direct contact with any of these.
2. Do not use in explosive atmospheres.
3. Do not use in locations subject to vibration or impact.
4. Do not use in locations where radiated heat will be received from nearby heat sources.
5. Employ suitable protective measures in locations where there is contact with water droplets, oil or welding spatter, etc.

### Maintenance

#### Warning

##### 1. Removing the product

The valve will reach a high temperature when used with high temperature fluids. Confirm that the valve temperature has dropped sufficiently before performing work. If touched inadvertently, there is a danger of being burned.

- 1) Shut off the fluid supply and release the fluid pressure in the system.
- 2) Shut off the power supply.
- 3) Dismount the product.

##### 2. Low frequency operation

Switch valves at least once every 30 days to prevent a malfunction. Also, in order to use it under the optimum state, conduct a regular inspection once a half year.

#### Caution

##### 1. Strainers

- 1) Be careful regarding clogging of strainers.
- 2) Clean strainers when the pressure drop reaches 0.1 MPa.

##### 2. Lubrication

When using after lubricating, never forget to lubricate continuously.

##### 3. Storage

In case of long term storage after use, thoroughly remove all moisture to prevent rust and deterioration of rubber materials etc.

##### 4. Exhaust the drainage from the piping periodically.

### Operating Precautions

#### Warning

1. If there is a possibility of reverse pressure being applied to the valve, take countermeasures such as mounting a check valve on the downstream side of the valve.
2. When problems are caused by a steam hammer, install a steam hammer relief device such as an accumulator.
3. When the pilot type 2 port solenoid valve is closed, and pressure is applied suddenly due to the starting of fluid supply source such as a boiler, the valve may open momentarily and fluid may leak.
4. If the product is used in the conditions in which rapid decrease in the inlet pressure of the valve and rapid increase in the outlet pressure of the valve are repeated, excessive stress will be applied to the piston, which causes the piston to be damaged and dropped, leading to the operation failure of the valve. Check the operating conditions before use.





# Series VXS Specific Product Precautions 4


Be sure to read before handling. Refer to back cover for Safety Instructions, "Handling Precautions for SMC Products" (M-E03-3) and the Operation Manual for 2 Port Solenoid Valves for Fluid Control Precautions. Please download it via our website, <http://www.smcworld.com>

## Electrical Connections

### Caution

#### Grommet

Class H coil: AWG18 Insulator O.D. 2.1 mm

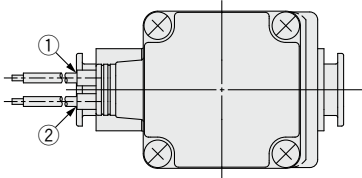


Rated voltage	Lead wire color	
	①	②
DC	Black	Red
100 VAC	Blue	Blue
200 VAC	Red	Red
Other AC	Gray	Gray

\* There is no polarity.


#### DIN terminal

Since internal connections are as shown below for the DIN terminal, make connections to the power supply accordingly.



Terminal no.	1	2
DIN terminal	+ (-)	- (+)

\* There is no polarity.  
 · Use a heavy-duty cord with cable O.D. of  $\phi 6$  to  $\phi 12$  mm.  
 · Use the tightening torques below for each section.

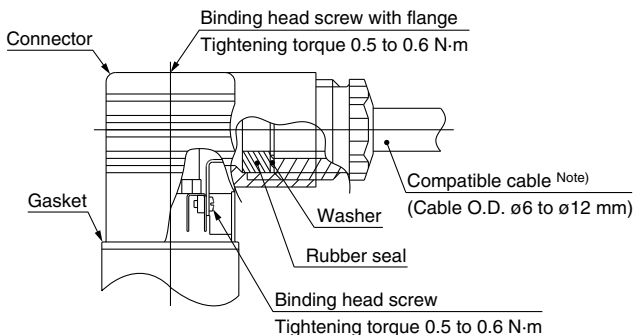

Note) For cable O.D. of  $\phi 9$  to  $\phi 12$  mm, remove the internal parts of the rubber seal before using.

#### [Change of electrical entry]


Wire entry can be changed by mounting the housing in either direction (four directions at every  $90^\circ$ ) after dividing the terminal block and the housing.

\* For the indicator lighted style, be careful not to damage the light with the lead wire of the cable.

#### Conduit terminal

In the case of the conduit terminal, make connections according to the marks shown below.

- Use the tightening torques below for each section.
- Properly seal the terminal connection (G1/2) with the special wiring conduit etc.

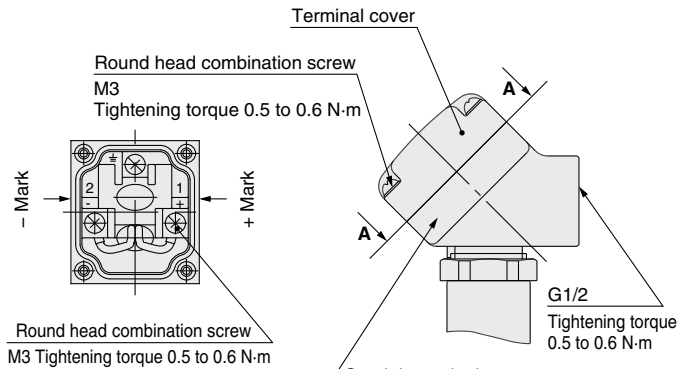


View A-A  
(Internal connection diagram)

#### Conduit

When used as an IP65 equivalent, use seal to install the wiring conduit. Also, use the tightening torque below for the conduit.

Class H coil: AWG18 Insulator O.D. 2.1 mm

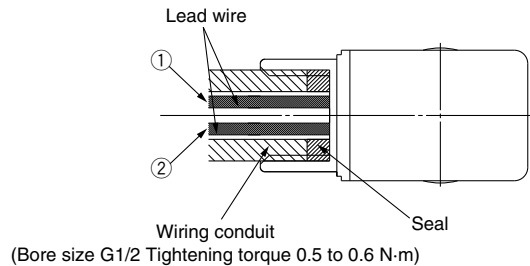

Rated voltage	Lead wire color	
	①	②
DC	Black	Red
100 VAC	Blue	Blue
200 VAC	Red	Red
Other AC	Gray	Gray

\* There is no polarity.  
 (For the power saving type, there is polarity.)

Description	Part no.
Seal	VCW20-15-6

Note) Please order separately.



# Series VXS

## Specific Product Precautions 5


Be sure to read before handling. Refer to back cover for Safety Instructions, "Handling Precautions for SMC Products" (M-E03-3) and the Operation Manual for 2 Port Solenoid Valves for Fluid Control Precautions. Please download it via our website, <http://www.smcworld.com>

### Electrical Circuits

#### ⚠ Caution


[DC circuit]

Grommet




Without electrical option

DIN terminal



With surge voltage suppressor


DIN terminal, Conduit terminal

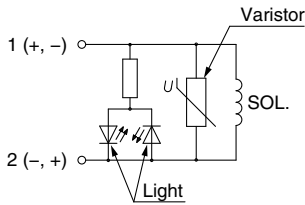

With light/surge voltage suppressor


[AC circuit]

Grommet, DIN terminal,  
Conduit terminal, Conduit



With surge voltage suppressor

DIN terminal, Conduit terminal





With light/surge voltage suppressor


DIN terminal H type with AC voltage has full-wave rectifier built in the DIN connector. Coil does not have full-wave rectifier.

## Safety Instructions

These safety instructions are intended to prevent hazardous situations and/or equipment damage. These instructions indicate the level of potential hazard with the labels of “**Caution**,” “**Warning**” or “**Danger**.” They are all important notes for safety and must be followed in addition to International Standards (ISO/IEC)\*1, and other safety regulations.

 **Caution:** **Caution** indicates a hazard with a low level of risk which, if not avoided, could result in minor or moderate injury.

 **Warning:** **Warning** indicates a hazard with a medium level of risk which, if not avoided, could result in death or serious injury.

 **Danger :** **Danger** indicates a hazard with a high level of risk which, if not avoided, will result in death or serious injury.

- \*1) ISO 4414: Pneumatic fluid power – General rules relating to systems.  
ISO 4413: Hydraulic fluid power – General rules relating to systems.  
IEC 60204-1: Safety of machinery – Electrical equipment of machines.  
(Part 1: General requirements)  
ISO 10218-1: Manipulating industrial robots – Safety.  
etc.

### Warning

#### 1. The compatibility of the product is the responsibility of the person who designs the equipment or decides its specifications.

Since the product specified here is used under various operating conditions, its compatibility with specific equipment must be decided by the person who designs the equipment or decides its specifications based on necessary analysis and test results. The expected performance and safety assurance of the equipment will be the responsibility of the person who has determined its compatibility with the product. This person should also continuously review all specifications of the product referring to its latest catalog information, with a view to giving due consideration to any possibility of equipment failure when configuring the equipment.

#### 2. Only personnel with appropriate training should operate machinery and equipment.

The product specified here may become unsafe if handled incorrectly. The assembly, operation and maintenance of machines or equipment including our products must be performed by an operator who is appropriately trained and experienced.

#### 3. Do not service or attempt to remove product and machinery/equipment until safety is confirmed.

1. The inspection and maintenance of machinery/equipment should only be performed after measures to prevent falling or runaway of the driven objects have been confirmed.
2. When the product is to be removed, confirm that the safety measures as mentioned above are implemented and the power from any appropriate source is cut, and read and understand the specific product precautions of all relevant products carefully.
3. Before machinery/equipment is restarted, take measures to prevent unexpected operation and malfunction.

#### 4. Contact SMC beforehand and take special consideration of safety measures if the product is to be used in any of the following conditions.

1. Conditions and environments outside of the given specifications, or use outdoors or in a place exposed to direct sunlight.
2. Installation on equipment in conjunction with atomic energy, railways, air navigation, space, shipping, vehicles, military, medical treatment, combustion and recreation, or equipment in contact with food and beverages, emergency stop circuits, clutch and brake circuits in press applications, safety equipment or other applications unsuitable for the standard specifications described in the product catalog.
3. An application which could have negative effects on people, property, or animals requiring special safety analysis.
4. Use in an interlock circuit, which requires the provision of double interlock for possible failure by using a mechanical protective function, and periodical checks to confirm proper operation.

### Caution

#### 1. The product is provided for use in manufacturing industries.

The product herein described is basically provided for peaceful use in manufacturing industries.

If considering using the product in other industries, consult SMC beforehand and exchange specifications or a contract if necessary.

If anything is unclear, contact your nearest sales branch.

## Limited warranty and Disclaimer/ Compliance Requirements

The product used is subject to the following “Limited warranty and Disclaimer” and “Compliance Requirements”.

Read and accept them before using the product.

### Limited warranty and Disclaimer

1. The warranty period of the product is 1 year in service or 1.5 years after the product is delivered, whichever is first.\*2)  
Also, the product may have specified durability, running distance or replacement parts. Please consult your nearest sales branch.
2. For any failure or damage reported within the warranty period which is clearly our responsibility, a replacement product or necessary parts will be provided.  
This limited warranty applies only to our product independently, and not to any other damage incurred due to the failure of the product.
3. Prior to using SMC products, please read and understand the warranty terms and disclaimers noted in the specified catalog for the particular products.

**\*2) Vacuum pads are excluded from this 1 year warranty.**

A vacuum pad is a consumable part, so it is warranted for a year after it is delivered.  
Also, even within the warranty period, the wear of a product due to the use of the vacuum pad or failure due to the deterioration of rubber material are not covered by the limited warranty.

### Compliance Requirements

1. The use of SMC products with production equipment for the manufacture of weapons of mass destruction (WMD) or any other weapon is strictly prohibited.
2. The exports of SMC products or technology from one country to another are governed by the relevant security laws and regulations of the countries involved in the transaction. Prior to the shipment of a SMC product to another country, assure that all local rules governing that export are known and followed.

## Safety Instructions

Be sure to read “Handling Precautions for SMC Products” (M-E03-3) before using.